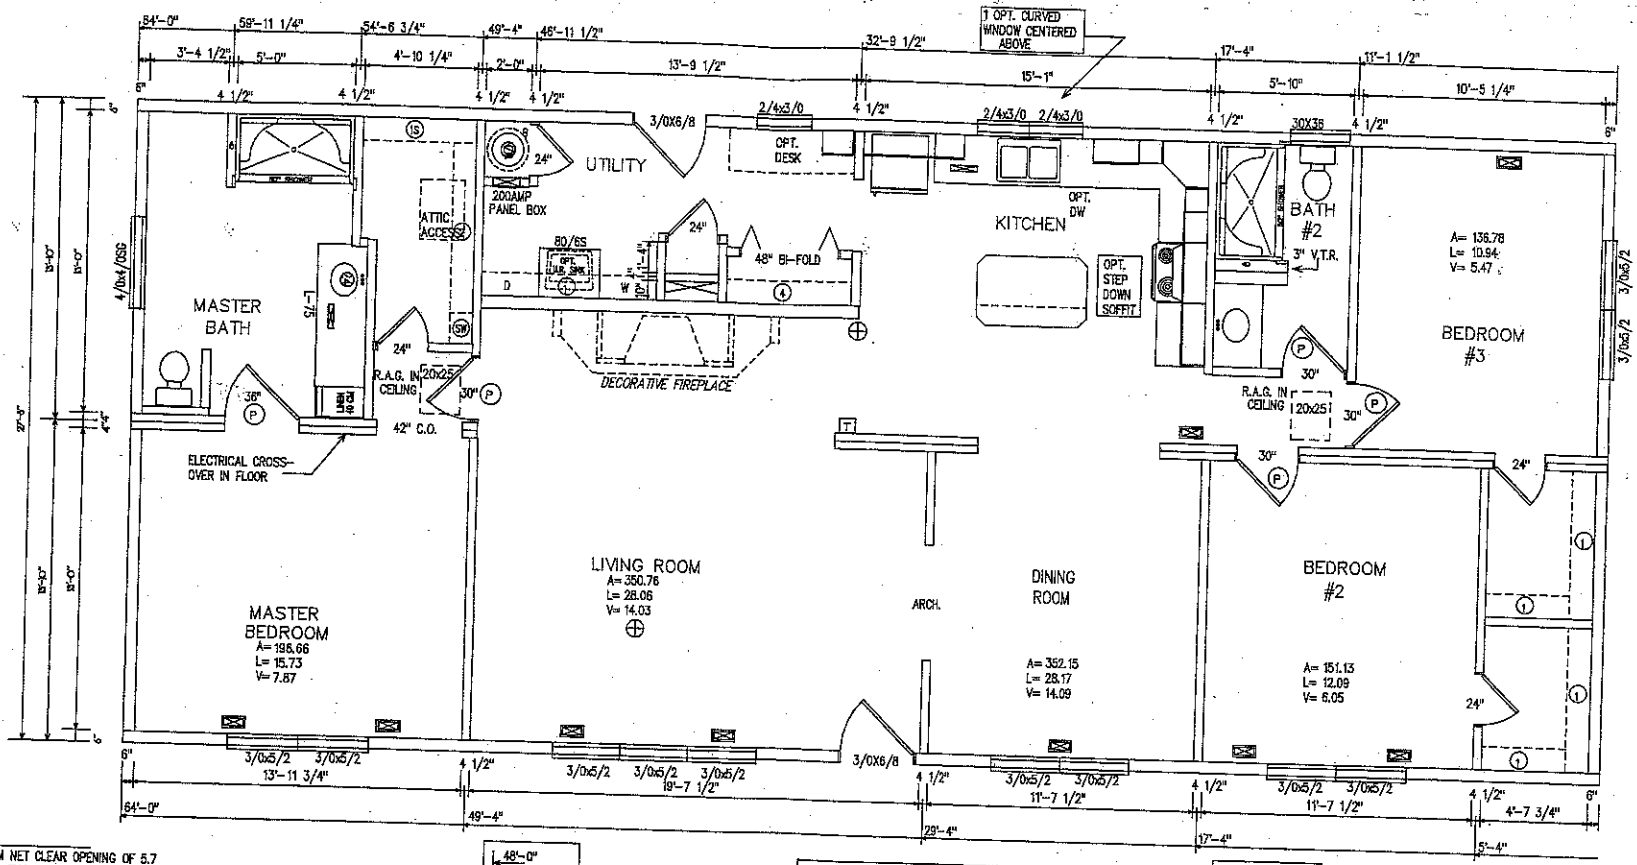


SERIAL # 0000 | SERIAL # 0000
HUD CODE | MODULAR

EGRESS NOTE :

EGRESS WINDOWS MUST HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQ. FT. (5.0 SQ. FT. AT GRADE LEVEL). THE MINIMUM CLEAR WIDTH SHALL BE 20 INCHES, THE MINIMUM CLEAR HEIGHT SHALL BE 24 INCHES. THE SILL HEIGHT SHALL NOT EXCEED 44 INCHES ABOVE THE FLOOR. ALL MUST BE OPERABLE FROM THE INSIDE WITHOUT THE USE OF SEPERATE TOOLS.

FLAMESPREAD NOTE :

ALL WALL AND CEILING FINISHES MUST HAVE A FLAMESPREAD CLASSIFICATION OF LESS THAN 200. THE SMOKE DENSITY DEVELOPMENT RATING SHALL NOT BE GREATER THAN 450. ALL SMOKE DETECTORS ARE PROVIDED WITH A BATTERY BACKUP.

(18) =SHELF & ROD W/SHOE RACK UNDERNEATH			
(1) =1 SHELF	(2) =2 SHELVES		
(4) =4 SHELVES	(SW) =SWEATER SHELVES	FLOOR PLAN LEGEND	
⊕ = DUCT CONNECTOR		E EGRESS WINDOW	(T) THERMOSTAT
(6) =20"X25"RAG/DOOR	(7) =20"X25"RAG/WALL	ELECTRICAL PANEL	(S) SMOKE DETECTOR
(8) =2"X10" OVER DOOR	(24) =24X42 MIRROR	(A) 22"x 30" ATTIC ACCESS	(P) PRIVACY LOCK
(58) =58X42 MIRROR	(72) =72X42 MIRROR	R STEREO	SG SAFTEY GLAZED

STANDARD
TOTAL GLASS R.O.= 259.9 S.F.

PRELIMINARY
SUBJECT TO FINAL REVISION
JOB # 9197
DATE 9/28/2004
THIS PLAN MUST BE RETURNED TO ENGINEERING WITH PRODUCTION ORDER

R-ANELL HOUSING GROUP, LLC
P.O. Box 428 Denver, N.C. 28037

TITLE: FLOOR PLAN	DATE: 9/28/04	DRAWN BY: JLR	JOB NUMBER: 9197
DESCRIPTION: 546 R-ANELL	SCALE: 3/16"=1'-0"	FILE NUMBER: 0000	DRAWING NUMBER:

9'-0" FLAT THRU-OUT OPT.