08154

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Robert Yearington DATE Aug 17, '88 PERMIT NO. ______

PHONE: Business ______ Home ______

LOCATION 150 E, TR past Carrigan Farms near end on left 4677-48-8725 S. R. No. ______

SUBDIVISION NAME Oakmeadow LOT NO. 10 SECTION OR BLOCK NO. ______

House (✓) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes (✓) No ( )

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

~~Site Suitable~~ PS Yes (✓) No ( )

Character & Porosity of Soil clay class IVA

Percolation Rate .2-.3


Topography ~8%

Depth to Water Table 44

Rock or other impervious formations scattered rock numerous

Lot Area 1 AC +

✓ Basement with Plumbing ______ Basement without Plumbing ______ No Basement

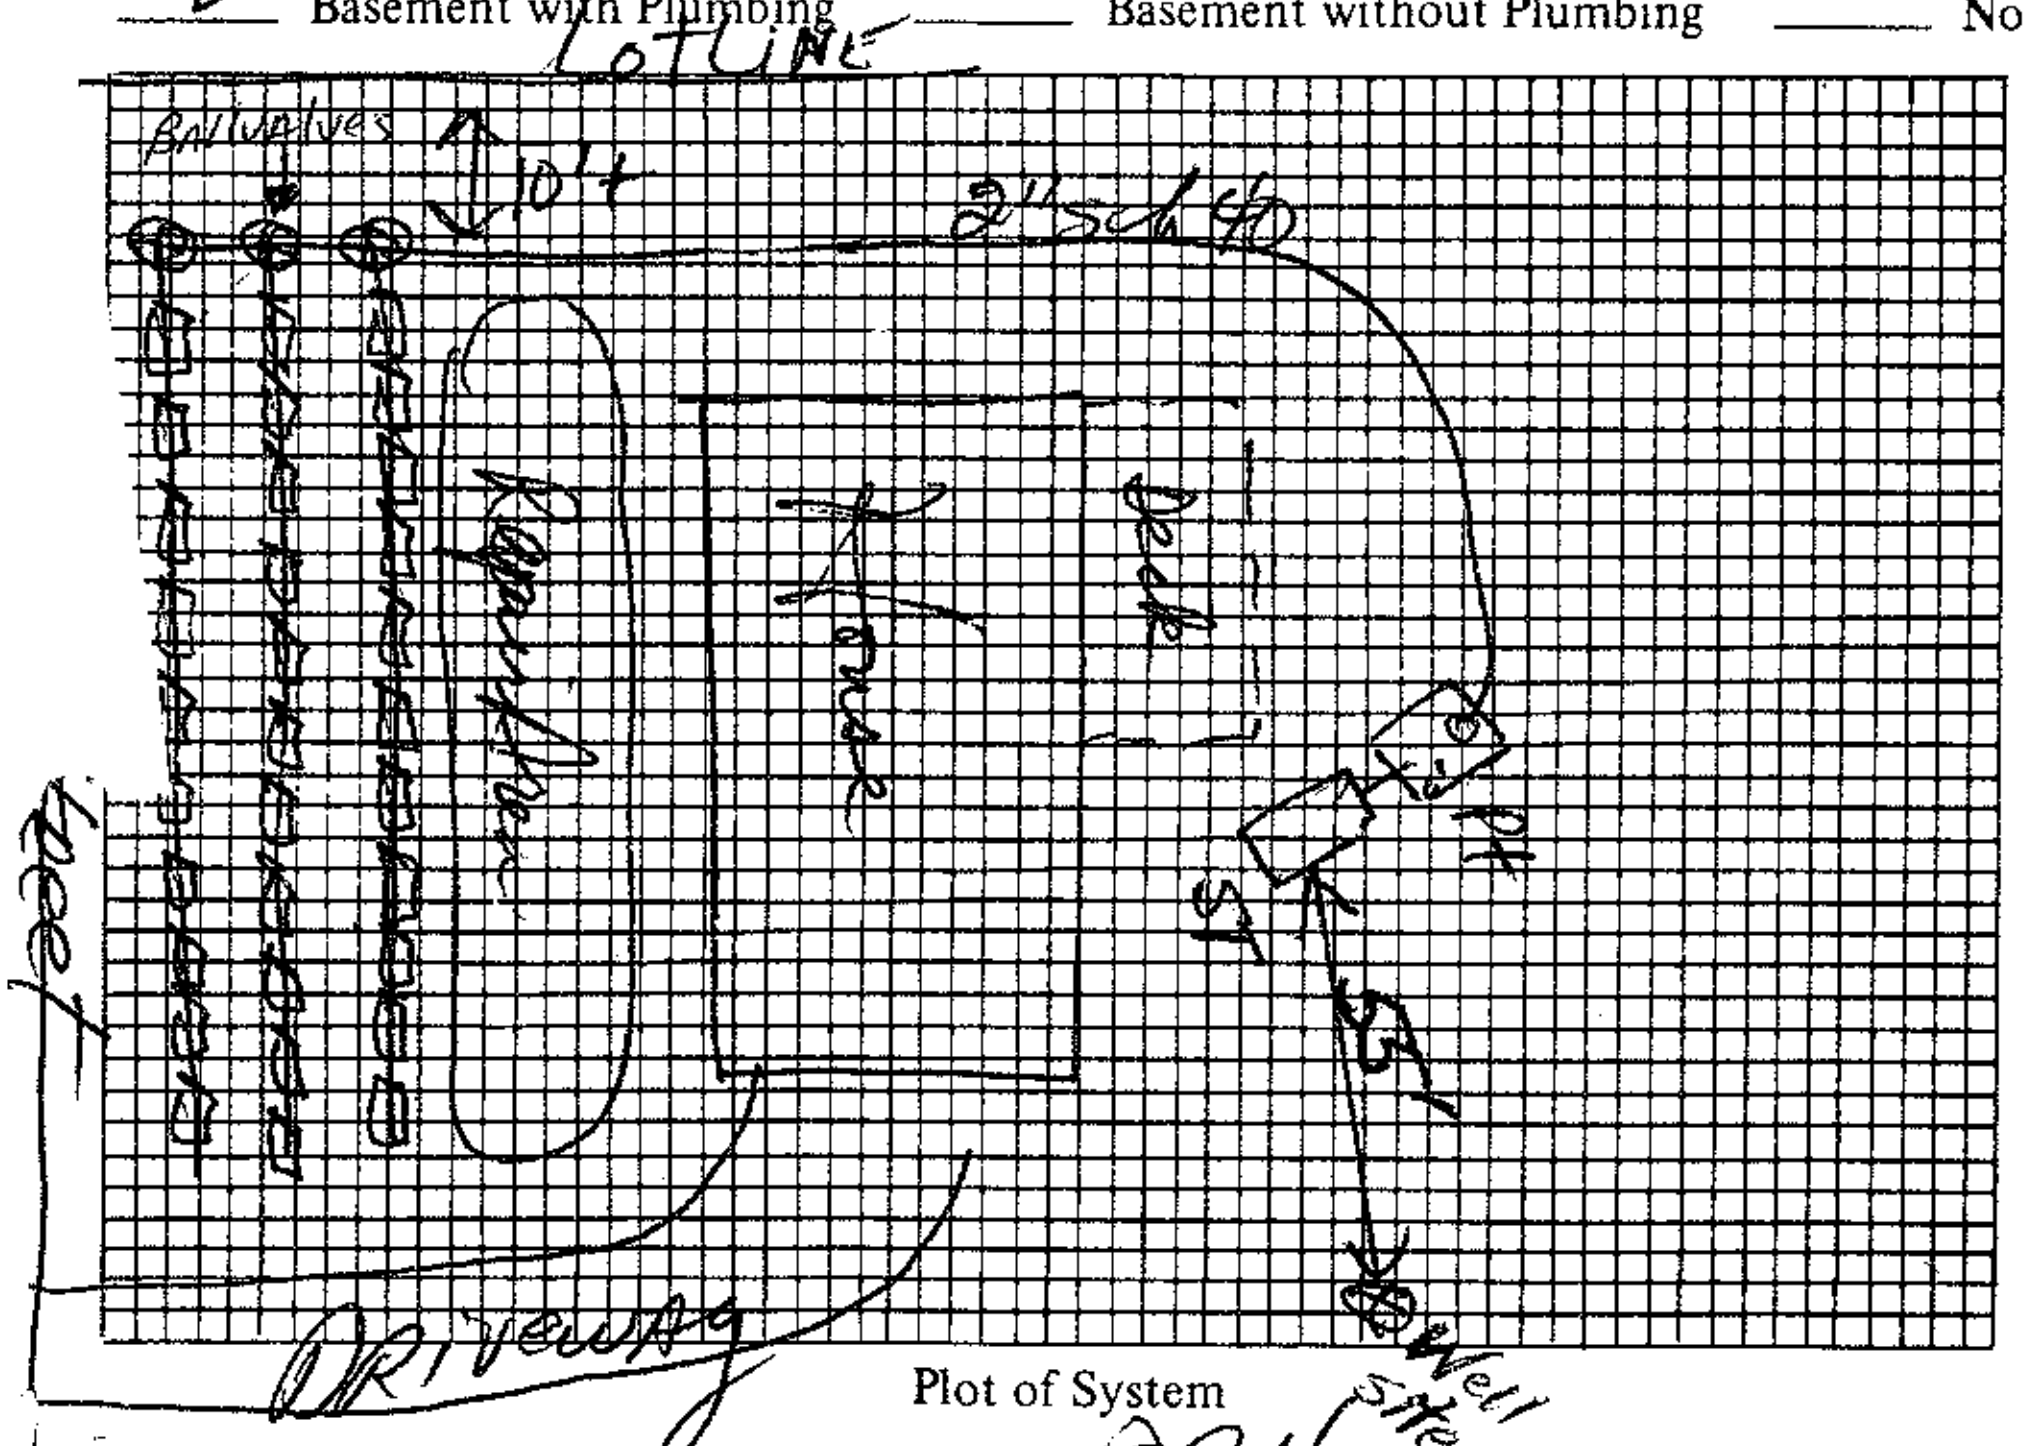

Plot of System

1250 pumptank

Size of Tank 1250 Gals.

Nitrification Field:

No. of Lines 3

Sq. Ft. ______ Linear Ft. 270 [illegible]

Depth of Stone in Lines 16" [illegible]

Water Supply: Individual (✓) panels pressure-dosed

Public ( )

Installed by Bennie Myers Rowan Co.

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ______

IMPROVEMENTS PERMIT BY DLH

COMMENTS: Alarm checked & working but not mounted yet.

(6) panels total used with one 3/16" hole per panel. 2' pressure/ditch

CERTIFICATE OF COMPLETION BY D L Hinson, RS DATE 8-17-88

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making ...ovements Permit.

...ept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold