4677517395

IREDELL COUNTY HEALTH DEPARTMENT

15285

IMPROVEMENT PERMIT AND CERTIFICATE OF COMPLETION / OPERATIONS PERMIT

OWNER OR CONTRACTOR Daniel J Brewer DATE 4/12/93 PERMIT NO. 16-A-9

PHONE: Business _____ Home 663-3802

LOCATION Brumley Rd, Enochville TR on Brumley X creek to 3rd house on (L), house ~800' off road in field S.R. No. _____

SUBDIVISION NAME N/A LOT NO. N/A SECTION OR BLOCK NO. _____

House ☑ Mobile Home ☐ Business ☐ Other _____

No. Bedrooms 3 No. Bathrooms 2 Soil Characteristics P-C/C TRANS.


Garbage Disposal Unit Yes ☐ No ☑ Application Rate P-.25 (WK, SP, S)

Auto. Dishwasher Yes ☑ No ☐ Topography P

Auto. Wash. Machine Yes ☑ No ☐ Depth to Water Table P

Lot Area ~20,000 FT² Rock or other impervious formations S None

_____ Basement with Plumbing ✓ Basement without Plumbing 1/2 _____ No Basement _____ Crawl Space

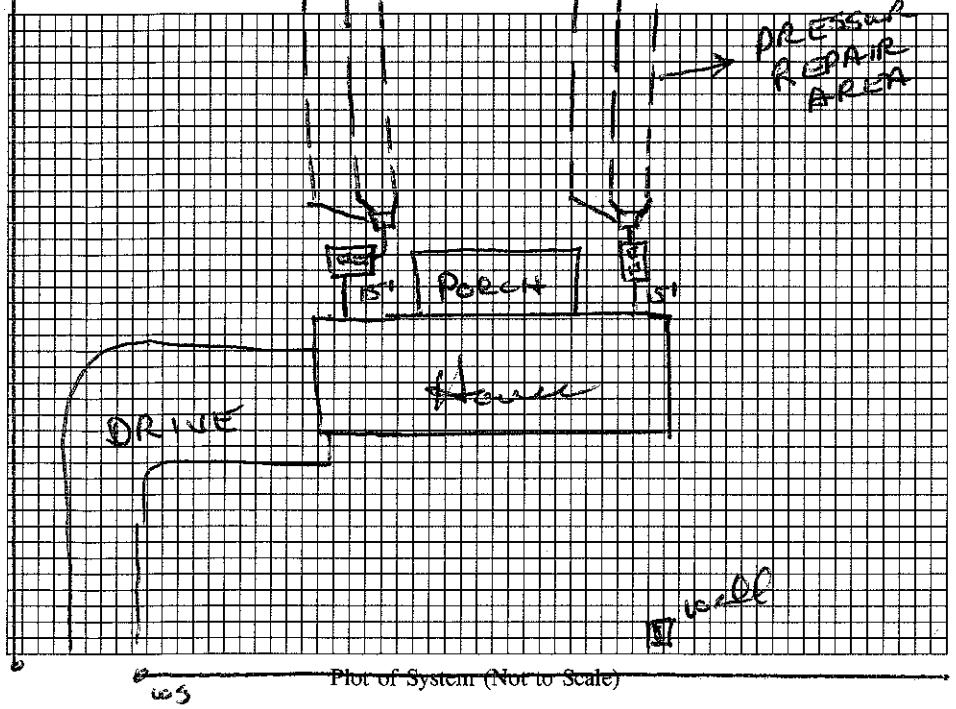

Size of Tank 1000 / 1000 Gals.

Nitrification Field:

No. of Lines 6 (@) 80'x3'

Sq. Ft. 1440 Linear Ft. 480

Depth of Stone in Lines 12

Water Supply: Individual ☑ Public ☐

Installed by Sammy Revis

I understand and agree to install a septic tank system as specified on this Improvement Permit.

Signed: _____

(IMPROVEMENT PERMIT IS VALID FOR 60 MONTHS FROM DATE OF ISSUE.)

IMPROVEMENT PERMIT BY AWS

COMMENTS Plumbing split to accomodate the manner in which plumbing was done on house.

CERTIFICATE OF COMPLETION BY Wesley Sparks RS. DATE 4/12/93

EXISTING SYSTEM CHECKED BY _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS

Permit is VOID if any unauthorized changes are made in installation of system, and/or if any unapproved changes are made to the site, and/or if any false information is supplied toward securing Improvement Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

15285

IREDELL COUNTY HEALTH DEPARTMENT

IMPROVEMENT PERMIT AND CERTIFICATE OF COMPLETION / OPERATIONS PERMIT

(HAROLD BEYER BUILDER)

OWNER OR CONTRACTOR DANIEL J. BREWER DATE 10/7/92 PERMIT NO. IG-A-9

PHONE: Business ______ Home 663-3802


LOCATION NC 150-152 INTERSECTION EAST OF MOORESVILLE, TAKE 152 NEXT RD ON RIGHT 1153 (BRUMBLY RD APPROX 1 MILE ON RIGHT - HOUSE ~300' OFF ROAD S.R. No. ______

SUBDIVISION NAME ______ LOT NO. ______ SECTION OR BLOCK NO. ______

House ☑ Mobile Home ☐ Business ☐ Other ______

No. Bedrooms 3	No. Bathrooms 2	Soil Characteristics	PS. CLAY
Garbage Disposal Unit	Yes ☐ No ☑	Application Rate	0.25
Auto. Dishwasher	Yes ☑ No ☐	Topography	S
Auto. Wash. Machine	Yes ☑ No ☐	Depth to Water Table	S >48"
Lot Area 20,000 sq'		Rock or other impervious formations	NONE

______ Basement with Plumbing ✓ Basement without Plumbing ______ No Basement ______ Crawl Space

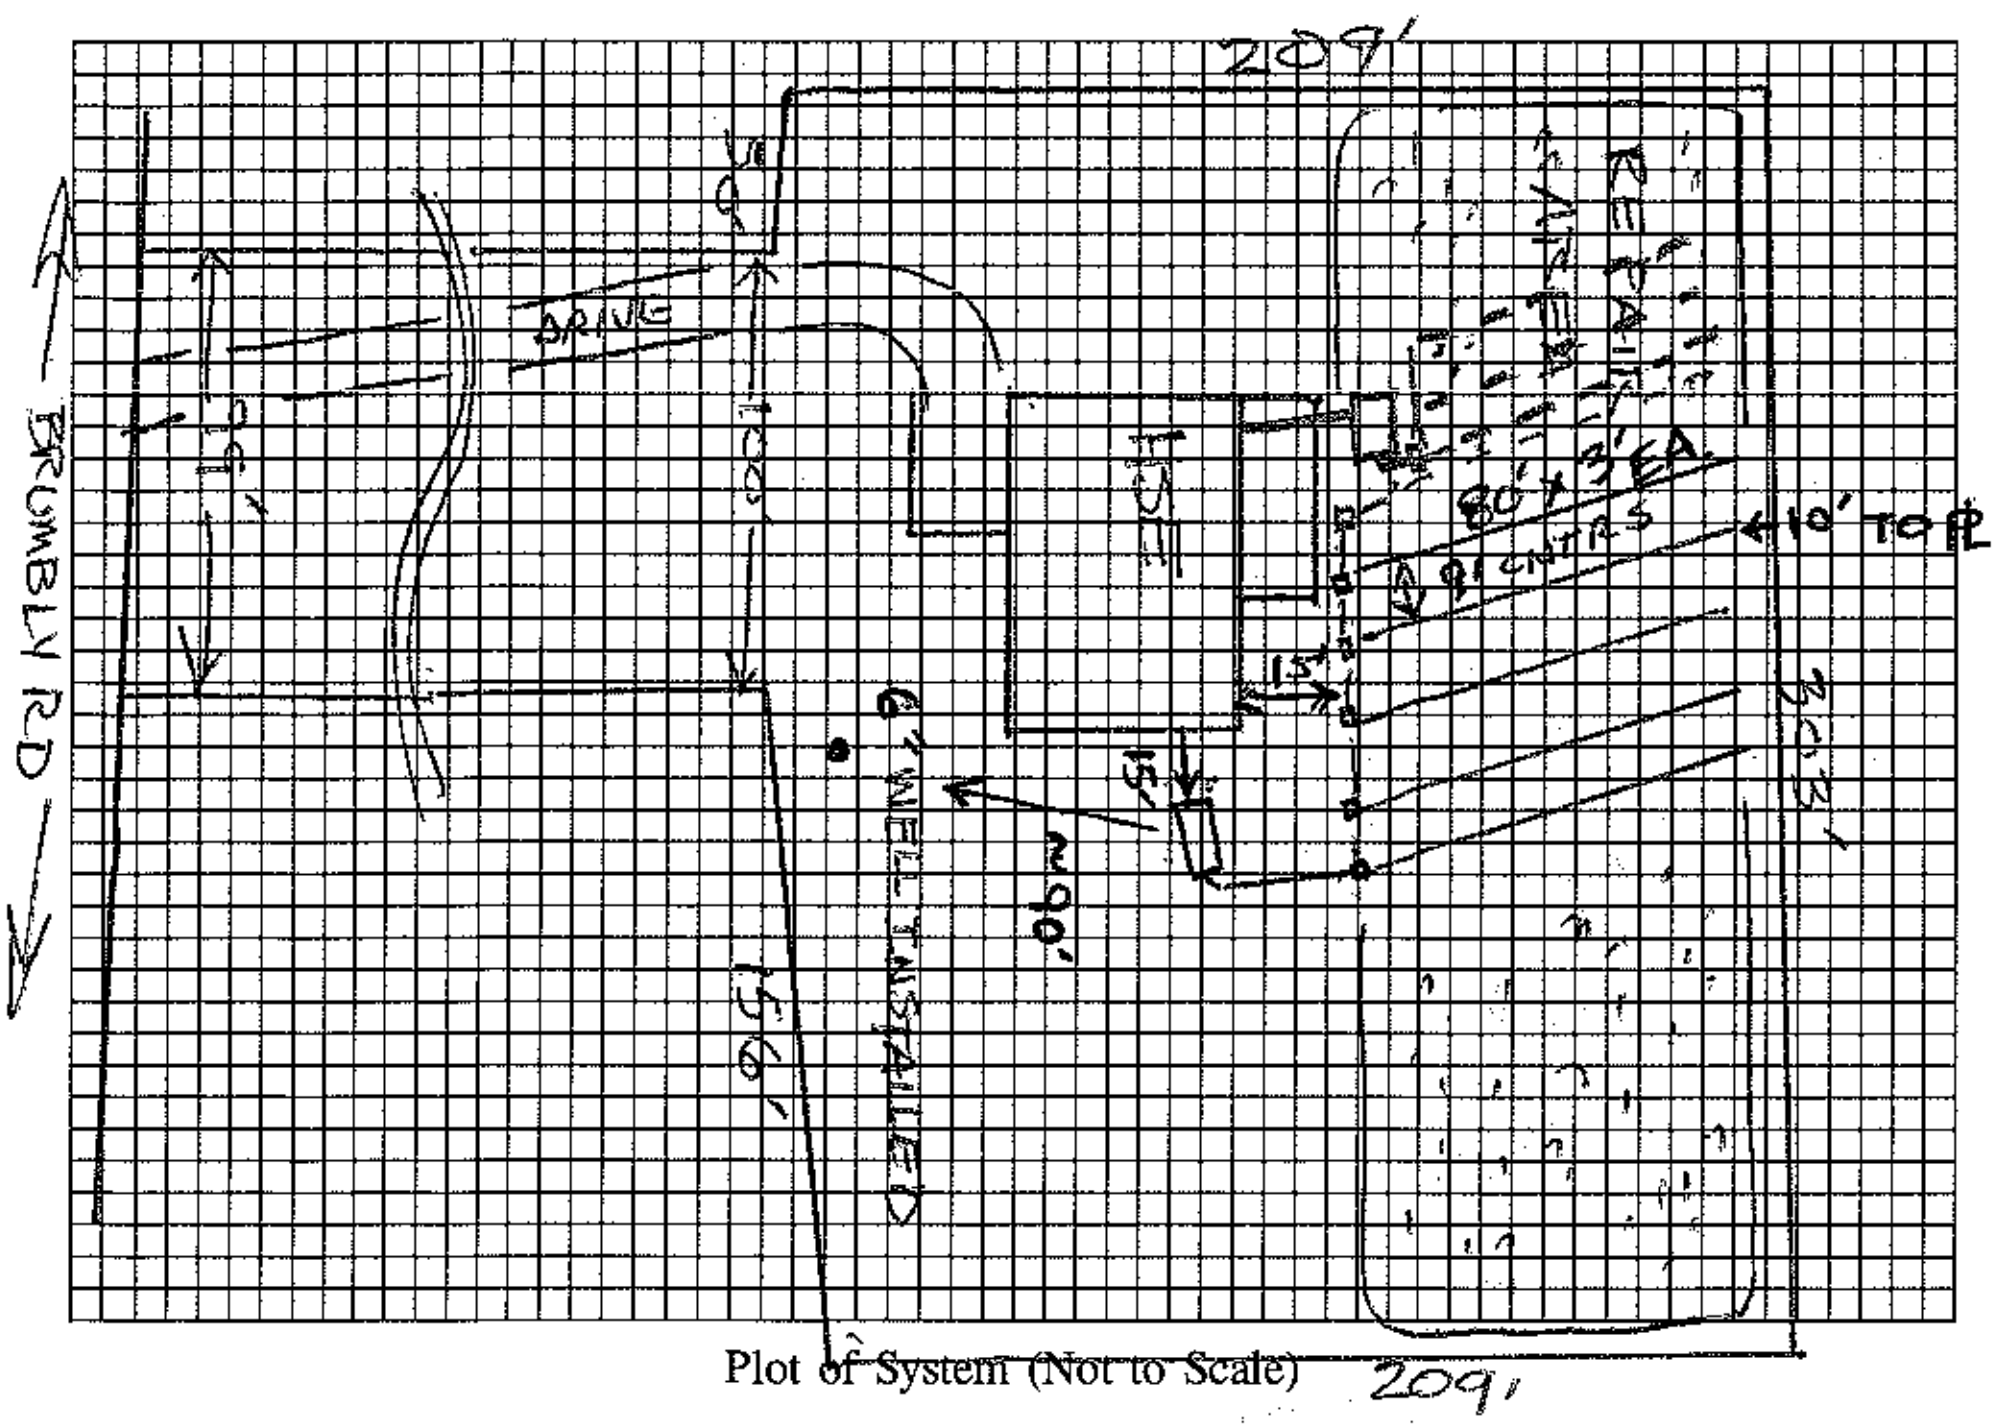

Plot of System (Not to Scale)

Size of Tank 1000 Gals.

Nitrification Field: AWS

No. of Lines 6

Sq. Ft. 1440 Linear Ft. 480

Depth of Stone in Lines 12"

Water Supply: Individual ☑ ALREADY

Public ☐ DRILLED

Installed by ______

I understand and agree to install a septic tank system as specified on this Improvement Permit.

Signed: X [signature]

(IMPROVEMENT PERMIT IS VALID FOR 60 MONTHS FROM DATE OF ISSUE.)

IMPROVEMENT PERMIT BY Wesley Sparks RS.

COMMENTS DO NOT INSTALL DURING WET SOIL CONDITIONS. MAXIMUM 24" DITCH BOTTOM DEPTH. SEPTIC TANK NEEDS TO BE SET SLIGHTLY ABOVE EXISTING GRADE & 15' FROM BASEMENT EXCAVATION. 4/7/93 Split system 2 - 1000 GAL TANK WITH 240 LIN. FT. OFF EACH TANK - AWS.

CERTIFICATE OF COMPLETION BY ______ DATE ______

EXISTING SYSTEM CHECKED BY ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS

Permit is VOID if any unauthorized changes are made in installation of system, and/or if any unapproved changes are made to the site, and/or if any false information is supplied toward securing Improvement Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold