4677-72-2674
201 Brumley Rd

11751

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Marcus Jones DATE May 22, 191 PERMIT NO. IG-A-52

PHONE: Business _____ Home _____

LOCATION 152 E left TR 1153 (Brumley Rd.) 2nd driveway to ✓ S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other _____


No. Bedrooms 3 No. Bathrooms 2 1/2

Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable PS Yes (✓) No ( )
Lot Area 1.085 Ac.

Basement with Plumbing ____ Basement without Plumbing ____ No Basement

Area) drainfield
Character & Porosity of Soil ps clay (firm)
Percolation Rate 2 3
Topography 4 6%
Depth to Water Table 3'+
Rock or other impervious formations none obs.

1000 gal.
Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 8
Sq. Ft. 1200 Linear Ft. 400
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

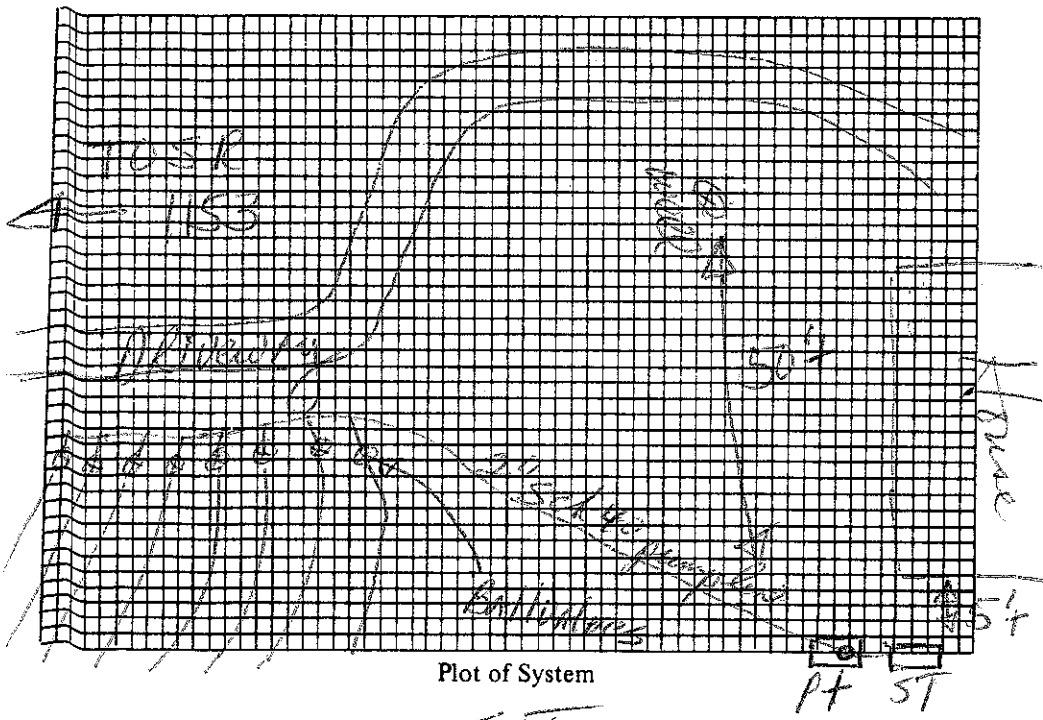

Plot of System

Installed by D Irwin

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY SCL

COMMENTS: Alarm tested & functioning but not permanently mounted yet.

Operation permit

CERTIFICATE OF COMPLETION BY D Harrison, RS, EHC DATE 5/22/91

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold