4678229153

IREDELL COUNTY HEALTH DEPARTMENT

STATESVILLE 704-878-5305 MOORESVILLE 704-664-5281

IMPROVEMENT PERMIT / CERTIFICATE OF COMPLETION / OPERATION PERMIT / EXISTING SYSTEM INSPECTION

PROPERTY DESCRIPTION NO. 22029 DATE 9/26/95 TAX MAP NO. IN A 12B Watershed: X Yes ☐ No

OWNER OR CONTRACTOR Douglas Hamilton PHONE: Business _____ Home 597-2233

ADDRESS 4314 Johny Drive Charlotte, NC. 28216

LOCATION Wiggins Rd. .7 mile from 150 on (L)

SUBDIVISION N/A BLOCK / SECTION _____ LOT _____ LOT AREA 1.012 Ac SITE CLASS. PS DESIGN FLOW 480 L.T.A.R. .3

Septic Tank: 1000 Gallons; STB 1017 Date 1/29/96
Pump Tank: _____ Gallons; PT _____ Date _____
Pump Make: _____ Model _____ Serial No. _____
Nitrification Field: No Fields 1 Square Feet 1200 Linear Feet * 400
No Lines 5 Trench Width 36" Max Trench Bottom Depth 36" Gravel Depth N/A

X New System ☐ Repair System Type: I, II, III, IV, V, VI
System Description: GRAV. INFILTRATOR
Repair System Description: SAME
Maintenance Agreement Required: ☐ Yes ☐ No

X House/Mod. Home No. Bedrooms 4
☐ Mobile Home No. Bathrooms 3
☐ Business No. Employees _____
☐ Other _____
☐ Slab X Crawl Space ☐ Basement w/plumbing ☐ Basement wo/plumbing


Water Supply: X Individual ☐ Community ☐ Public


Comments: 400 FT of gravity infiltrator

Comments:

The proposed / existing Storage Building addition does not appear to impact the existing septic system.
**NOTE: Must be at least 25' from well
Marina Nelson R.S.
Date: 3/12/2012
ICHD-Environmental Health Division

INITIAL SITE SKETCH

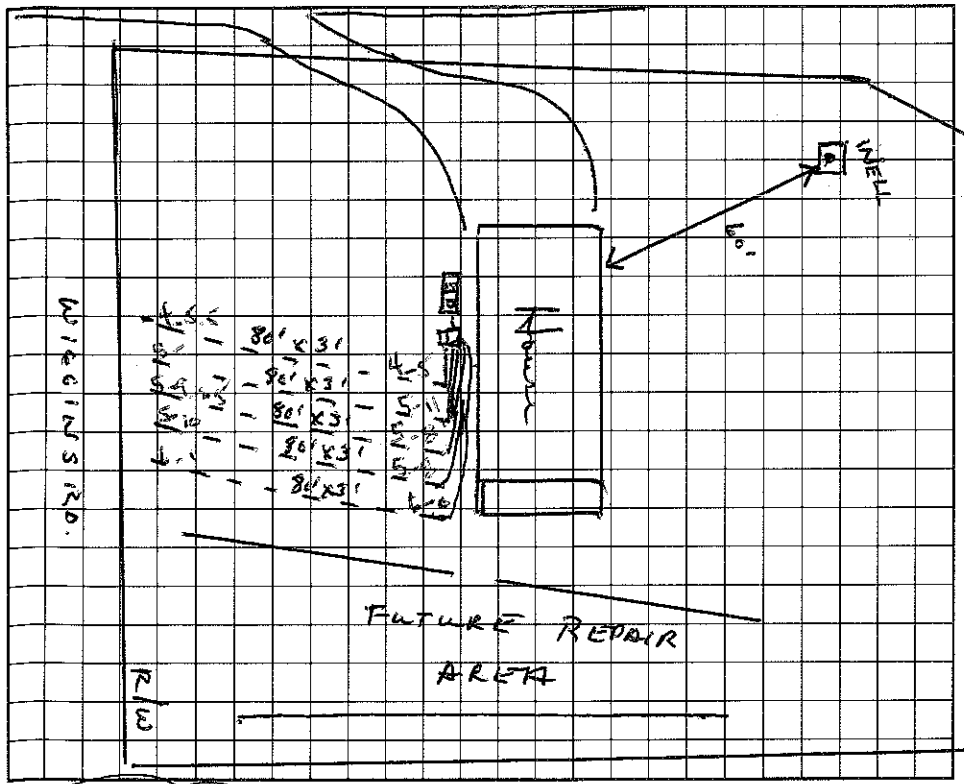

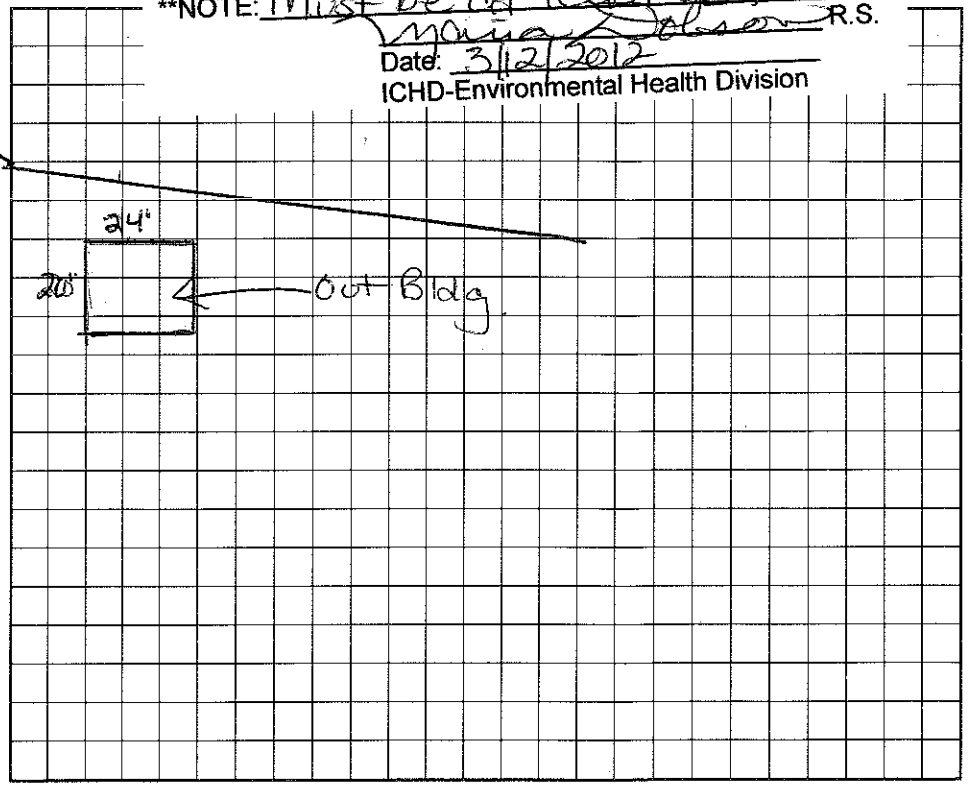

I understand that this permit can be suspended or revoked if any false information is supplied toward securing the permit/any unauthorized changes are made to the site/any unauthorized changes are made in the installation of the system.

Signed: X Roger Brewer for Frank Burke Harmon

Improvement Permit by: Wesley Sparks R.S. date 9/20/95

Existing System Inspection by: _____ date _____

Installed by: _____

Certificate of Completion by: _____ date _____

Operation Permit by: Wesley Sparks R.S. date 4/12/96

HEALTH DEPT. COPY: WHITE INSPECTION COPY (FINAL): GREEN OWNER COPY (FINAL): YELLOW INSPECTION COPY (INITIAL): PINK OWNER COPY (INITIAL): GOLD