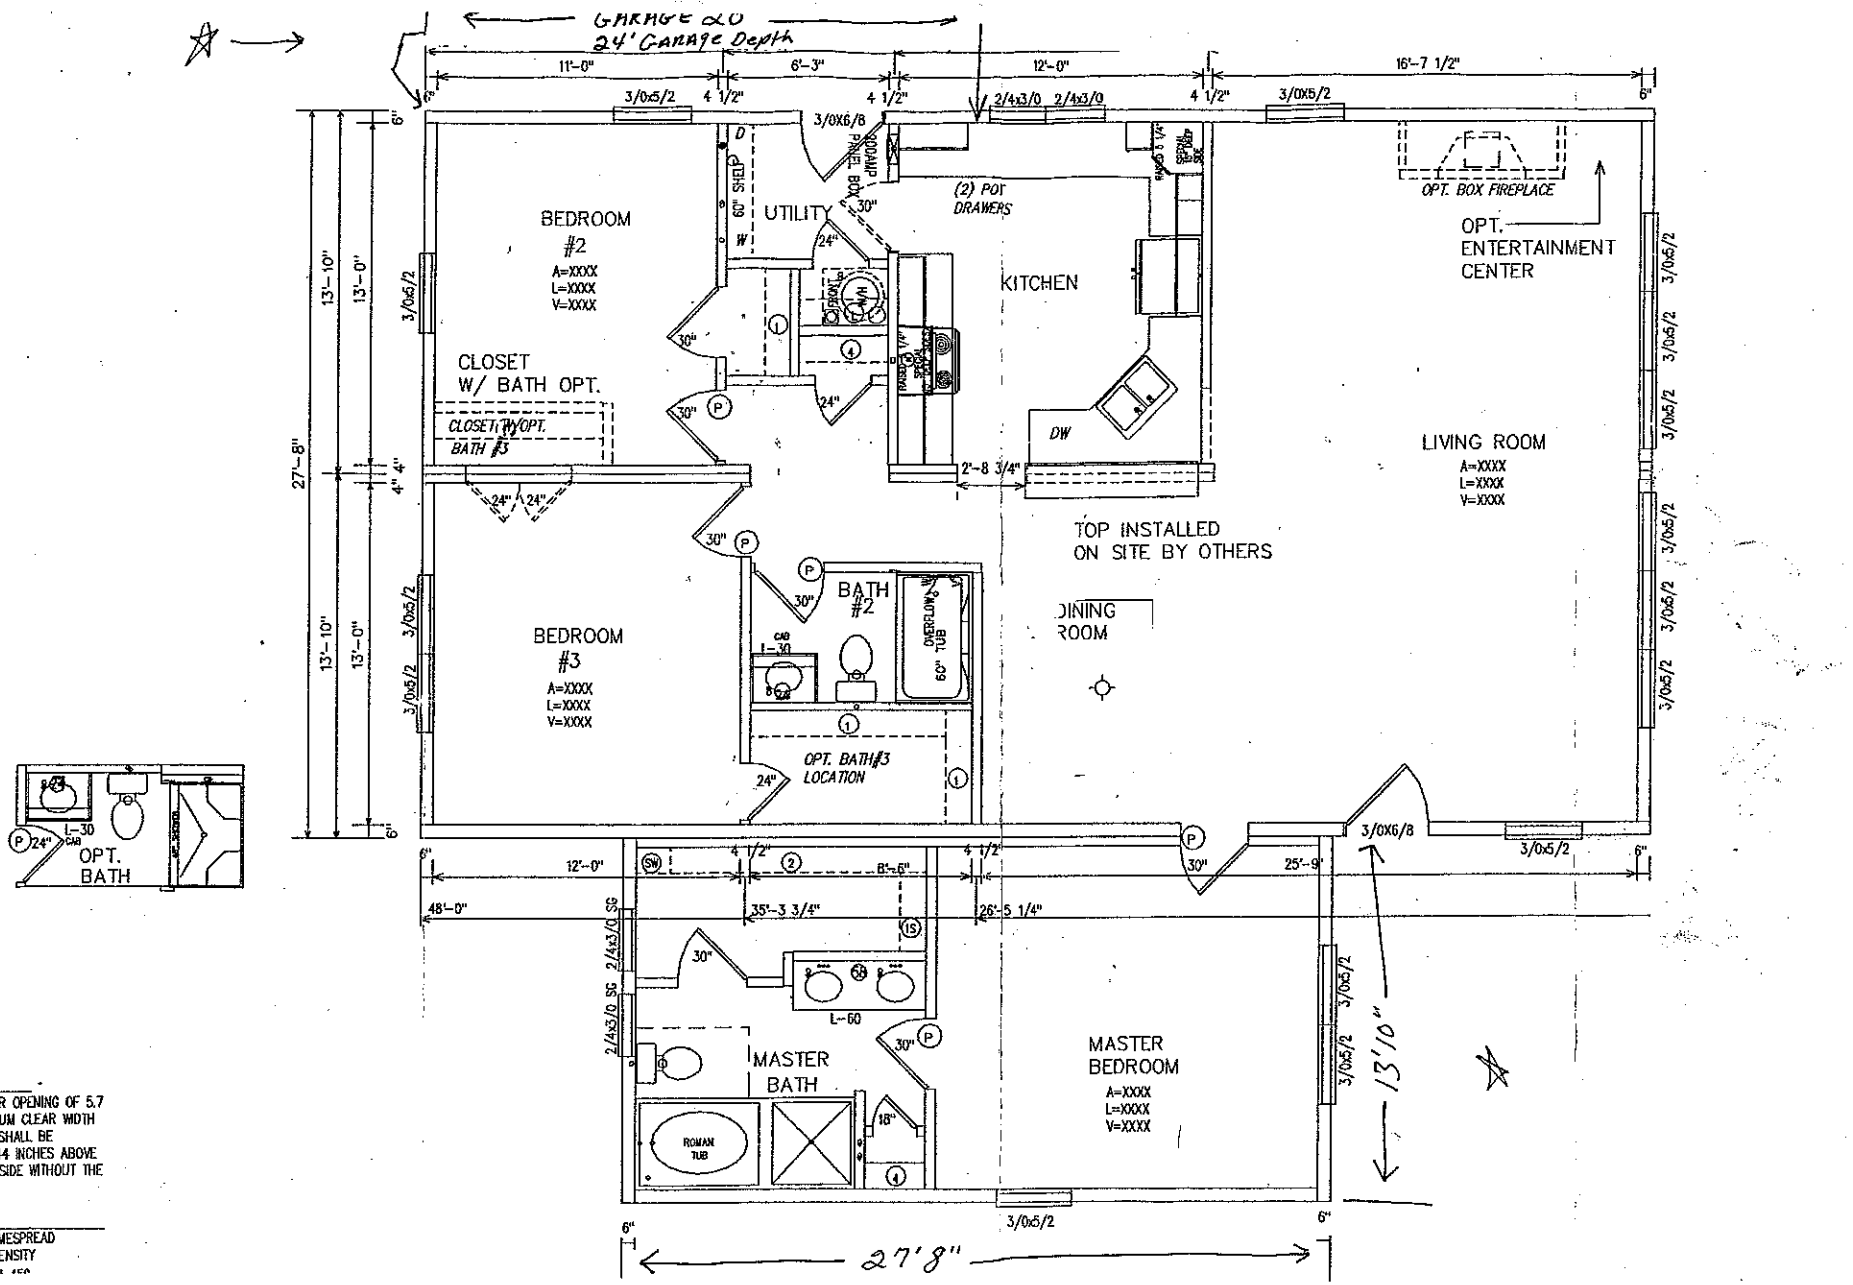


MINIMUM NET CLEAR OPENING OF 5.7
LEVEL). THE MINIMUM CLEAR WIDTH
MUM CLEAR HEIGHT SHALL BE
HALL NOT EXCEED 44 INCHES ABOVE
RABLE FROM THE INSIDE WITHOUT THE

TE :
MUST HAVE A FLAMESPREAD
200. THE SMOKE DENSITY

Acknowledgement Of
Plans Submittal ONLY!
Date 5/3/13
Date