10075

150 Dun Rovin Ln
4685-03-1195

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Allen Heavner DATE Aug 30, '89 PERMIT NO. 1A-A-1C

PHONE: Business ______ Home ______

LOCATION N. Main TR 1150 (Linwood Rd.) TR 1143 (Patterson Farm Rd.) ~1/2 mile TR across from "Duck Houses" on right S. R. No. ______

SUBDIVISION NAME ______ LOT NO. ______ SECTION OR BLOCK NO. ______

House ( ) Mobile Home (✓) Business ( ) Other ______

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

~~Site Suitable~~ PS Yes ( ) No ( )

Lot Area ~1 Ac.

Character & Porosity of Soil shallow ps clay


Percolation Rate No 3

Topography 6-8%

Depth to Water Table 3'+

Rock or other impervious formations none obs.

______ Basement with Plumbing ______ Basement without Plumbing ✓ No Basement

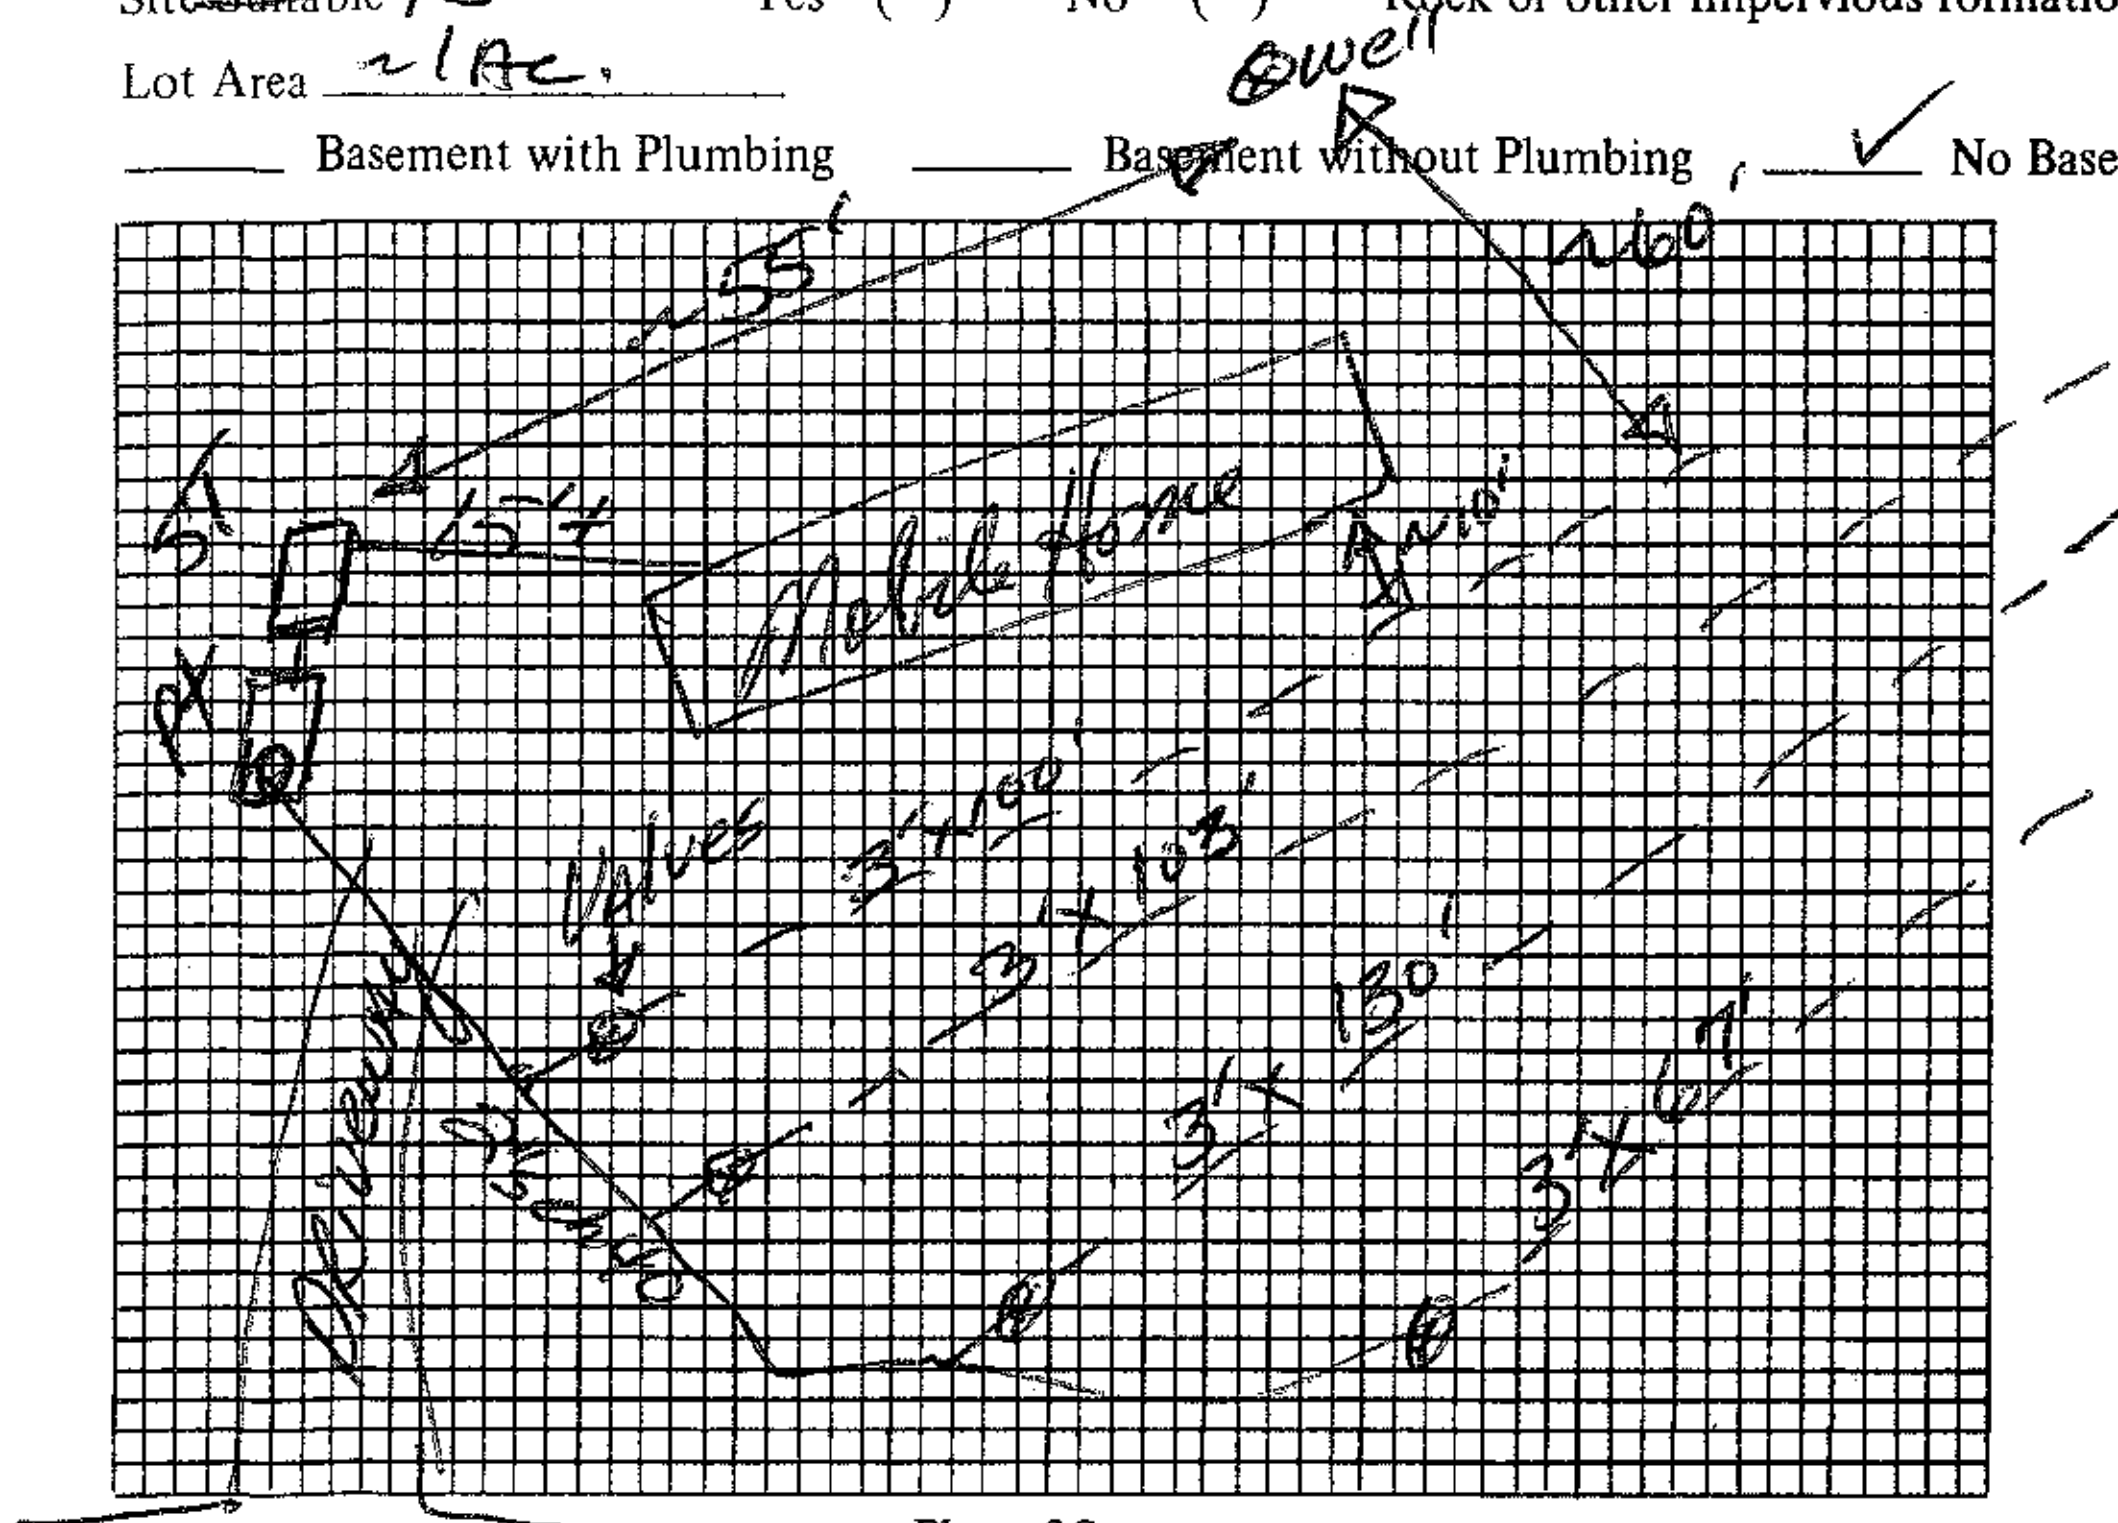

Plot of System

1000 p.T.

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 4

Sq. Ft. 1200 Linear Ft. 400

Depth of Stone in Lines 12"

Water Supply: Individual (✓)

Public ( )

Installed by Sigmon

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ______

~~IMPROVEMENTS PERMIT BY~~ Acess Road TO 1143 →

COMMENTS: Alarm on site, checked & working but not mounted yet inside M.H.

CERTIFICATE OF COMPLETION BY D R Henson, RS. DATE 8-30-89

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold