Harrington Construction 206509

IREDELL COUNTY HEALTH DEPARTMENT

IMPROVEMENT PERMIT / CERTIFICATE OF COMPLETION / OPERATION PERMIT / EXISTING SYSTEM INSPECTION

STATESVILLE 704-878-5305 MOORESVILLE 704-664-5281 49269

PROPERTY DESCRIPTION NO. 16654 DATE 11-3-93

OWNER OR CONTRACTOR Terry Sherrill TAX MAP NO. 3N-3-A-13

ADDRESS Rt. 3 Box 4160 Statesville, N.C. 28677 PHONE: Business _____ Home 872-1806

LOCATION I-40 W TL old Mtn. Rd. TR Celeste-Eufola Rd. TL Eufola Rd. TR Carriage Rd. TR Lake Top Lane Lot at end of Cul-de-Sac. Watershed: ☐ Yes ☑ No

SUBDIVISION Top of the Lake BLOCK / SECTION _____ LOT 13 LOT AREA ≈.5k acre SITE CLASS. P.S. DESIGN FLOW 360 L.T.A.R. .3 gpd/ft²

Septic Tank: 1500 Gallons; STB 1011 Date 10-9-93

Pump Tank: — Gallons; PT — Date —

Pump Make: — Model — Serial No. —

Nitrification Field: No Fields 2 Square Feet 400 Panels Linear Feet 200'

No Lines 5 Trench Width 24" Max Trench Bottom Depth 30" Gravel Depth 24"

☑ New System ☐ Repair System Type: I, II, III, IV, V, VI

System Description: PPBPS, gravity

Repair System Description: PPBPS, gravity

Maintenance Agreement Required: ☐ Yes ☑ No


☑ House/Mod. Home ☐ Mobile Home ☐ Business ☐ Other

No. Bedrooms 3 No. Bathrooms 3 No. Employees —

☐ Slab ☐ Crawl Space ☐ Basement w/plumbing ☑ Basement wo/plumbing

Water Supply: ☑ Individual ☐ Community ☐ Public


Comments: Install PPBPS, gravity. Install flow devider between tank and drain fields. Install 46 panels total. Keep lines on contour. Keep system 15' from foundation or sidestore of basement drain, 10' downgra from basement drain, 10' from all property lines, and 50' from any wells. 100% Repair Area below system, INITIAL SITE SKETCH PPBPS, gravity fed.

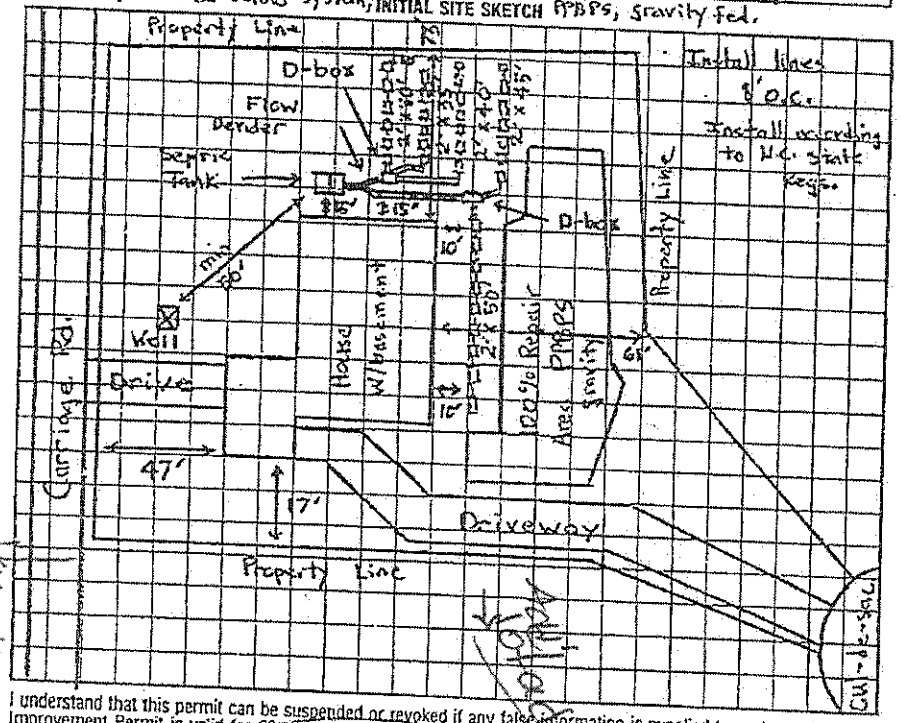

Location of the proposed 28'x28' BLDG addition does not appear to impact the existing on-site septic system or well. **NOTE: area where lines were to be installed

REHS Date: 10/24/14

ICHD-Environmental Health Division

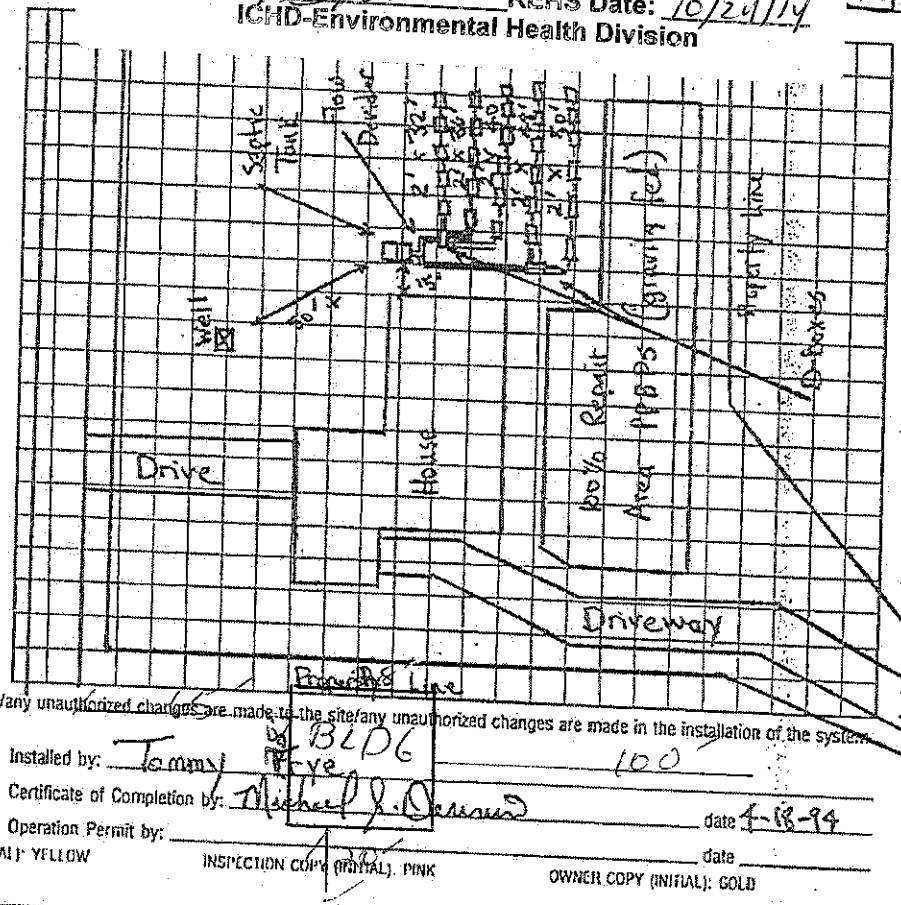

I understand that this permit can be suspended or revoked if any false information is supplied toward securing the permit/any unauthorized changes are made to the site/any unauthorized changes are made in the installation of the system. Improvement Permit is valid for 60 months from date of issuance.

Signed: _____

Improvement Permit by: Michael J. Deraso date 11-3-93

Existing System Inspection by: _____ date _____

Installed by: Tommy 100

Certificate of Completion by: Michael J. Deraso date 4-18-94

Operation Permit by: _____ date _____

HEALTH DEPT COPY: WHITE INSPECTION COPY (FINAL): GREEN OWNER COPY (FINAL): YELLOW INSPECTION COPY (INITIAL): PINK OWNER COPY (INITIAL): GOLD

This line is actually 27'