
Acknowledgement Of
Plans Submittal ONLY!

Date

Date 19 May 11

APPROVED BY
NFA INC.
09/04/2008
Mike Faller

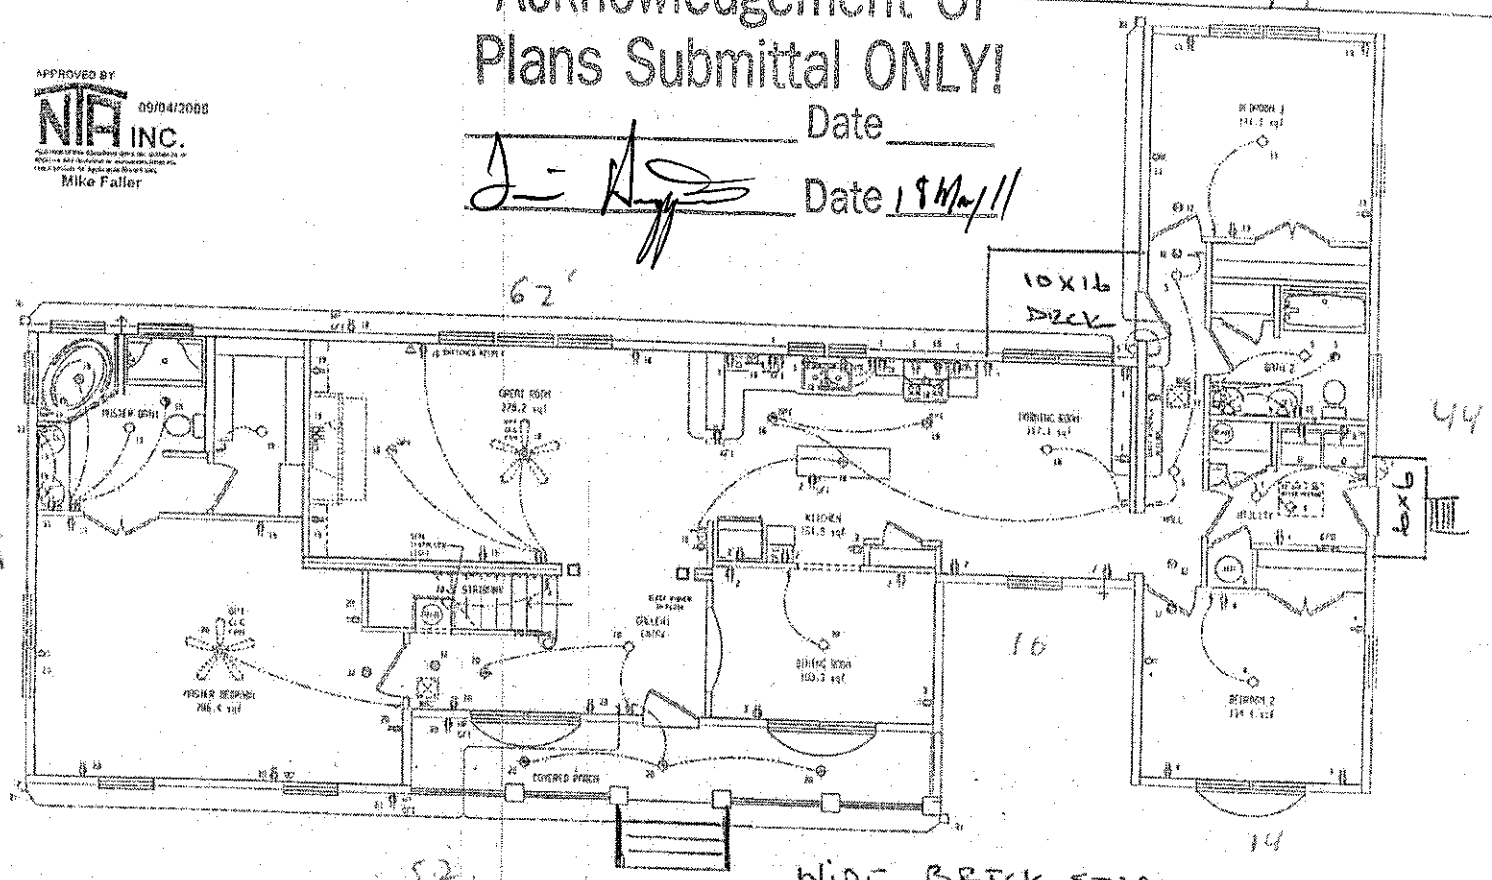

WIDE BRICK STEPS
VINYL RAILS TO MATCH FACTORY

NOTE: ON RECEPTACLES RATED 15 & 20 AMP CIRCUITS FEEDING ELECTRICAL OUTLETS IN BEDROOMS MUST BE PROTECTED BY AN ARC-FAULT INTERRUPTER IN ACCORDANCE WITH SECTION 210.12 OF THE NEC.

ELECTRICAL SCHEDULE

NO.	DESCRIPTION	AMPS	VOLTS	TYPE
1	PORTABLE APPLIANCES	20	120	15
2	PORTABLE APPLIANCES	20	120	15
3	PORTABLE APPLIANCES	20	120	15
4	GEN. LIGHTING & RECPT.	15	120	15
5	GEN. LIGHTING & RECPT.	15	120	15
6	ELECT. WATER HEATER (CIRCUITED WITH)	30	240	30
7	UNUSED SPACE	20	120	15
8	WATER HEATER	30	240	30
9	DRYER	30	240	30
10	RANGE	50	240	50
11	CENTRAL AIR CONDITIONER	30	240	30
12	ELECT. RANGE OVEN	40	240	40
13	GAS FURNACE	15	120	15
14	SPA	50	240	50
15	SPA	50	240	50
16	SPA CONTROL BOX	15	120	15
17	SPA	50	240	50
18	SPA	50	240	50
19	SPA	50	240	50
20	SPA	50	240	50
21	SPA	50	240	50
22	SPA	50	240	50
23	SPA	50	240	50
24	SPA	50	240	50
25	SPA	50	240	50
26	SPA	50	240	50
27	SPA	50	240	50
28	SPA	50	240	50
29	SPA	50	240	50
30	SPA	50	240	50
31	SPA	50	240	50
32	SPA	50	240	50
33	SPA	50	240	50
34	SPA	50	240	50
35	SPA	50	240	50
36	SPA	50	240	50
37	SPA	50	240	50
38	SPA	50	240	50
39	SPA	50	240	50
40	SPA	50	240	50
41	SPA	50	240	50
42	SPA	50	240	50
43	SPA	50	240	50
44	SPA	50	240	50
45	SPA	50	240	50
46	SPA	50	240	50
47	SPA	50	240	50
48	SPA	50	240	50
49	SPA	50	240	50
50	SPA	50	240	50
51	SPA	50	240	50
52	SPA	50	240	50
53	SPA	50	240	50
54	SPA	50	240	50
55	SPA	50	240	50
56	SPA	50	240	50
57	SPA	50	240	50
58	SPA	50	240	50
59	SPA	50	240	50
60	SPA	50	240	50
61	SPA	50	240	50
62	SPA	50	240	50
63	SPA	50	240	50
64	SPA	50	240	50
65	SPA	50	240	50
66	SPA	50	240	50
67	SPA	50	240	50
68	SPA	50	240	50
69	SPA	50	240	50
70	SPA	50	240	50
71	SPA	50	240	50
72	SPA	50	240	50
73	SPA	50	240	50
74	SPA	50	240	50
75	SPA	50	240	50
76	SPA	50	240	50
77	SPA	50	240	50
78	SPA	50	240	50
79	SPA	50	240	50
80	SPA	50	240	50
81	SPA	50	240	50
82	SPA	50	240	50
83	SPA	50	240	50
84	SPA	50	240	50
85	SPA	50	240	50
86	SPA	50	240	50
87	SPA	50	240	50
88	SPA	50	240	50
89	SPA	50	240	50
90	SPA	50	240	50
91	SPA	50	240	50
92	SPA	50	240	50
93	SPA	50	240	50
94	SPA	50	240	50
95	SPA	50	240	50
96	SPA	50	240	50
97	SPA	50	240	50
98	SPA	50	240	50
99	SPA	50	240	50
100	SPA	50	240	50

BUILD	CHATEAU ELAN
SERIES	CE42
	CIRCLE

REVISIONS	BY	DATE
ARRIVE HRV CEILINGS AND SMOKE DETECTORS	BLR	12/15/05

GENERAL NOTES
LOCK-OUT BREAKER ON CIRCUIT #6

DRAWING TITLE
ELECTRICAL PLAN

PLAN	DESCRIPTION	SQ. FT.
958	42X62' 3BR-2BA	2896
DRAWN BY	DRAW. DATE	BRICK NO.
RMH	05/23/2004	2006
	09/04/2008	SHEET NO.
		11-1