
PUMP TANK DESIGN

ATTACHMENT TO PROPERTY DESCRIPTION # _____

TAX MAP # 4704-58-1923

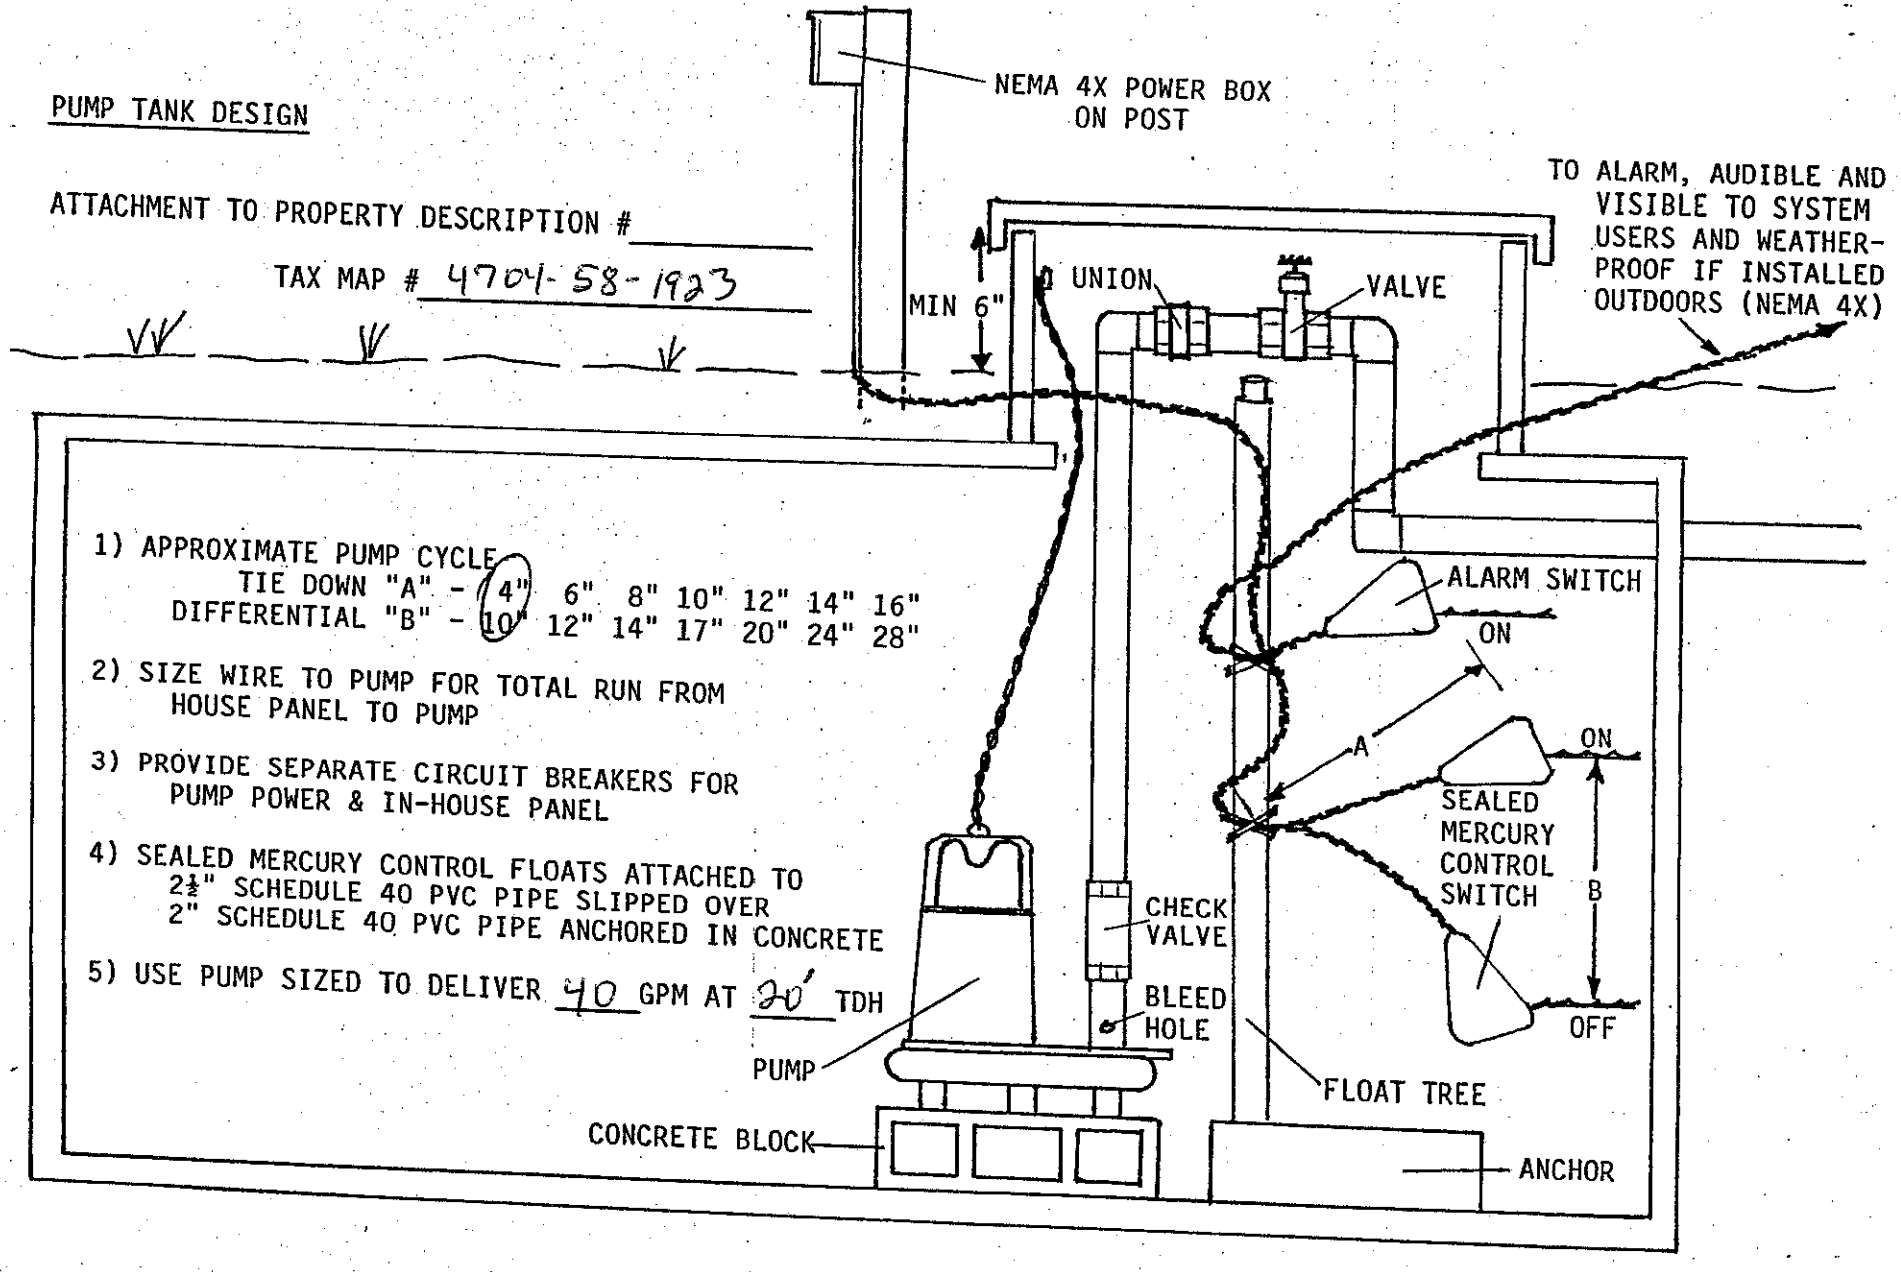

1) APPROXIMATE PUMP CYCLE
   TIE DOWN "A" - (4") 6" 8" 10" 12" 14" 16"
   DIFFERENTIAL "B" - (10") 12" 14" 17" 20" 24" 28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP


3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO
   2½" SCHEDULE 40 PVC PIPE SLIPPED OVER
   2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

5) USE PUMP SIZED TO DELIVER 40 GPM AT 20' TDH

ATTACHMENT TO P.D.# _____

TAX MAP # 41704-58-A23

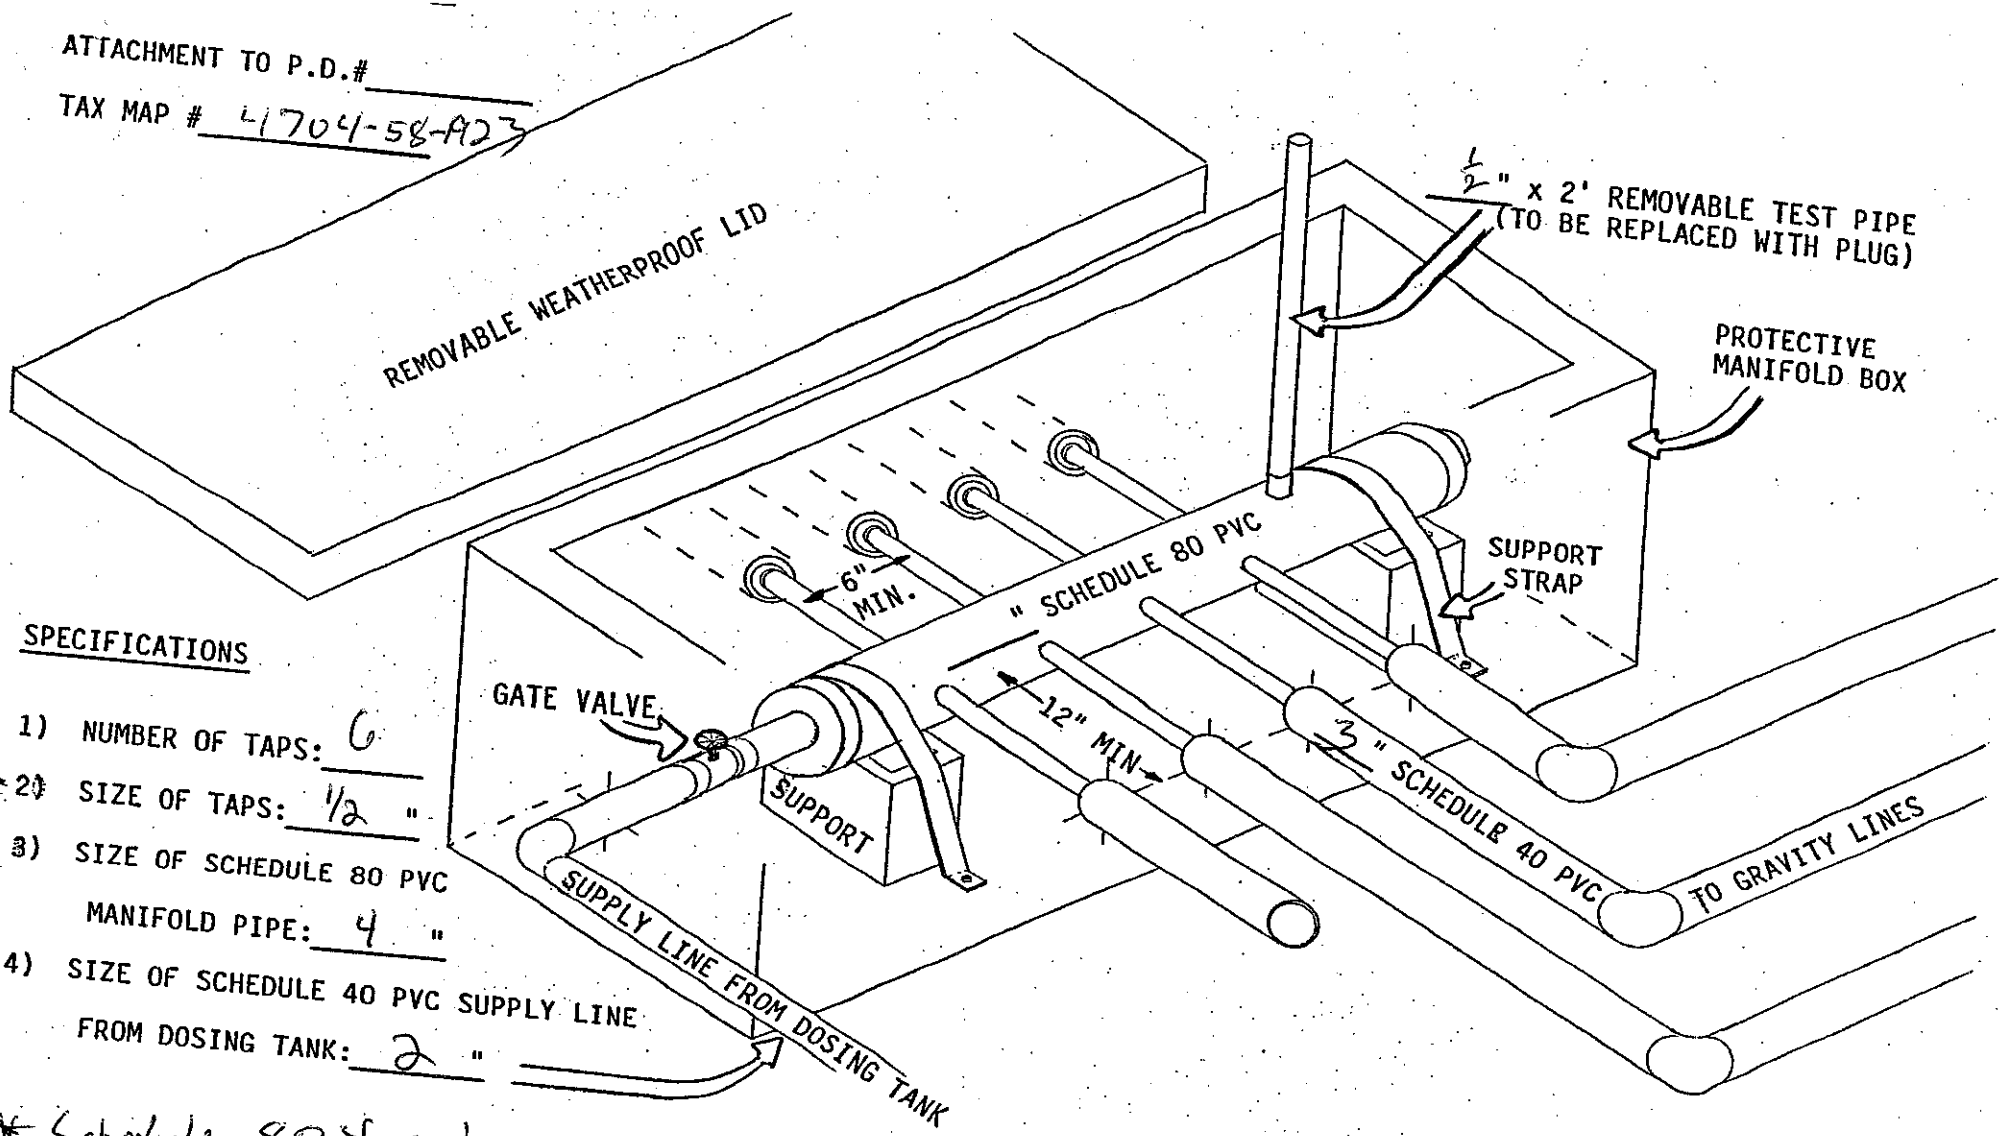

SPECIFICATIONS

1) NUMBER OF TAPS: 6

*2) SIZE OF TAPS: 1/2 "

3) SIZE OF SCHEDULE 80 PVC MANIFOLD PIPE: 4 "

4) SIZE OF SCHEDULE 40 PVC SUPPLY LINE FROM DOSING TANK: 2 "

* Schedule 80 Taps!