BLDG - 2022-6558

ICHD - ENVIRONMENTAL HEALTH DIVISION

Statesville Office (704) 878-5305 Mooresville Office (704) 660-3625 PERMIT # OSWP-2023-13390

SEPTIC: IMPROVEMENT PERMIT / AUTHORIZATION TO CONSTRUCT / OPERATION PERMIT / EXISTING SYSTEM

PIN # 4704 -- 81 -- 2090

APPLICANT/OWNER: KEITH SLAUGHTER APPLICANT ADDRESS: 129 BEULAH ROAD, STATESVILLE, N.C. 28677

SITE ADDRESS: 120 BEULAH ROAD, STATESVILLE, N.C. 28677 PHONE: 704-902-3875 ALT. PHONE —


SITE DIRECTIONS: (W) ON 40, (L) ON OLD MOUNTAIN, (R) ON BEULAH, LOT ON (R) SAP CONTROLLED: ☐ YES ☑ NO

SUBDIVISION: KEITH SLAUGHTER SECTION: — LOT # — LOT AREA: 1.87 AC DESIGN FLOW: 200 GPD L.T.A.R.: 0.3 (REPAIR 0.25)

Septic Tank	1000	(gal)	STB 1012	Date 4-9-2024	☑ New System	☐ Repair	☐ Expansion	System Type: I II (III) IV V VI	☐ Residence	No. Bedrooms —	Water Supply
Pump Tank	—	(gal)	PT —	Date —	System Description: 50% REDUCTION - VERTICAL PP BPS				☑ Business	No. Persons —	☐ Private
Pump Make	—	Model	—	Serial # —	Repair System Description: 50% REDUCTION				☐ Other	No. Employees 8	☑ Public
# Nitrification Fields	1	# Lines	2	Linear Ft 116 FT	Maintenance Agreement Required:	☐ YES	☑ NO		☑ Slab	☐ Crawl Space	☐ Community
Trench Width	24 IN	Trench Bottom Depth(Low side)	52 IN	Gravel Depth —		☑ GRAVITY	☐ PRESSURE		☐ Basement w/plumbing		☐ Basement w/o plumbing

Comments / Conditions: INSTALL ON CONTOUR, INSTALL ON 8FT CENTERS, UTILIZE D-BOX TO ACHIEVE EQUAL DISTRIBUTION. DO NOT EXCEED A 60 IN MAX TRENCH DEPTH

INITIAL SITE SKETCH

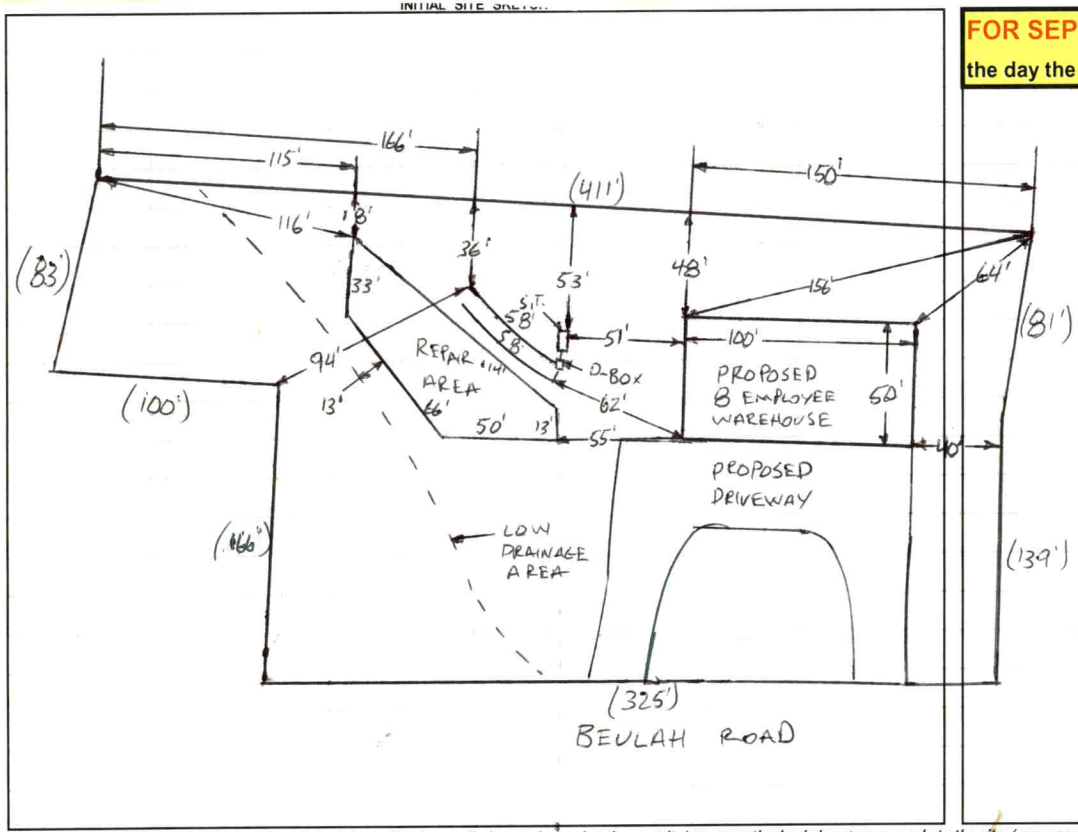

AS BUILT SKETCH

FOR SEPTIC FINAL INSPECTION CALL: 704-664-3703 between 8am-9am the day the inspection is needed. Be sure to speak with an inspector to confirm your time.

1 IN = 80 FT

S.T. = SEPTIC TANK

Tanks - BW 8/26

Installed as Shown

Permit can be suspended or revoked if any false information is supplied toward securing the permit / any unauthorized changes are made to the site / any unauthorized changes are made in the installation of the system. **CONTACT A LOCATOR SERVICE PRIOR TO ANY EXCAVATION**

☐ **IMPROVEMENT PERMIT** *with plat valid without expiration.* ☑ **IMPROVEMENT PERMIT** *with site plan valid for 60 mos.* ☑ **AUTHORIZATION TO CONSTRUCT** *valid for period equal to IMPROVEMENT PERMIT--not to exceed 60 mo.*

Owner / Applicant Signature: ONLINE SIGNATURE Date: — Installed by: Piedmont Backhoe

IMPROVEMENT PERMIT by: Burnett C. Whitley Date: 8-26-2024 OPERATION PERMIT by: Sydney Holland Date: 9/4/24

AUTHORIZATION TO CONSTRUCT by: Burnett C. Whitley Date: 8-26-2024 Existing System Inspected by: Date:

FOR SEPTIC FINAL INSPECTION: CALL 704-664-3703 between 8am-9am the day the inspection is needed.

Item	Date	Initials
Drain Lines Checked		
Tanks Checked		
Pressure Manifold or Valve Box Checked		
Pressure Head Set		
Electrical Checked		
Floats Set		
Alarm Checked		
Maintenance Contract Needed? Y / N		
Comments:		

Repairs Only	
	State Code
Failing System Code	
Type of Distribution	G or P
Type of Failure/Malfunction	
Primary Cause of Failure/Malfunction	
Age of System? _____	
Initial or Repair? _____	

SOIL/SITE EVALUATION

(Continuation Sheet-Complete all field in full)

DEPARTMENT OF HEALTH AND HUMAN SERVICES
DIVISION OF PUBLIC HEALTH
ENVIRONMENTAL HEALTH SECTION
ON-SITE WATER PROTECTION BRANCH

PROPERTY ID #: 4704-81-2090
DATE OF EVALUATION: 8-22-2024
COUNTY: IREDELL

120 BEULAH ROAD, STATESVILLE, N.C. 28677

PROFILE #	.0502 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY .0503 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY .0503 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .0504 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .0506 SOIL DEPTH	OTHER PROFILE FACTORS .0507 SAPRO CLASS	OTHER PROFILE FACTORS .0508 RESTR HORIZ	.0509 PROFILE CLASS & LTAR*	.0503 SLOPE CORRECTION
1	TANK HOLE GRADED 2%	0-40	C, ABK	FI, S, P, SEXP	Y/B MOTS 2.5Y 7/6 8"-26" SAP INC COMMON R/B MATRIX	70"	PS II SL	NA		
		40-70	CL, WSBK	FR, SS, SP, SEXP					PS	1"
		70-88	SAP. AMAS	FR, NS, NP, SEXP					-3	
2	GRADED LINEAR SIDE 3%	0-48	C, ABK	FI, SIP, SEXP	Y/B MOTS 2.5Y 7/6 10"-24" SAP INC COMMON R/B MATRIX	78"+	NA	NA	PS	
		48-78	CL, WABK	FR, SS, SP, SEXP					-3	1"

COMMENTS:

PERMIT SNAPSHOT REPORT OSWP-2024-60337 FOR IREDELL COUNTY

Permit Type	Environmental Health OSWP	**Project:**		**App Date:**	08/22/2024
Work Class:	EH Septic Permit	**District:**	Iredell County	**Exp Date:**	NOT AVAILABLE
Status:	Need to Draw	**Square Feet:**	0.00	**Completed:**	NOT COMPLETED
Valuation:	$0.00	**Assigned To:**	White, Bryant	**Approval Expire Date:**	
Description:	Comprehensive Redraw (PLEASE ASSIGN TO BRYANT - BRYANT DID SITE VISIT)				

Parcel: 4704812090.000 Main	**Address:** 120 Beulah Rd Statesville, NC 28677 Main	**Zone:** HB(Highway Business District)

Property Owner	Applicant/Authorized Agent
Keith Slaughter	Keith Slaughter
129 Beulah Rd	129 Beulah Rd
Statesville, NC 28677	Statesville, NC 28677
Business: (704) 902-3875	Business: (704) 902-3875
Mobile: (704) 902-3875	Mobile: (704) 902-3875

Permit Custom Fields

How is your site plan being submitted	Custom Site Plan	Septic Application/Permit Type	Re-Layout/change septic permit (sys not installed)	Does the site contain any jurisdictional wetlands	No
Non-domestic Sewage Generated	No	Other Public Agency	No	All proposed structure dimensions	50x100
What are the proposed structures	Other Addition/Structure	Maximum Number of Bedrooms	0	If other Addition/Structure, please explain	50x100 commercial metal building-flooring warehouse
Number of Occupants	10	Foundation Type	Concrete Slab Foundation	Residential/Business/Other	Commercial
Number of Employees	2	Water Supply	Municipal Water	Desired Septic System Type	Conventional (most common)
If other septic system type, please explain		Pump Make		# of Nitrification Fields	
Model		Serial #		System Description	
Repair System Description		Comments/Conditions		Permit type(s)	Authorization to Construct
Additional Unique Setbacks Apply	No				

Attachment File Name	Added On	Added By	Attachment Group	Notes
Signature_Keith_Slaughter_8/22/2024.jpg	08/22/2024 8:57	Slaughter, Keith		Uploaded via CSS
septic010824STVEHSCANNER_v1.pdf	08/22/2024 10:15	Slaughter, Keith	Available Online	
20240822_125710_v2.jpg	08/22/2024 14:16	Slaughter, Keith	Available Online	
IntenttoRevoke120BeulahRoad18E.docx	08/22/2024 16:53	White, Bryant	Available Online	Intent To Revoke
20240822_181602.pdf	08/26/2024 15:03	White, Bryant	Available Online	Signed VR Form

Invoice No.	Fee	Fee Amount	Amount Paid
INV-00035084	Comprehensive Gravity System Re-layout	$500.00	$500.00
	Total for Invoice INV-00035084	$500.00	$500.00
	Grand Total for Permit	**$500.00**	**$500.00**

Workflow Step / Action Name	Action Type	Start Date	End Date
Application Completeness Check v.1		08/22/2024 14:13	08/22/2024 14:16
Confirm application complete v.1	Generic Action		08/22/2024 14:16
~~**Zoning Review v.1**~~			08/22/2024 14:15