
Dr Robert Brown
PIN # 4705-81-8109

Attachment "A"

PUMP TANK DESIGN

ATTACHMENT TO ~~PROPERTY DESCRIPTION~~ Permit # 119107

TAX MAP # _____

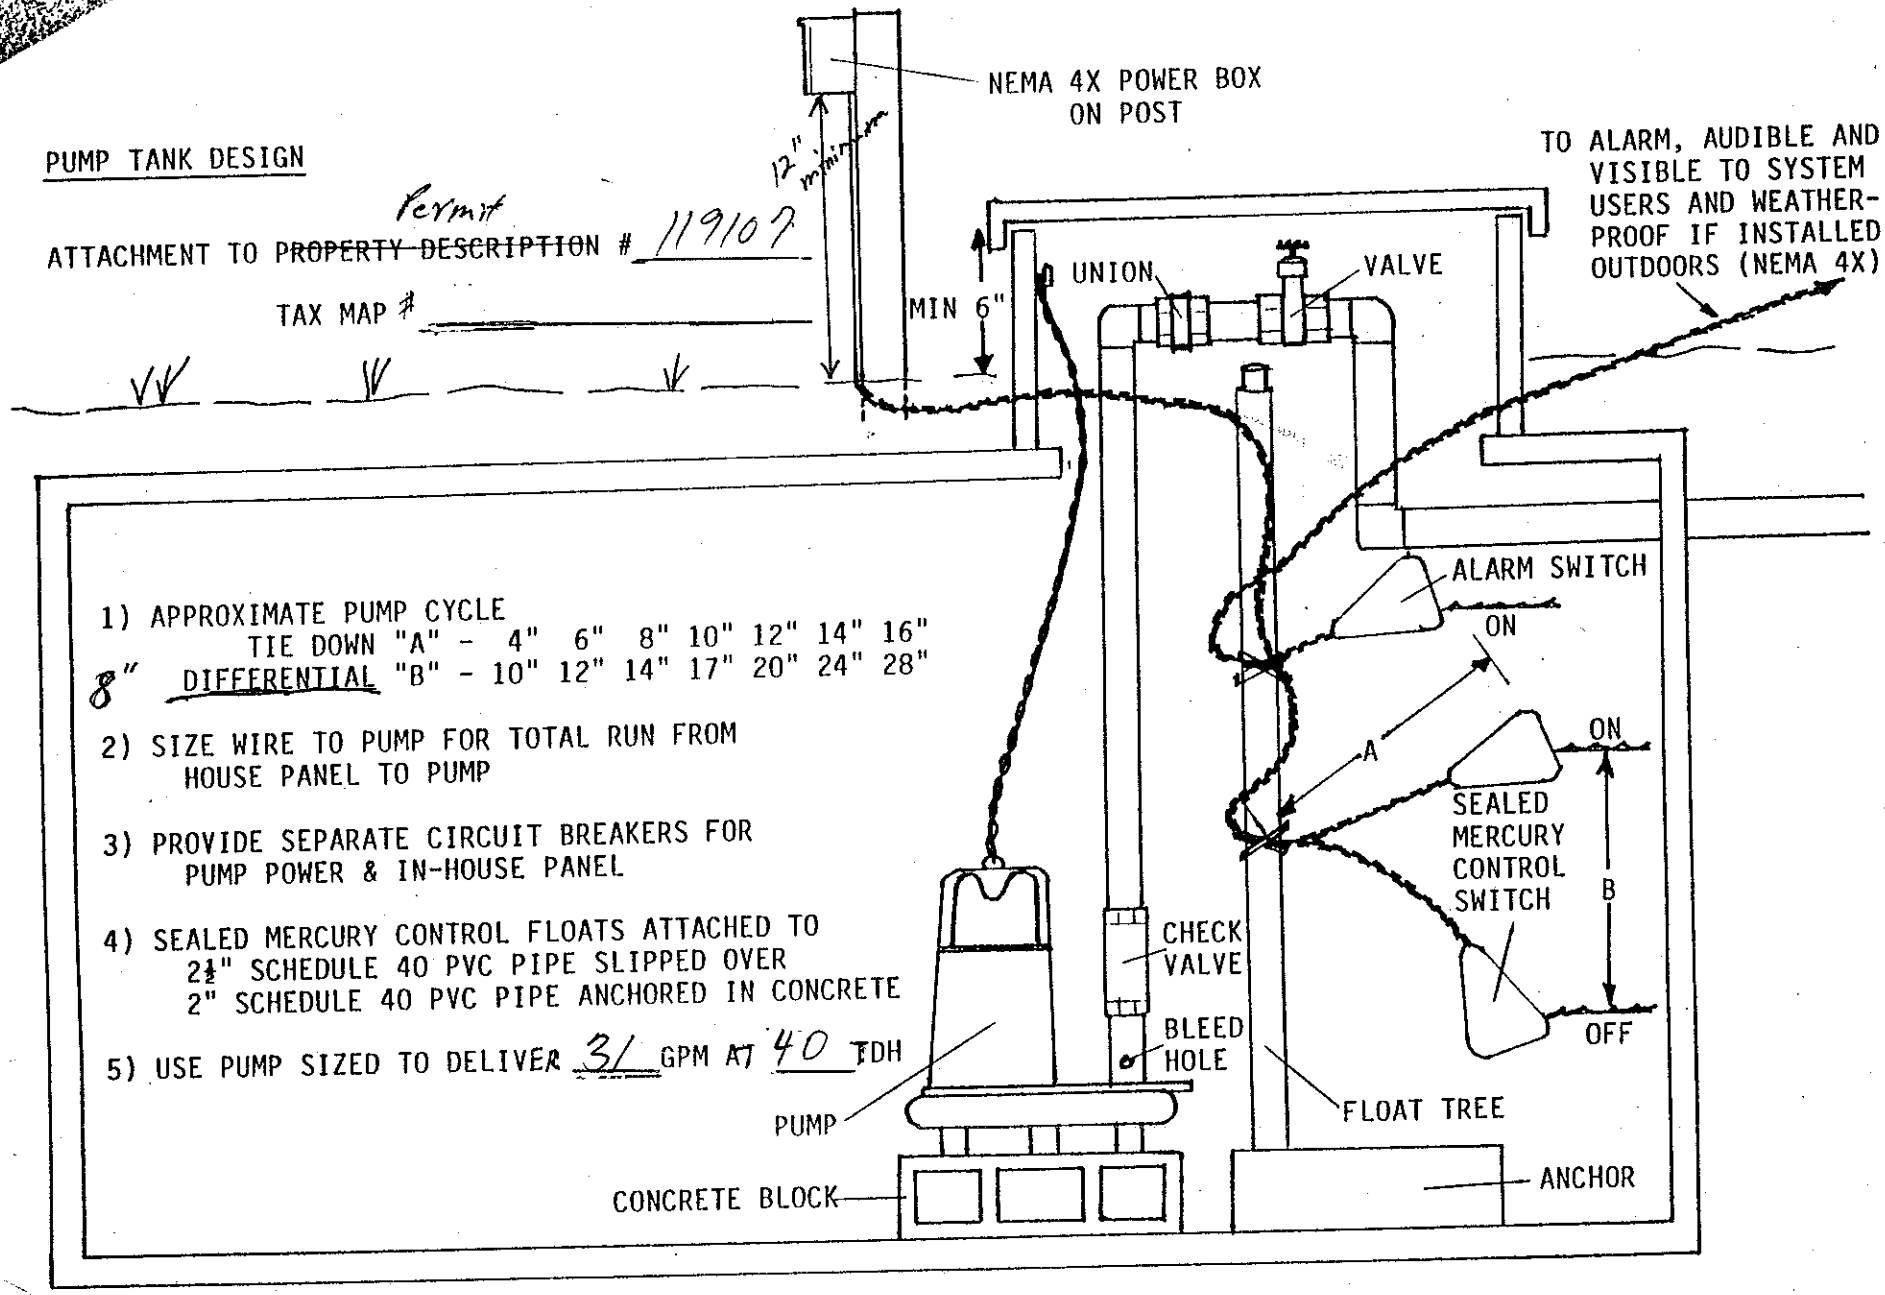

1) APPROXIMATE PUMP CYCLE
   TIE DOWN "A" - 4" 6" 8" 10" 12" 14" 16"
   8" DIFFERENTIAL "B" - 10" 12" 14" 17" 20" 24" 28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

5) USE PUMP SIZED TO DELIVER 3/ GPM AT 40 TDH

Dr. Robert Brown


Rm # 4705-81-8169

Attachment "B"

PRESSURE MANIFOLD DESIGN

ATTACHMENT TO ~~P.O.~~ Permit #119107

TAX MAP #_____

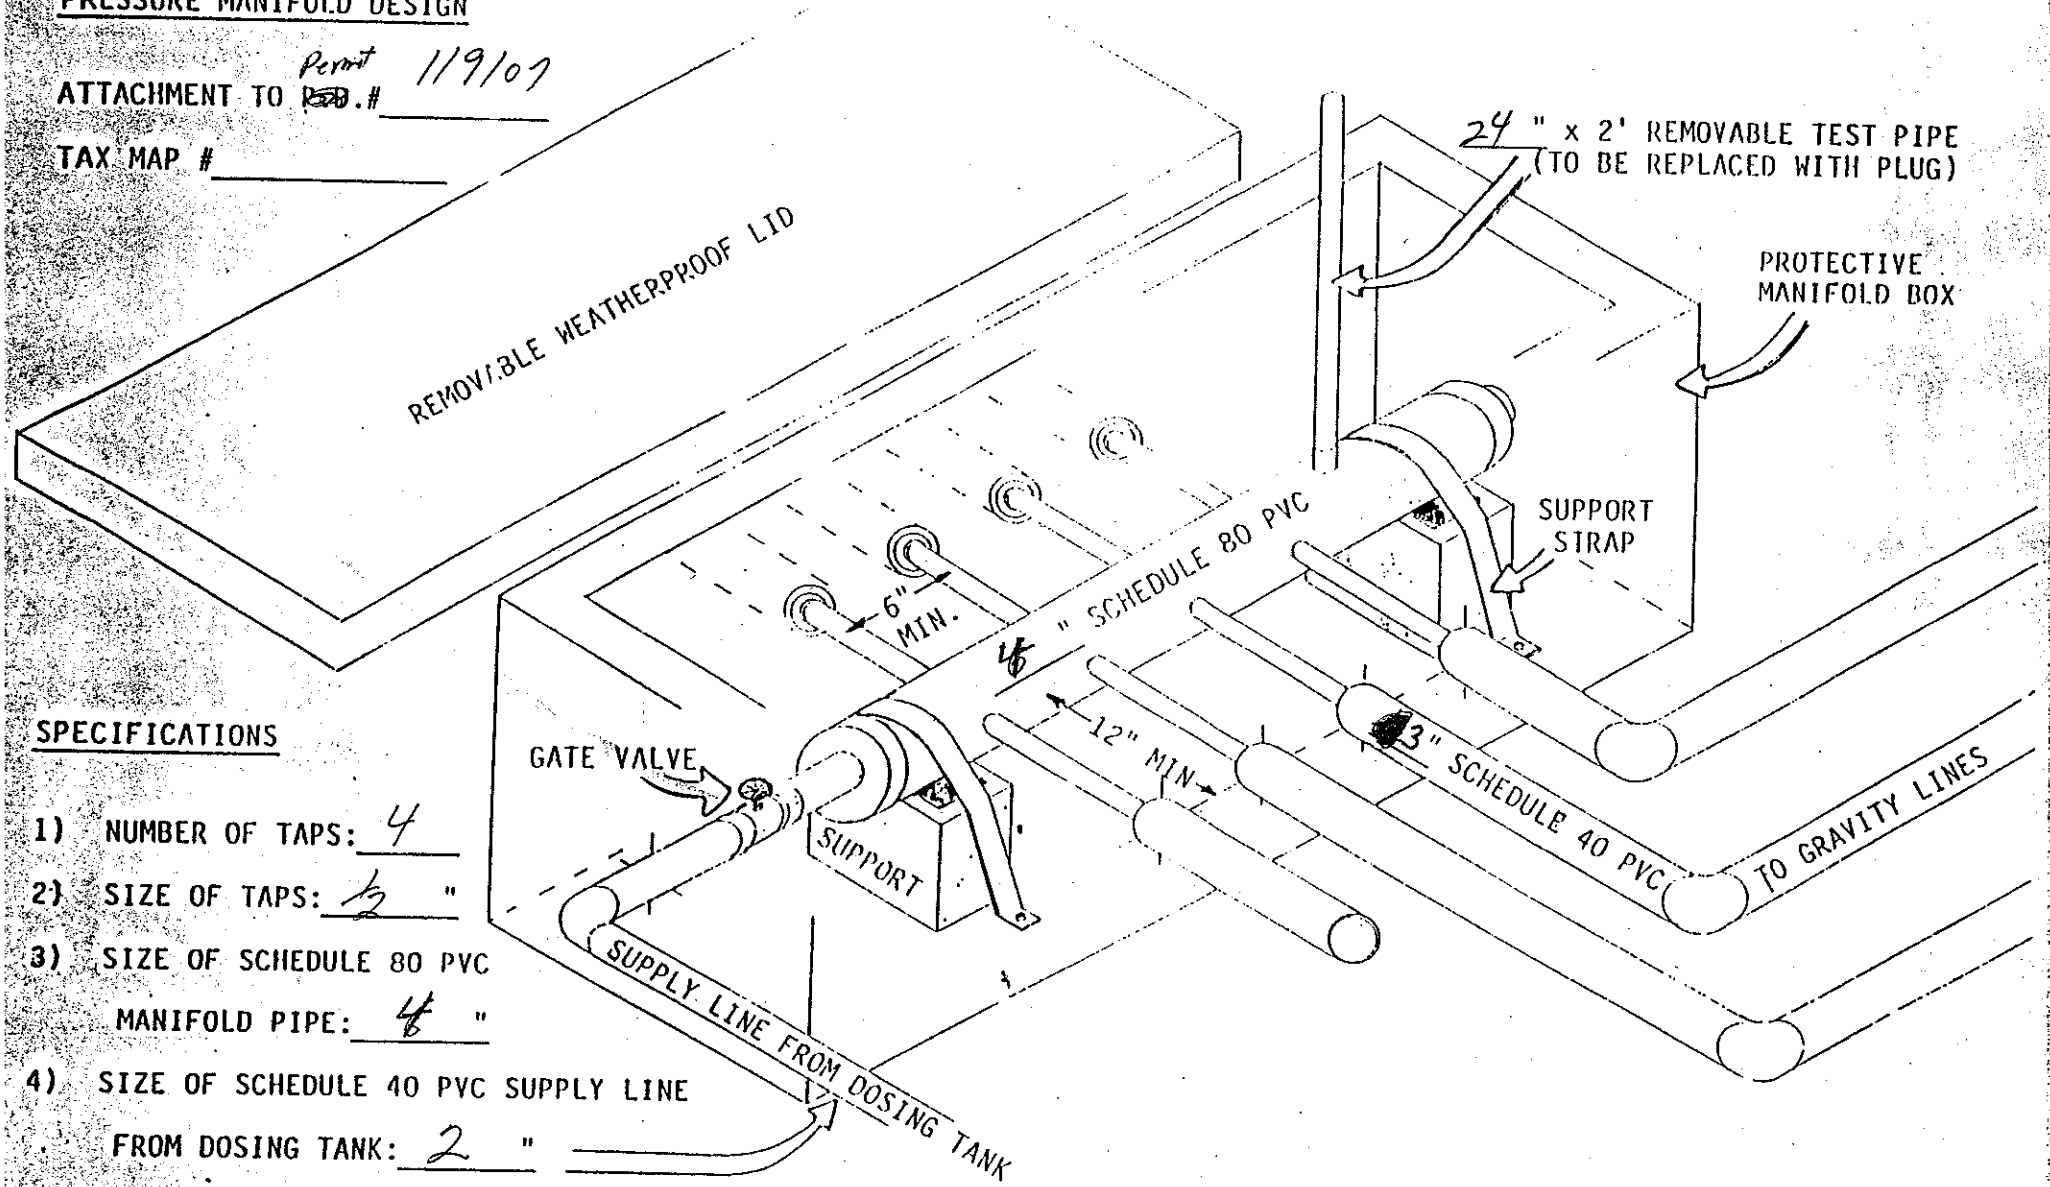

SPECIFICATIONS

1) NUMBER OF TAPS: 4

2) SIZE OF TAPS: ½ "

3) SIZE OF SCHEDULE 80 PVC MANIFOLD PIPE: 4 "

4) SIZE OF SCHEDULE 40 PVC SUPPLY LINE FROM DOSING TANK: 2 "