
Attachment "B"

PUMP TANK DESIGN

Permit # 111221

ATTACHMENT TO ~~PROPERTY DESCRIPTION~~ # _____

TAX MAP # 406-33-336.16

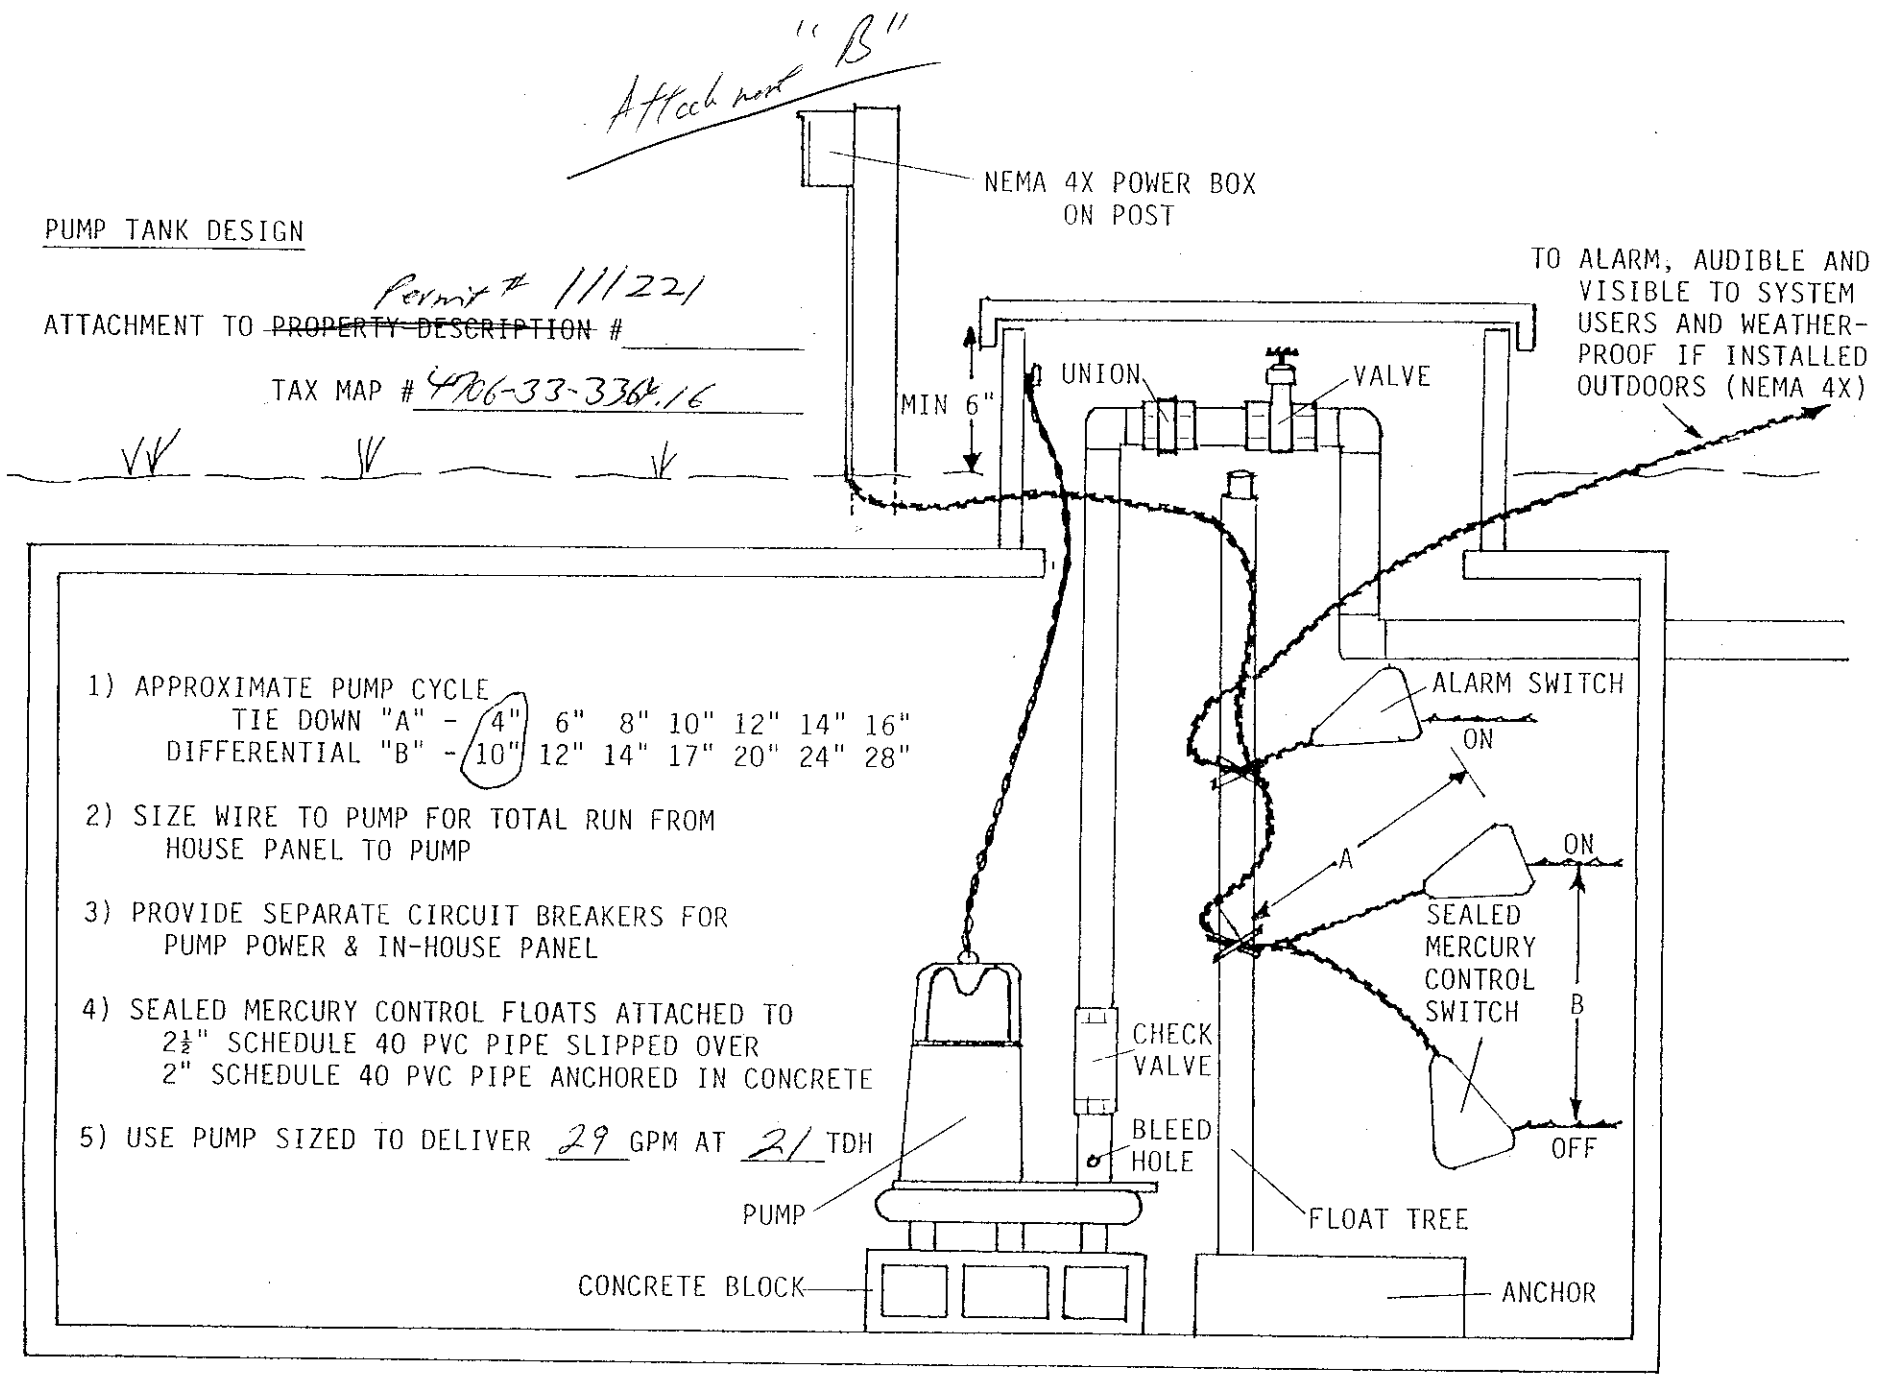


1) APPROXIMATE PUMP CYCLE
TIE DOWN "A" - (4") 6" 8" 10" 12" 14" 16"
DIFFERENTIAL "B" - (10") 12" 14" 17" 20" 24" 28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO
2½" SCHEDULE 40 PVC PIPE SLIPPED OVER
2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE


5) USE PUMP SIZED TO DELIVER 29 GPM AT 21 TDH

Attachment "A"

PRESSURE MANIFOLD DESIGN

ATTACHMENT TO ~~P.D.#~~ Permit 111221

TAX MAP # 4706-33-3364/16

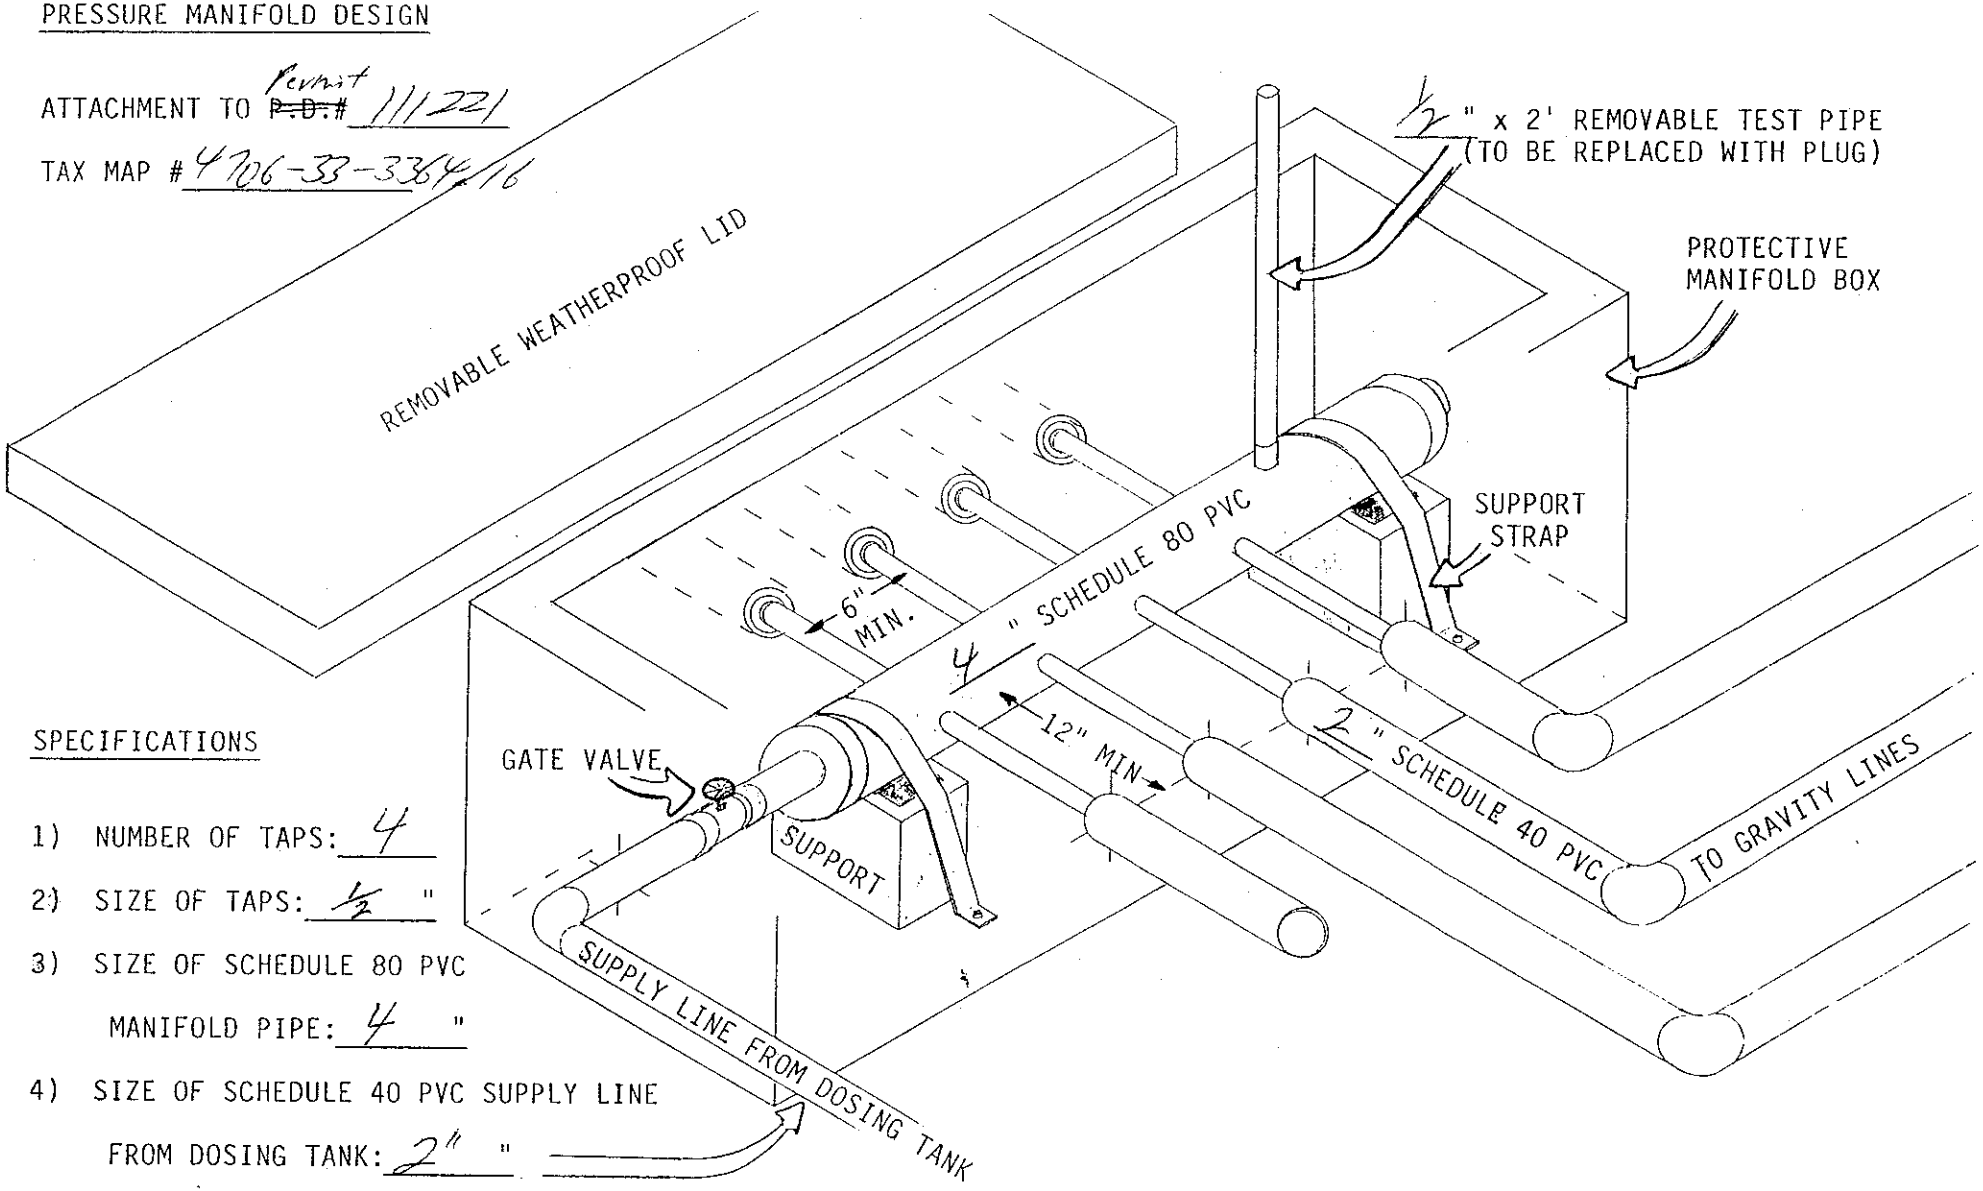


SPECIFICATIONS

1) NUMBER OF TAPS: 4
2) SIZE OF TAPS: ½ "
3) SIZE OF SCHEDULE 80 PVC MANIFOLD PIPE: 4 "
4) SIZE OF SCHEDULE 40 PVC SUPPLY LINE FROM DOSING TANK: 2" "