2:00 * Repair

IREDELL COUNTY HEALTH DEPARTMENT

STATESVILLE 704-878-5305 MOORESVILLE 704-664-5281

IMPROVEMENT PERMIT / AUTHORIZATION TO CONSTRUCT / OPERATION PERMIT / EXISTING SYSTEM INSPECTION

PERMIT# Repair PIN# 4706 70-8519 DATE 22 March 07

OWNER OR APPLICANT William Moody PHONE: Business 843-693-0548 Home

ADDRESS 4290 Taylorsville Hwy Statesville, N.C.

LOCATION Hwy 90 west - 3rd drive on Rt. past Lippard Farm Rd.

SUBDIVISION BLOCK / SECTION LOT LOT AREA SITE CLASS. PS DESIGN FLOW 240 gpd L.T.A.R. 0.35, 1ft²/d

Septic Tank: Existing Gallons: STB Date

Pump Tank: Gallons: PT Date

Pump Make: Model Serial No.

Nitrification Field: No Fields 1 Square Feet 960 Linear Feet 240'

No Lines 2 Trench Width 36" Max Trench Bottom Depth 36" Gravel Depth

☐ New System ☑ Repair ☐ Expansion System Type: I II III IV V VI

System Description: 2570 Reduction

Repair System Description:

Maintenance Agreement Required: ☐ Yes ☑ No

☑ House/Mod. Home No. Bedrooms

☐ Mobile Home No. Persons

☐ Business No. Employees

☐ Other

Water Supply: ☑ Individual ☐ Public ☐ Community

☑ Gravity ☐ Pressure ☐ Slab ☐ Crawl Space ☑ Basement w/plumbing ☐ Basement wo/plumbing

Comments:/Conditions: Plumb washing machine into septic tanks / * Easement attached. / Replace D-Box if necessary and use speed-levelers

INITIAL SITE SKETCH

Comments:/Conditions: New tee in Exist. Tank 32 Rock 4 each trench. Installed as Drawn on site Plan * washing machine plumbed into septic Tank

AS BUILT SKETCH

Permit can be suspended or revoked if any false information is supplied toward securing the permit/any unauthorized changes are made to the site/any unauthorized changes are made in the installation of the system. Improvement Permit with plat valid without expiration ☐ Improvement Permit with site plan valid for sixty months ☐ Authorization to Construct is valid for a period equal to that of Improvement Permit – not to exceed sixty months.

* Signed: William P. Moody date 4-11-07

Improvement Permit by: date

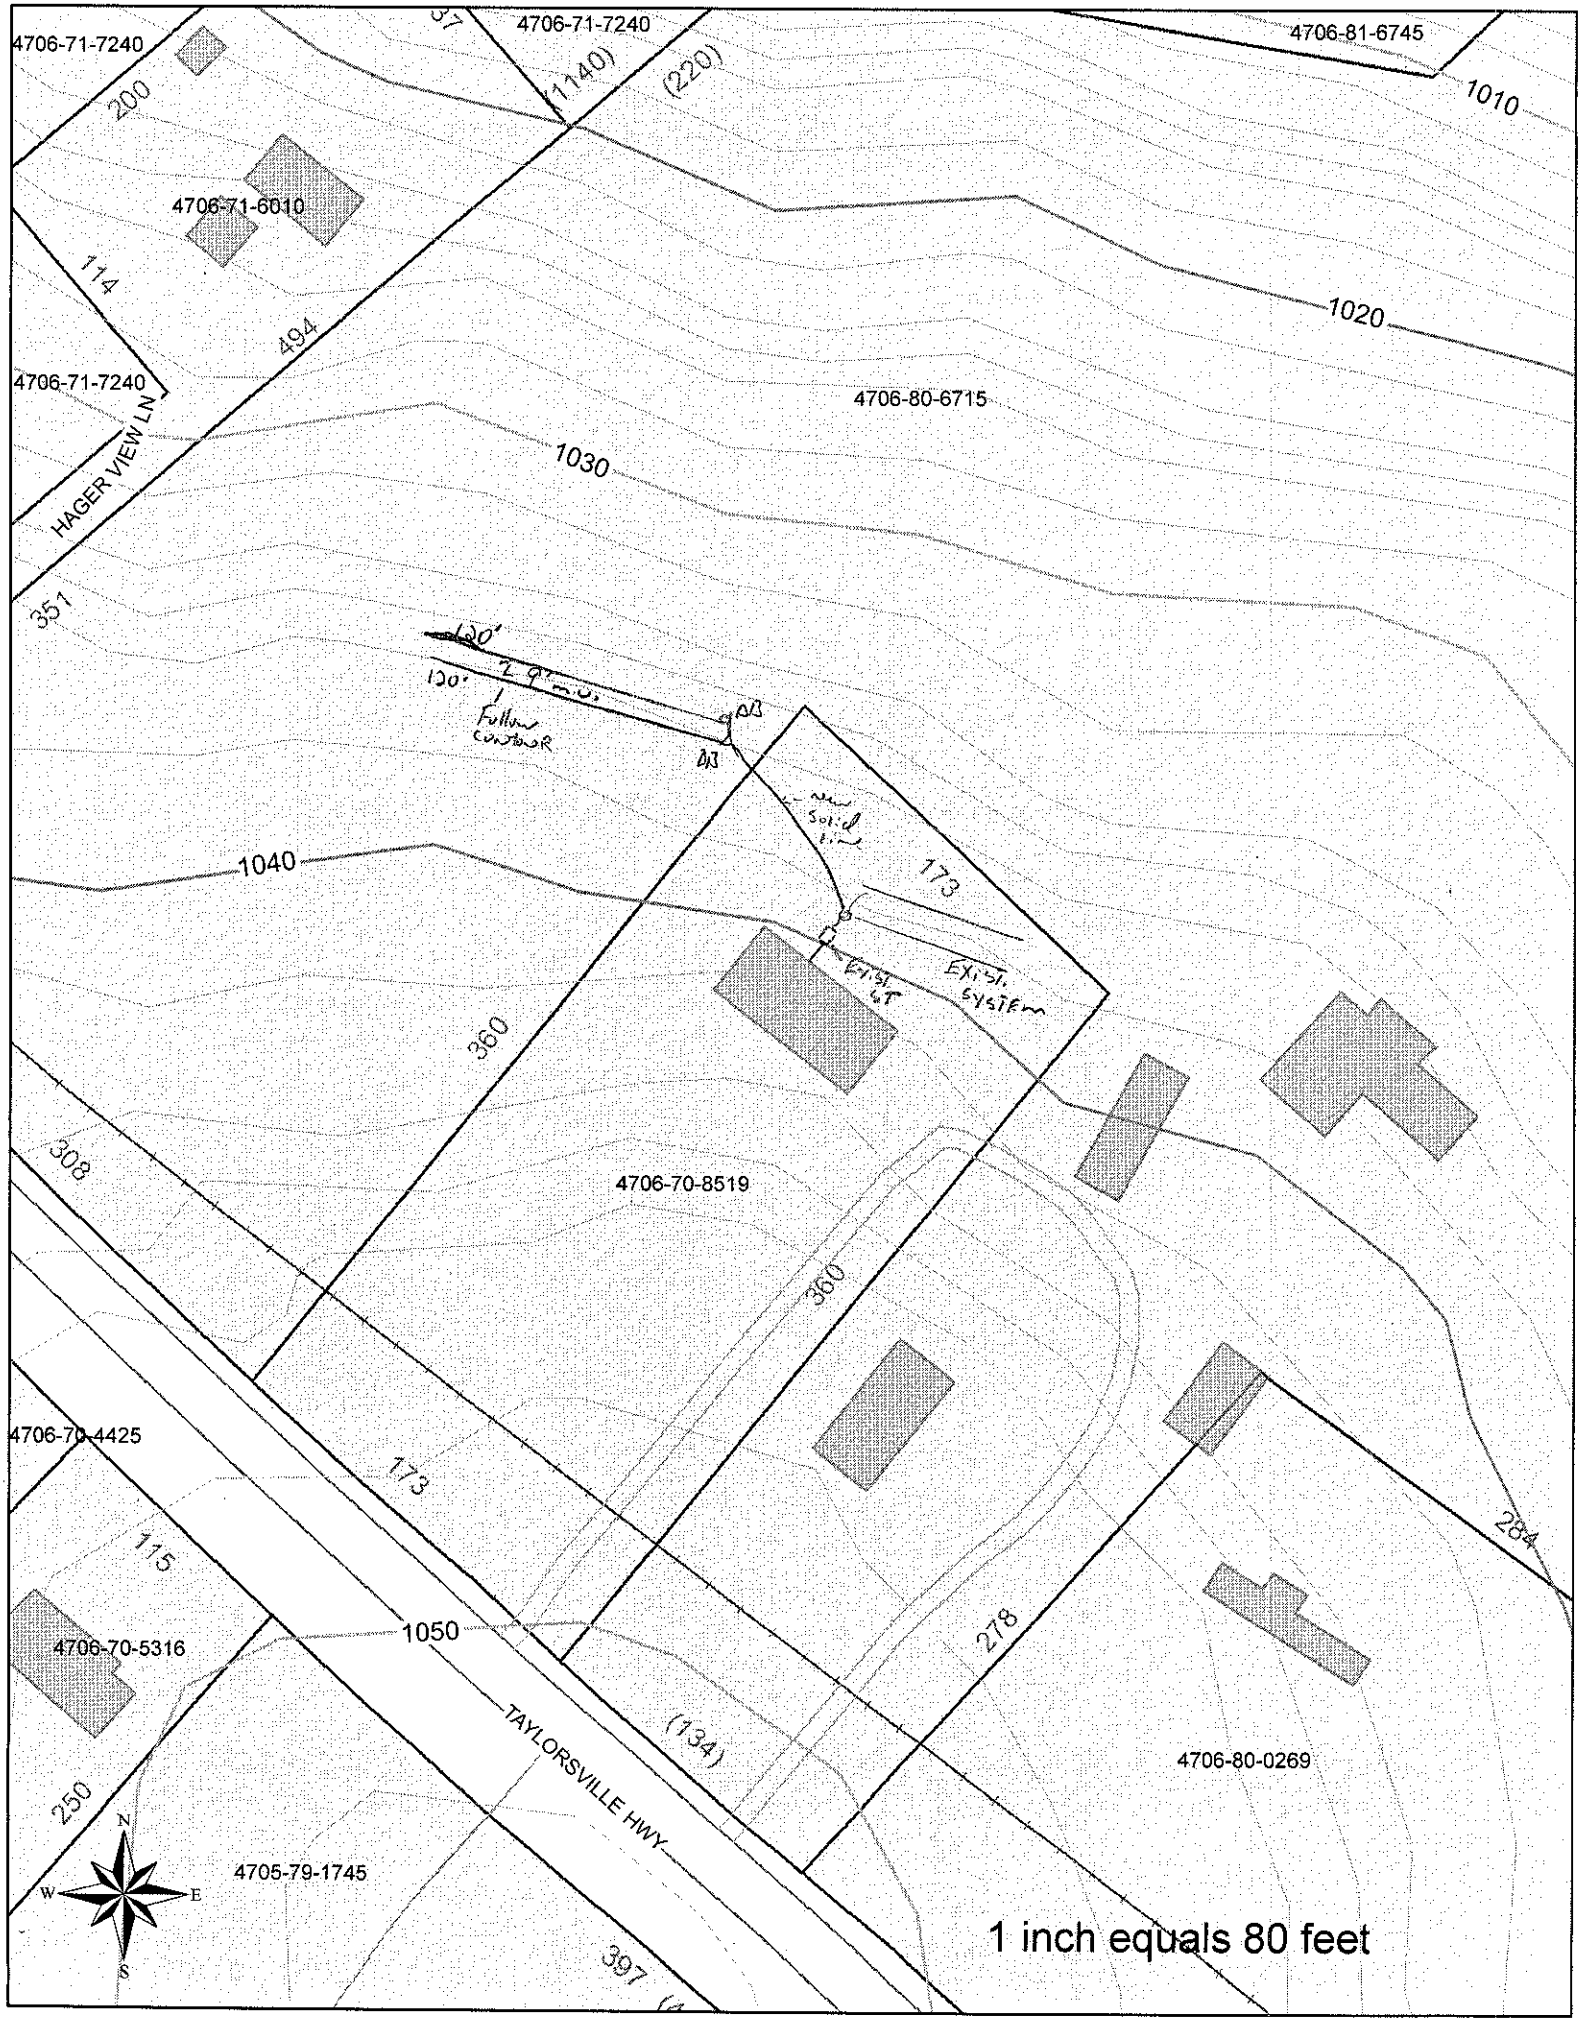
Authorization to Construct by: Jim Wyatt, R.S. date 29 March 07

Installed by: Wes Litton

Operation Permit by: Jim Wyatt, R.S. date 2 May 07

Existing System Inspection by: date

HEALTH DEPT. COPY: WHITE OWNER COPY (FINAL): YELLOW OWNER COPY (INITIAL): PINK


4706-71-7240
4706-71-7240
4706-81-6745
200
(1140)
(220)
1010
4706-71-6010
114
494
1020
4706-71-7240
4706-80-6715
HAGER VIEW LN
1030
351
120'
120'
Fullen Contour
New Septic Line
1040
173
Exist. Tank
Exist. System
360
308
4706-70-8519
360
4706-70-4425
173
115
284
1050
4706-70-5316
278
TAYLORSVILLE HWY
(134)
4706-80-0269
250
4705-79-1745
397
N
W
E
S
1 inch equals 80 feet