1674.

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR JAMES BECKHAM DATE 6-28-90 PERMIT NO. 4D-A-14.

PHONE: Business _____ Home _____

LOCATION Hwy 115N - T.L. on Pisgah Church Rd. - 4 miles on ⓡ. S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House ( ) Mobile Home (✓) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes ( ) No (✓)

Auto. Wash. Machine Yes (✓) No ( )

Site Suitable Yes (✓) No ( )

Character & Porosity of Soil Loam Suitable.

Percolation Rate 2-4 Min/Ft

Topography 2-3%

Depth to Water Table 72+

Rock or other impervious formations None observed.

Lot Area Acreage

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

Size of Tank 1000 Gals.


Nitrification Field:

No. of Lines 3

Sq. Ft. 180 Linear Ft. 300

Depth of Stone in Lines 12"

Water Supply: Individual (✓)
Public ( )

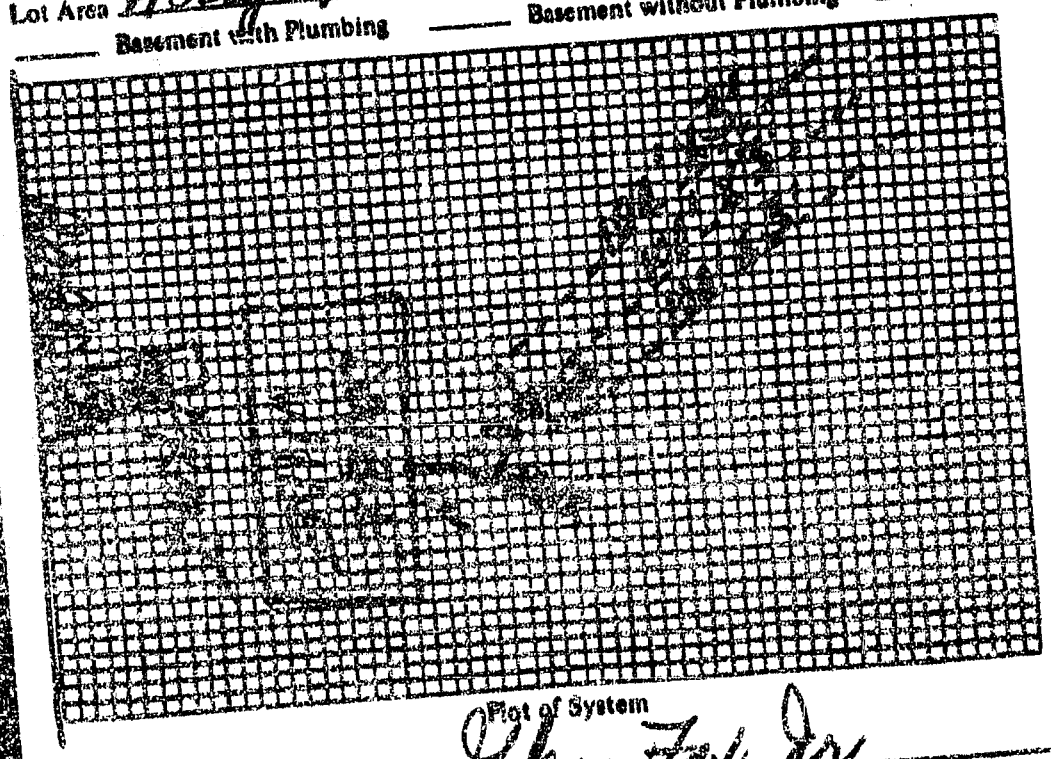

Plot of System

Installed by Boyd Adams

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY Glenn Taft Jr.

COMMENTS: _____

CERTIFICATE OF COMPLETION BY Robert Brown DATE 6-28-90

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold