
Attachment "A"
Permit # 101199
Pin # 4710-69-3381

PUMP TANK DESIGN

ATTACHMENT TO PROPERTY DESCRIPTION #_____

TAX MAP #_____

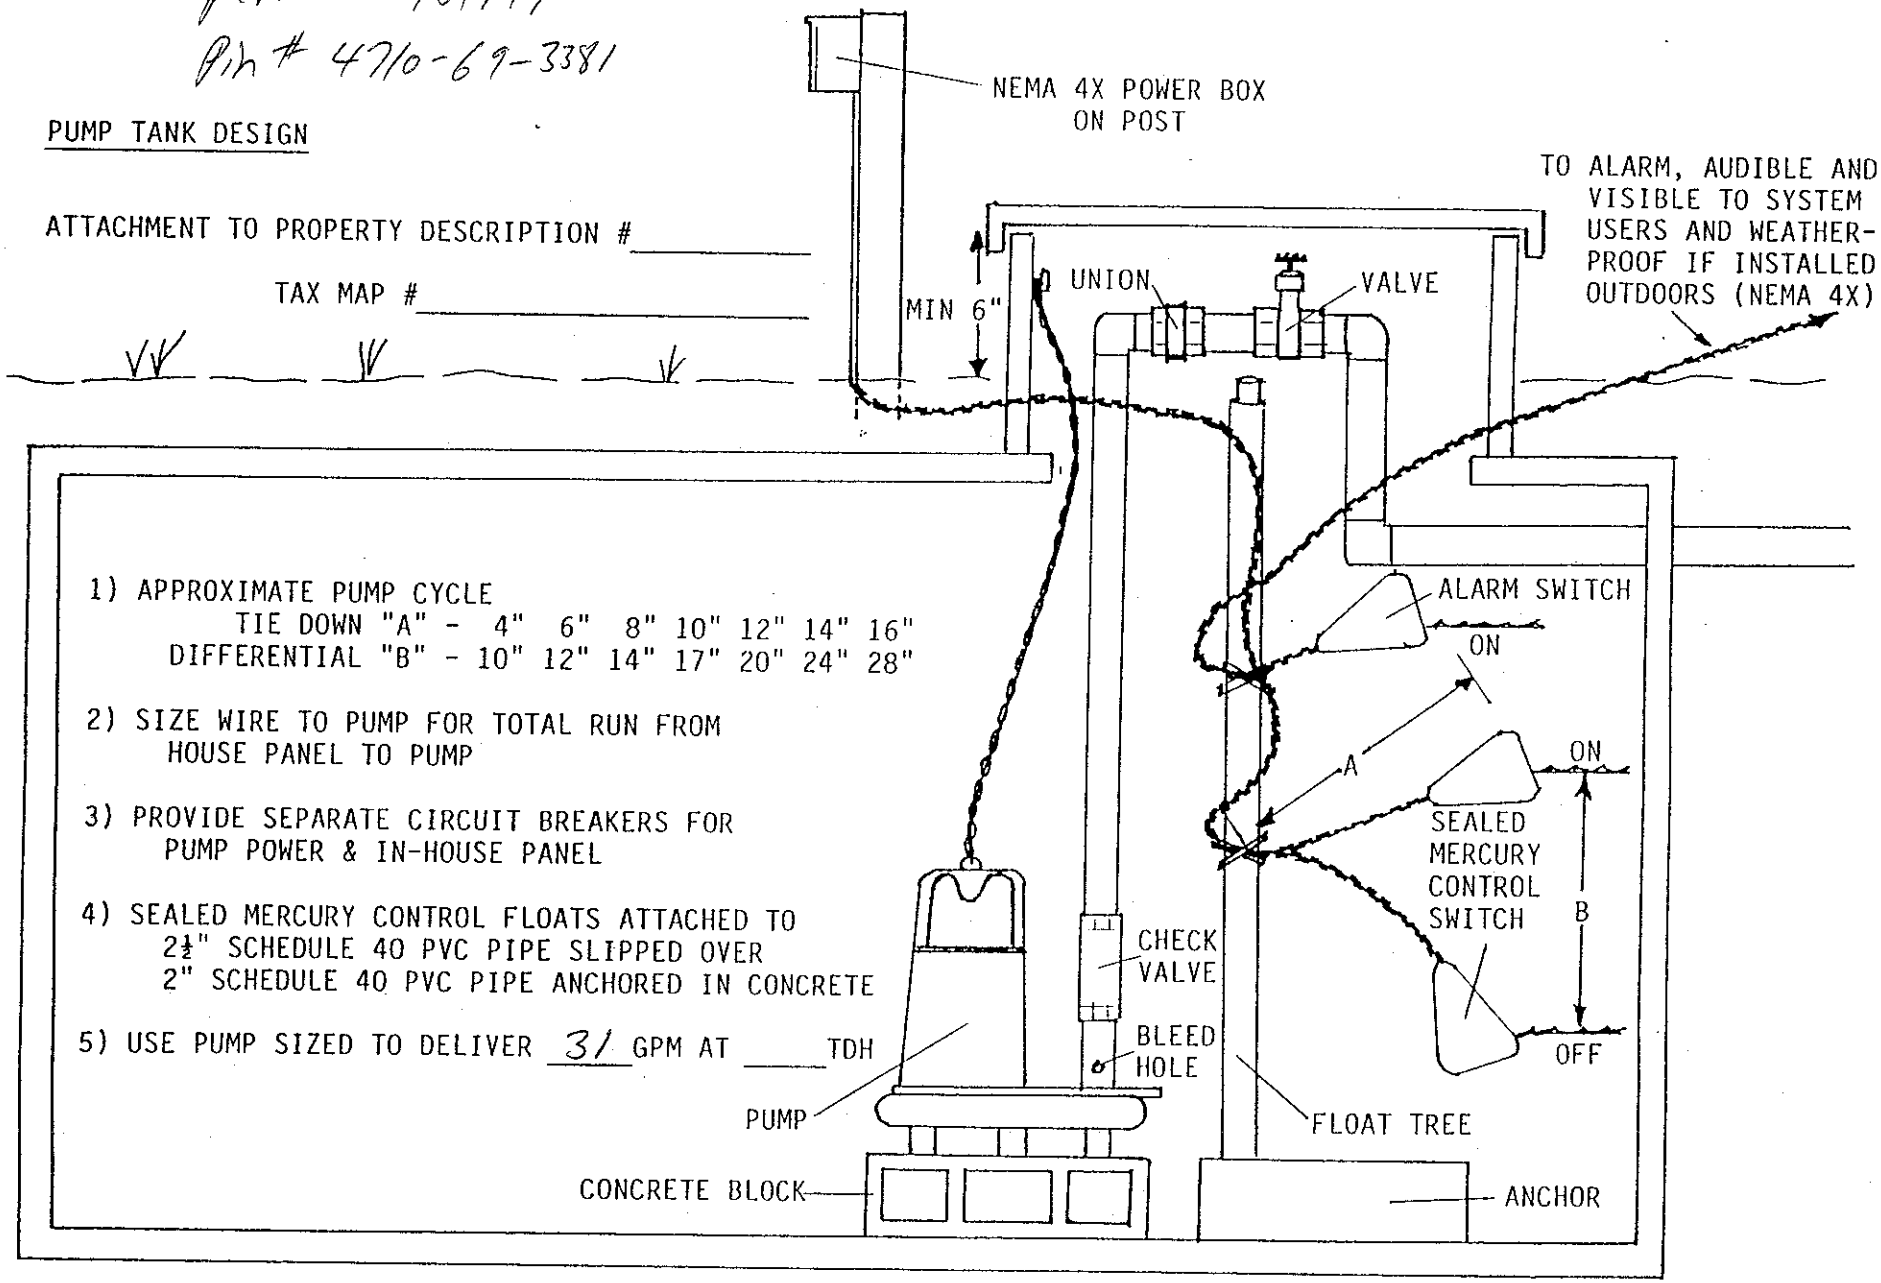

1) APPROXIMATE PUMP CYCLE
TIE DOWN "A" - 4" 6" 8" 10" 12" 14" 16"
DIFFERENTIAL "B" - 10" 12" 14" 17" 20" 24" 28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE


5) USE PUMP SIZED TO DELIVER 31 GPM AT _____ TDH

Attachment "B"
Permit # 101199
Pin #4710-69-3381

PRESSURE MANIFOLD DESIGN

ATTACHMENT TO P.D.#_____

TAX MAP #_____

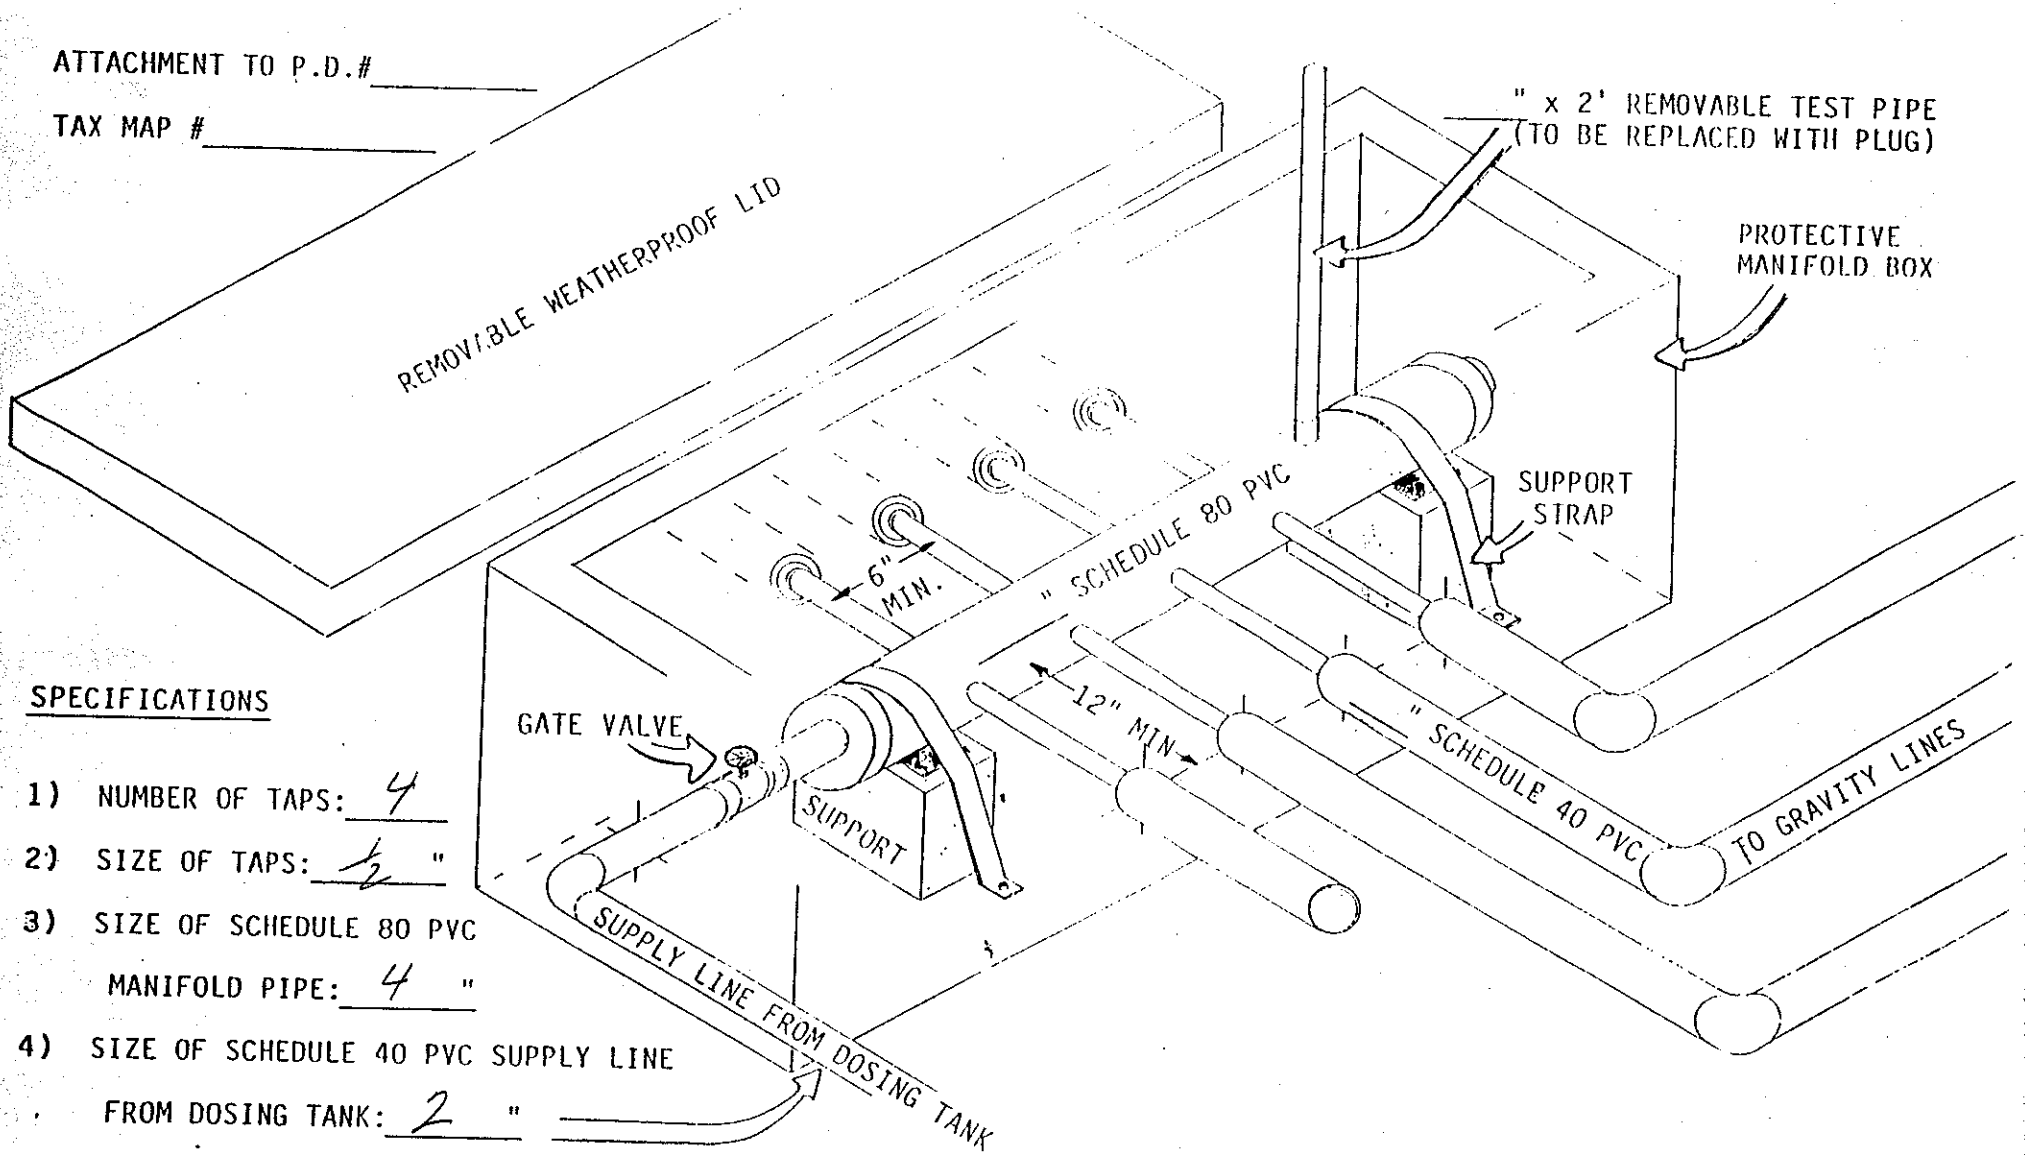

SPECIFICATIONS

1) NUMBER OF TAPS: 4

2) SIZE OF TAPS: ½ "

3) SIZE OF SCHEDULE 80 PVC
MANIFOLD PIPE: 4 "

4) SIZE OF SCHEDULE 40 PVC SUPPLY LINE
FROM DOSING TANK: 2 "