DENR/DEH

ON-SITE WASTEWATER SECTION

Sheet 1 of
PROPERTY ID #: 4712157099
COUNTY: Iredell

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Sandra Platt
ADDRESS: 597 Celeste Eufola Rd
PROPOSED FACILITY: 4 BR Residence PROPOSED DESIGN FLOW (.1949): 480gpd.
LOCATION OF SITE: 597 Celeste Eufola Rd.
WATER SUPPLY: • Private • Public • Well • Spring • Other N/A
EVALUATION METHOD: • Auger Boring • Pit • Cut

APPLICATION DATE 9-28-12
DATE EVALUATED: 10-4-12
PROPERTY SIZE: 6.72 acres
PROPERTY RECORDED: Yes
TYPE OF WASTEWATER: • Sewage • Industrial Process • Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	6.5% NS	0-10	SC SBK	Fr SS/SP Mod SG	>48"	>48"	>48"	>48"	PS 0.25
		10-31	C SBK mica	Fi SS/SP Mod SG					
		31-48	CL WSBK	Fr Mod SG					
			Coarse material present in 31"-48" horizon						
2	5% NS	0-10	SC SBK	Fr SS/SP Mod SG	>48"	>48"	>48"	>48"	PS 0.25
		10-32	C SBK mica	Fi SS/SP Mod SG					
		32-48	CL WSBK	Fr Mod SG					
			Coarse material present in CL horizon						
3	6.5% NS	0-10	SC SBK	Fr Mod SG	>48"	>48"	>48"	>48"	PS 0.25
		10-32	C SBK mica	Fi Mod SG					
		32-48	CL WSBK	Fr Mod SG					
			Coarse material present in CL horizon						
4	6% NS	0-6	SC SBK	Fr Mod SG	>48"	>48"	>48"	>48"	PS 0.25
		6-28	C SBK mica	Fr Mod SG					
		28-48	CL WSBK	Fr Mod SG					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	III	III
Site LTAR	0.25	0.25

OTHER FACTORS (.1946): N/A
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: Justin Henderson
OTHER(S) PRESENT: N/A

COMMENTS: N/A

LEGEND

use the following standard abbreviations

LANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL .1955 LTAR*	LPP .1957 LTAR*	MINERALOGY/ CONSISTENCE	STRUCTURE
CC (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
CV (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
D (Drainage Way)					EXP (Expansive)	CR (Crumb)
DS (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
FP (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
FS (Foot Slope)						ABK (Angular Blocky)
H (Head Slope)	III	Si (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
L (Linear Slope)		SiCL (Silty Clay Loam)				PR (Prismatic)
N (Nose Slope)		CL (Clay Loam)				
R (Ridge)		SCL (Sandy Clay Loam)			**MOIST**	**WET**
S (Shoulder Slope)		SiL (Silt Loam)				
T (Terrace)					VFR (Very Friable)	NS (Non-sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FR (Friable)	SS (Slightly Sticky)
		SiC (Silty Clay)			FI (Firm)	S (Sticky)
		C (Clay)			VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
		O (Organic)	None	None	EFI (Extremely Firm)	NP (Non-plastic)
						SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)

*Adjust LTAR due to depth, consistence, structure, soil wetness, landscape, position, wastewater flow and quality.


NOTES

HORIZON DEPTH	In inches below natural soil surface
DEPTH OF FILL	In inches from land surface
RESTRICTIVE HORIZON	Thickness and depth from land surface
SAPROLITE	S(suitable) or U(unsuitable)
SOIL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
CLASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

Evaluation of saprolite shall be by pits.

Long-term Acceptance Rate (LTAR): gal/day/ft^2

Show profile locations and other site features (dimensions, reference or benchmark, and North).

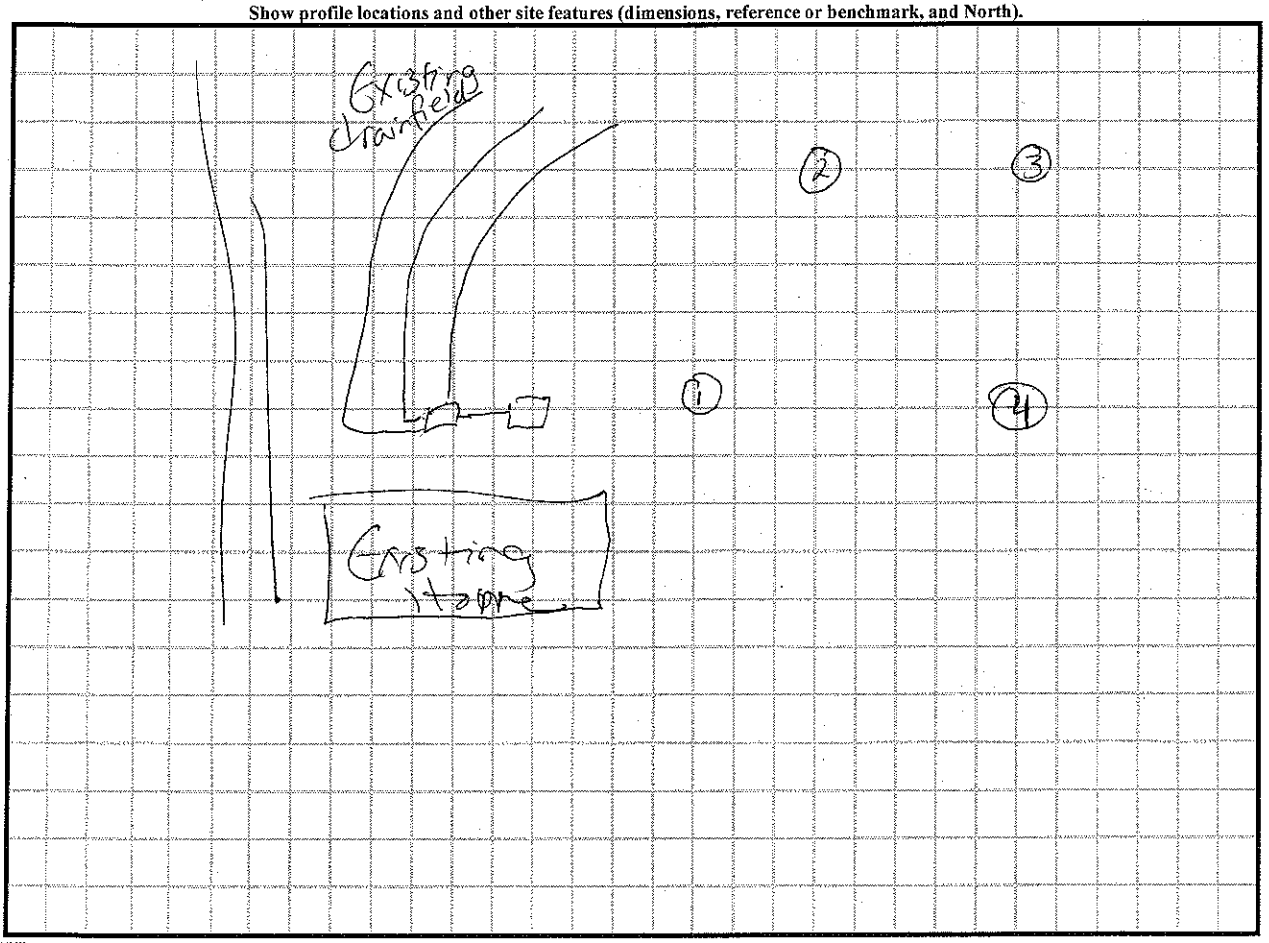

DENR (######)
Review (#####)