DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

#4 19314 543 471553 6543

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

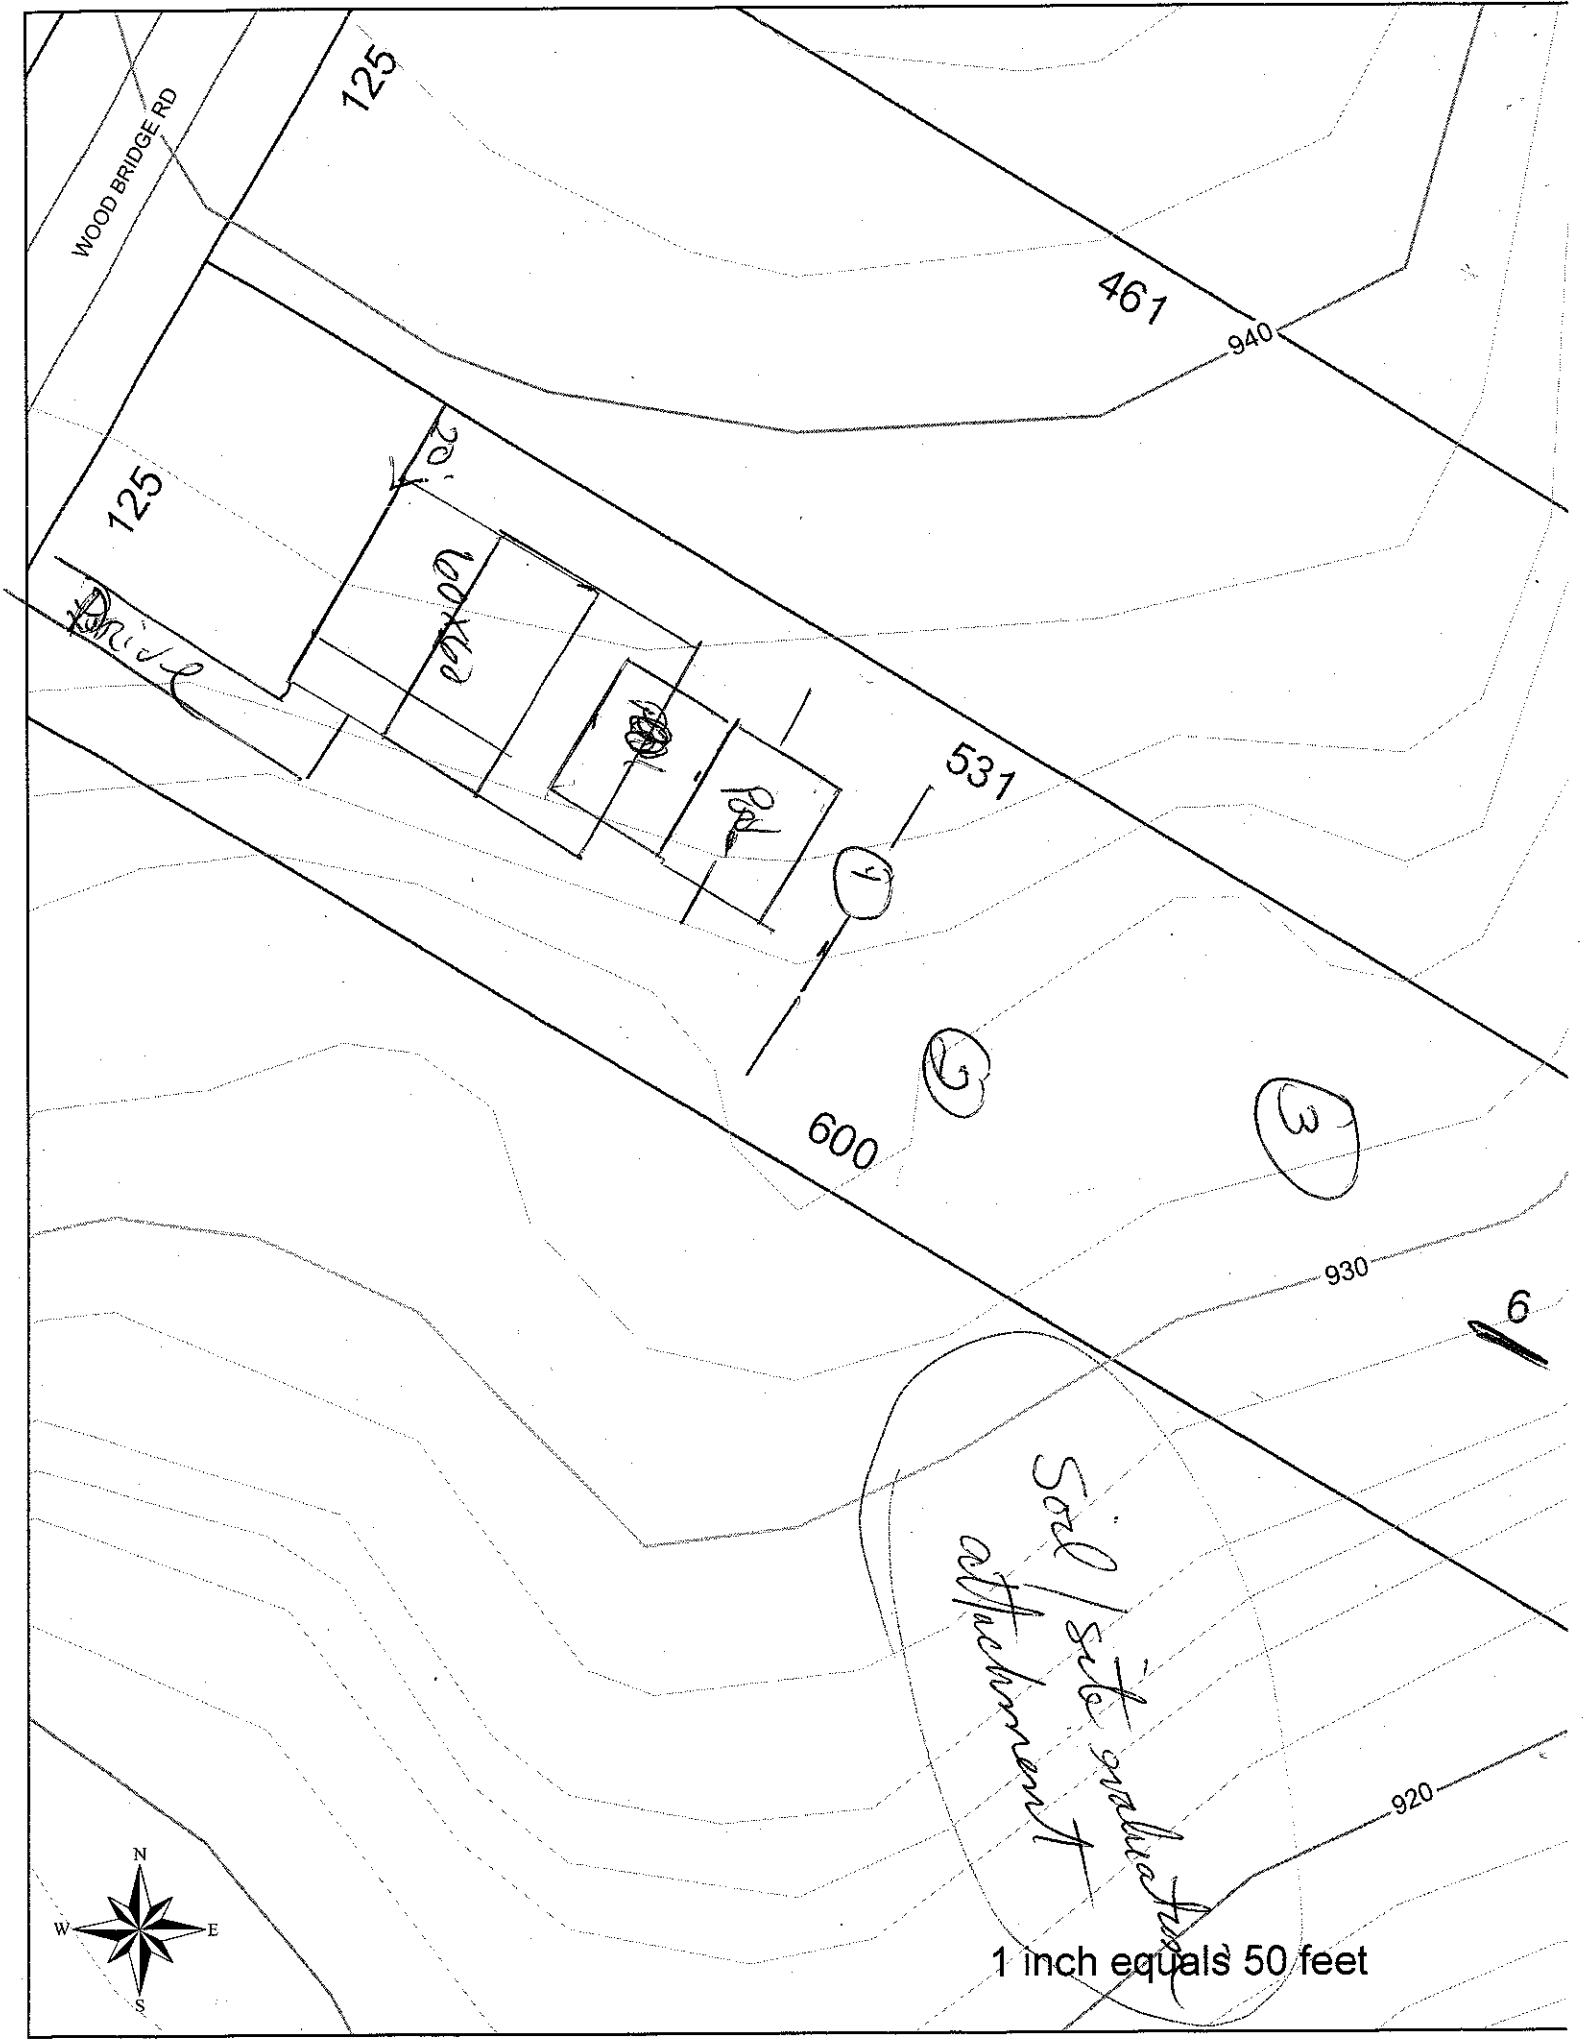
OWNER: C&D
ADDRESS: _____ APPLICATION DATE _____
PROPOSED FACILITY: House PROPOSED DESIGN FLOW (.1949): _____ DATE EVALUATED: _____
LOCATION OF SITE: _____ PROPERTY SIZE: _____
PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-16	SCLWBK	SSSPSMPF					1.25
		16-32	CLWBK	SSSPSMPS					
		32-56	B.AB1	SSSPSMPFR					
2		0-13	SCLWBK	SSSPSMPFR					1.25
		13-48	C.WBK	SSSPSMPF					
3		0-25	SCWBK	SSSPSMPF					1.25
		25-40	CWBK	SSSPSMPF modeling					
		40-56	CLWBK	SSSPSMPFR					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	1990 / 480	1550 / 300
System Type(s)	1.25	1.25
Site LTAR	1.25	1.25

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: Kelly Cox
OTHER(S) PRESENT: _____

COMMENTS: _____


WOOD BRIDGE RD
125
461
940
125
531
600
930
920
6
1
2
3
Soil Site evaluation attachment
1 inch equals 50 feet
N
W
E
S