DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

SHEET: 1 of 2
PROPERTY ID #: 132602
COUNTY: Iredell

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Nelson Dellinger
ADDRESS: 304 Bowles Farm Rd Statesville, NC 28625
PROPOSED FACILITY: Single Family PROPOSED DESIGN FLOW (.1949): 360 GPD
LOCATION OF SITE: 169 Hallmark Rd

APPLICATION DATE: 12/02/05
DATE EVALUATED: 12/28/05
PROPERTY SIZE: 9.765 Acres
PROPERTY RECORDED:

WATER SUPPLY: ■ Private ☐ Public ☐ Well ☐ Spring ☐ Other
EVALUATION METHOD: ■ Auger Boring ■ Pit ☐ Cut TYPE OF WASTEWATER: ■ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941)		OTHER PROFILE FACTORS				PROFILE CLASS & LTAR
			.1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	.1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	
1	S VL 12%	0-13	M SBK C	FR SS/SP SEXP		24"			U 0
		13-24	M GR SCL	VFR SS/SP SEXP					
		24+	L SAP						
2	S LL 10%	0-26	M SBK C	FR SS/SP SEXP		26"			U 0
		26+	L SAP						
3	S VL 12%	0-4	M SBK SCL	VFR SS/SP SEXP		24"	S		PS .3
		4-24	M SBK C	FR SS/SP SEXP					
		24-52	M GR L SAP	VFR NS/NP SEXP					
4	S LL 10%	0-4	M SBK SCL	VFR SS/SP SEXP		16"	S		PS .3
		4-16	M SBK C	FR SS/SP SEXP					
		16-35	M GR L SAP	VFR NS/SP SEXP					
		35-46	M SBK C	FR SS/SP SEXP					
		46-52	M GR L SAP	VFR NS/NP SEXP					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	S	S
System Type(s)	G 25% RED	G 25% RED
Site LTAR	.3	.3

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948): PS
EVALUATED BY:
OTHER(S) PRESENT:

COMMENTS: Profiles 1 and 2 are auger borings. Profiles 3 and 4 are pit evaluations. Site re-classified PS by pit eval.

Property ID#: 132602
County: Iredell

LEGEND

use the following standard abbreviations

LANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL .1955 LTAR*	LPP .1957 LTAR*	MINERALOGY/ CONSISTENCE	STRUCTURE
CC (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
CV (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
D (Drainage Way)					EXP (Expansive)	CR (Crumb)
DS (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
FP (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
FS (Foot Slope)						ABK (Angular Blocky)
H (Head Slope)	III	Si (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
L (Linear Slope)		SiCL (Silty Clay Loam)				PR (Prismatic)
N (Nose Slope)		CL (Clay Loam)				
R (Ridge)		SCL (Sandy Clay Loam)			**MOIST**	**WET**
S (Shoulder Slope)		SiL (Silt Loam)				
T (Terrace)					VFR (Very Friable)	NS (Non-sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FR (Friable)	SS (Slightly Sticky)
		SiC (Silty Clay)			FI (Firm)	S (Sticky)
		C (Clay)			VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
		O (Organic)	None	None	EFI (Extremely Firm)	NP (Non-plastic)
						SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)


*Adjust LTAR due to depth, consistence, structure, soil wetness, landscape, position, wastewater flow and quality.

NOTES

HORIZON DEPTH	In inches below natural soil surface
DEPTH OF FILL	In inches from land surface
RESTRICTIVE HORIZON	Thickness and depth from land surface
SAPROLITE	S(suitable) or U(unsuitable)
SOIL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
CLASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

Evaluation of saprolite shall be by pits.
Long-term Acceptance Rate (LTAR): gal/day/ft^2

Show profile locations and other site features (dimensions, reference or benchmark, and North).

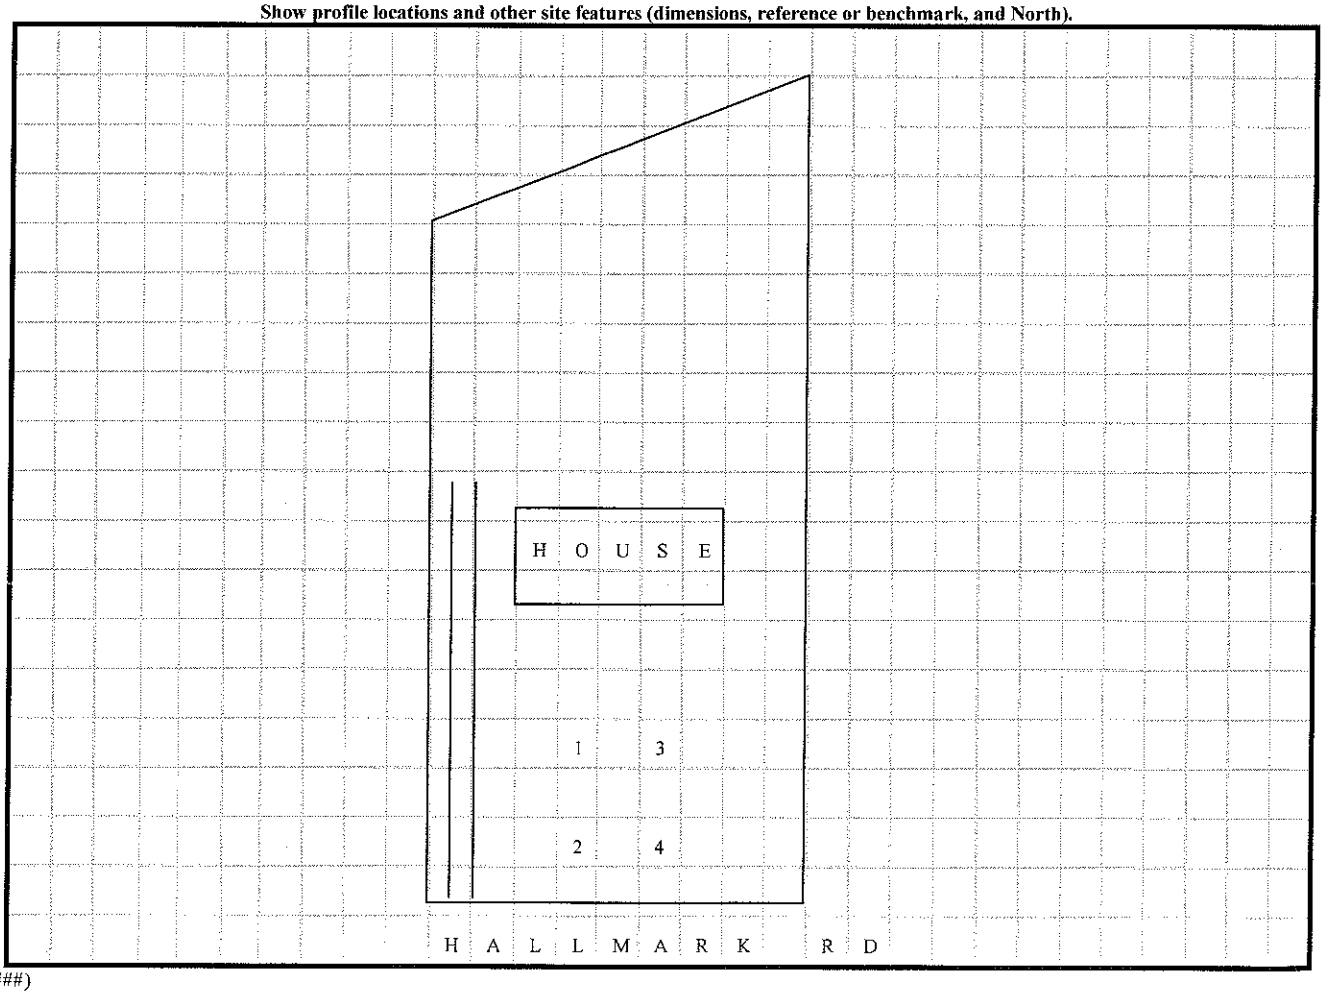

DENR (######)
Review (#####)