ICHD - ENVIRONMENTAL HEALTH DIVISION

Statesville Office (704) 878-5305 x3456 | Mooresville Office (704) 660-3625

BB BLDR-2024-46724

PERMIT: OSWP 2023-41486

SEPTIC: IMPROVEMENT PERMIT / AUTHORIZATION TO CONSTRUCT / OPERATION PERMIT / EXISTING SYSTEM

PIN # 4718 - 92 - 3722

APPLICANT/OWNER: CARRIE DOTSON | APPLICANT ADDRESS: 1860 CARRIAGE RD STATESVILLE NC 28677

SITE ADDRESS: 170 HIDDEN RIVER LN STATESVILLE NC 28625 | PHONE: 704 746 7094 | ALT. PHONE: —

SITE DIRECTIONS: 115 N → (L) PISGAH → (L) TREEBARK → (R) HIDDEN RIVER | SAP CONTROLLED: ☐ YES ☒ NO

SUBDIVISION: HIDDEN RIVER | SECTION: — | LOT # 8 | LOT AREA: 5AC | DESIGN FLOW: 600 | L.T.A.R.(Initial): 0.3 | L.T.A.R (Repair): 0.3

Septic Tank	1500 (gal)	STB 760	Date —	☒ New System ☐ Repair ☐ Expansion	System Type: I II (III) IV V VI	☒ Residence	No. Bedrooms 5
Pump Tank	— (gal)	PT —	Date —	System Description:	25% Reduction	☐ Business	No. Persons 10
Pump Make	—	Model —	Serial # —	Repair System Description:	25% Reduction	☐ Other	No. Employees —
# Nitrification Fields	1	# Lines 6	Linear Ft 500	Maintenance Agreement Required:	☐ YES ☒ NO	☐ Slab	☐ Crawl Space
Trench Width	36"	*Max. Trench Depth(Initial)	31"	*Max. Trench Depth(Repair)	30" Gravel Depth —	☒ GRAVITY	☐ PRESSURE

Water Supply: ☒ Private ☐ Public ☐ Community

☒ Basement w/plumbing ☐ Basement w/o plumbing

* Measured on the downhill side of the trench | Effluent Standard: ☒ DSE ☐ HSE ☐ TS-I ☐ TS-II ☐ RCW ☐ NSF/ANSI 40 | Usable Depth to LC (Initial): 48" | Usable Depth to LC (Repair): 48" *Limiting Condition*

Comments / Conditions: Install on contour 9' on center. Grinder pump to settling tank. Utilize Senal distribution. Do not exceed 36" maximum trench depth.

*50' buffer, Powerline ROW, to be marked at install.

Floorplans larger than in field, does not affect septic area.

INITIAL SITE SKETCH

SETTLING TANK 1500 gal STB 964 DATE —

SEE ATTACHED SITE PLAN BY ICHD.

AS BUILT SKETCH

Installed as drawn.

FOR SEPTIC FINAL INSPECTION CALL: 704-664-3703 between 8am-9am the day the inspection is needed. Be sure to speak with an inspector to confirm your time.

Permit can be suspended or revoked if any false information is supplied toward securing the permit / any unauthorized changes are made to the site / any unauthorized changes are made in the installation of the system. **CONTACT A LOCATOR SERVICE PRIOR TO ANY EXCAVATION**

☐ **IMPROVEMENT PERMIT** *with plat valid without expiration.* ☒ **IMPROVEMENT PERMIT** *with site plan valid for 60 mos.* ☒ **AUTHORIZATION TO CONSTRUCT** *valid for period equal to IMPROVEMENT PERMIT--not to exceed 60 mo.*

Owner / Applicant Signature: ONLINE | Date: — | Installed by: Groundbreakers

IMPROVEMENT PERMIT by: Sarah Williams | Date: 2/7/2024 | OPERATION PERMIT by: Sarah Williams | Date: 4/30/2024

AUTHORIZATION TO CONSTRUCT by: Sarah Williams | Date: 2/7/2024 | Existing System Inspected by: | Date:

Item	Date	Initials
Drain Lines Checked		
Tanks Checked		
Pressure Manifold or Valve Box Checked		
Pressure Head Set		
Electrical Checked		
Floats Set		
Alarm Checked		
Maintenance Contract Needed? Y / N		
Comments:		

Repairs Only	
	State Code
Failing System Code	
Type of Distribution	G or P
Type of Failure/Malfunction	
Primary Cause of Failure/Malfunction	
Age of System? _____	
Initial or Repair? _____	


170 HIDDEN RIVER

Sarah Williams

2/7/2024

KEY

A = SEPTIC TANK
B = SETTLING TANK
SCALE 1" = 100'

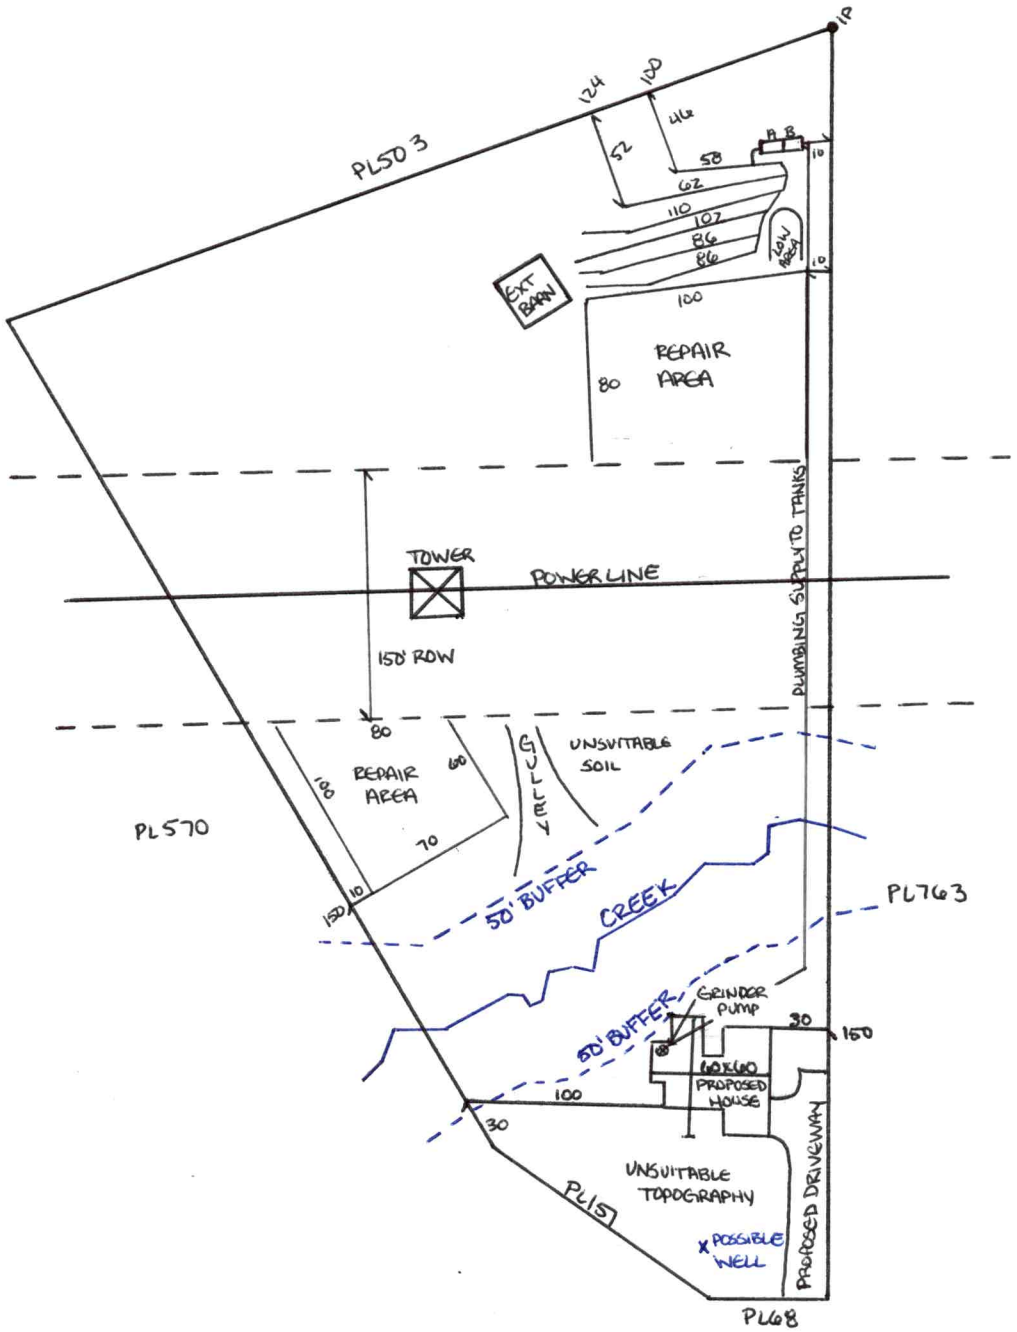

PERMIT SNAPSHOT REPORT RELAY-2023-41486 FOR IREDELL COUNTY

Permit Type	EH Re-layout	**Project:**		**App Date:**	11/19/2023
Work Class:	EH Limited	**District:**	Iredell County	**Exp Date:**	11/20/2024
Status:	Need to Draw	**Square Feet:**	0.00	**Completed:**	NOT COMPLETED
Valuation:	$0.00	**Assigned To:**	Bracken, Sarah	**Approval Expire Date:**	
Description:	Re layout for OSWP-2023-32368. Redraw with a grinder pump. IP / AC FLOOR PLANS INCLUDED Please Assign to Sarah Bracken				

Parcel: 4718923722.000 Main	**Address:** 170 Hidden River Ln Statesville, NC 28625 Main	**Zone:** RA(Residential Agricultural District)

Property Owner	Applicant/Authorized Agent
Michael Jones	Chad Holloway
Home: (123) 456-7899	186 Carriage road Statesville, NC 28677 Mobile: (704) 746-7094

Permit Custom Fields

How is your site plan being submitted	Survey Plat	Does the site contain any jurisdictional wetlands	No	Non-domestic Sewage Generated	No
Other Public Agency	Yes	All proposed structure dimensions	62'9" x 71'9.5" Ranch home on a basement with plumbing	What are the proposed structures	New Single-Family Residence - Stick Built
If other Addition/Structure, please explain		Maximum Number of Bedrooms	5	Number of Occupants	10
Foundation Type	Basement with Plumbing	Residential/Business/Other	Residential	Number of Employees	0
Total number of seats	0	Water Supply	New Well	Desired Septic System Type	Conventional (most common)
If other septic system type, please explain		Additional Unique Setbacks Apply	No		

Attachment File Name	Added On	Added By	Attachment Group	Notes
Signature_Chad_Holloway_11/19/2023.jpg	11/19/2023 15:22	Holloway, Chad		Uploaded via CSS
CamScanner 11-19-2023 15.18_v1.pdf	11/20/2023 7:58	Nebel, Barbara	Available Online	Authorize to Act as Agent
170 HIDDEN RIVER LN FLOOR PLAN.pdf	02/02/2024 9:51	COMEAUX, DEBRA	Available Online	FLOOR PLAN
170 HIDDEN RIVER LN DEED.pdf	02/02/2024 9:52	COMEAUX, DEBRA	Available Online	DEED

Invoice No.	Fee	Fee Amount	Amount Paid
INV-00024972	Limited Re-layout	$105.00	$105.00
	Total for Invoice INV-00024972	$105.00	$105.00
	Grand Total for Permit	**$105.00**	**$105.00**


Workflow Step / Action Name	Action Type	Start Date	End Date
Application Completeness Check v.1		11/20/2023 7:58	11/20/2023 7:58
Confirm application complete v.1	Generic Action		11/20/2023 7:58
Fees v.1		11/20/2023 7:58	02/01/2024 7:31
Issue Invoice v.1	Generic Action		11/20/2023 7:58
Fees Paid v.1	Generic Action		02/01/2024 7:31
~~**Zoning Review v.1**~~			11/20/2023 7:58

PERMIT SNAPSHOT REPORT (RELAY-2023-41486)


~~Floodplain Admin Overview v.1~~	Task	11/20/2023 7:58
~~Issue Invoice v.1~~	Generic Action	11/20/2023 7:58
~~Fees Paid v.1~~	Generic Action	11/20/2023 7:58
Permit Ready v.1		
Issue Permit v.1		
Issue Permit v.1	Generic Action	
Environment Health Inspections v.1		
Operation Permit Inspection v.1	Inspection	

PLAN/PRICE
SUBJECT TO APPROVAL

FINAL GRADE TO BE DETERMINED ON SITE

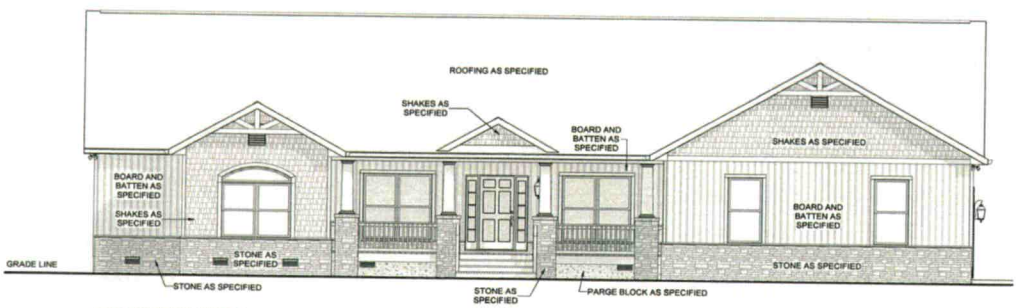

FRONT ELEVATION

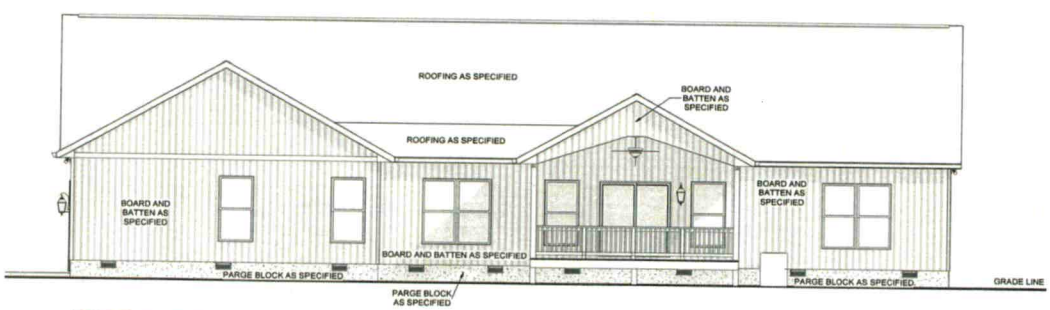

REAR ELEVATION

OPT. PAPER SIZE: for 1/4" = 1'-0" on 24" x 36" PAPER SIZE ENLARGE PRINTS TO 200%

PRELIMINARY DESIGN PLANS

PAPER SIZE: 11" x 17"

TO REPORT COPYRIGHT VIOLATIONS CALL (770) 532-1128 THE USE OF THIS PLAN BY ANYONE OTHER THAN AN AGENT OF "AMERICA'S HOME PLACE, INC." IS IN VIOLATION OF THE FEDERAL COPYRIGHT VIOLATION ACT. $1000 REWARD FOR RECOVERING AN ACTUAL COPYRIGHT INFRINGEMENT.
©COPYRIGHT-ALL RIGHTS RESERVED NOTE:VIOLATORS OF THE COPYRIGHT WILL BE PROSECUTED TO THE FULLEST EXTENT OF THE LAW. THIS WORK IS THE INTELLECTUAL PROPERTY OF AMERICA'S HOME PLACE AND SHALL NOT BE REPRODUCED WITHOUT PERMISSION.

REVISION SCHEDULE

REV #	DESCRIPTION	DATE

AREAS:

FIRST FLOOR HEATED	2,739 SF
	2,739 SF
FRONT PORCH	275 SF
GARAGE	964 SF
TOTAL UNDER ROOF	1,139 SF
	3,877 SF

TITLE: CARNEGIE II

JOB: DOTSON, CARIE & CHRISTOPHER
170 HIDDEN RIVER
STATESVILLE, NC 28625

OFFICE: STATESVILLE

SOLD BY: J. SCHOOLEY

JOB #: 87-23-059

FOUNDATION TYPE: CRAWLSPACE

PRINTED: 1/19/2023 11:26:52 AM

DRAWN BY: DANIEL A.

CHECKED BY: JB

PROPERTY OF:

©COPYRIGHT - 2023

SHEET #: DP-1

FRONT & REAR ELEVATIONS

SCALE: 1/8" = 1'-0"

DESIGN PLAN SHEET LIST

SHEET NUMBER	SHEET NAME
DP-0	COVER SHEET
DP-1	FRONT & REAR ELEVATIONS
DP-2	LEFT & RIGHT ELEVATIONS
DP-3	FLOOR PLAN
DP-4	ELECTRICAL DESIGN PLAN

ABBREVIATION LEGEND:

5 SH.	FIVE SHELVES	H.B.	HOSE BIBB	R.O.	ROUGH OPENING
6 SH.	SIX SHELVES	H.D.G.	HOT DIPPED GALVANIZED	S.C.	SUPPLY IN CEILING (HVAC)
A.F.F.	ABOVE FINISHED FLOOR	HDWD	HARDWOOD	S.D.	SMOKE DETECTOR
B.C.	BLIND CORNER (CABINET)	HDR.	HEADER	SH	SINGLE HUNG
C.H.	COMFORT HEIGHT	HT.	HEIGHT	SH-RD	SHELF AND ROD
C.J.	CEILING JOIST	INT.	INTERIOR	S.J.	SINGLE JOIST
C.M.U.	CONCRETE MASONRY UNIT	K.S.	KNEE SPACE	SM/CO	SMOKE AND CARBON MONOXIDE DETECTOR
C.O.	CASED OPENING	KDAT	KILN DRIED AFTER TREATMENT	SPEC.	SPECIFIED
CONC.	CONCRETE	L.B.W.	LOAD BEARING WALL	SPF	SPRUCE/PINE/FIR
C.R.V.	CONTINUOUS RIDGE VENT	L.S.	LAUNDRY SINK or LAZY SUSAN	S.R.O.	SHEETROCK OPENING
DBL SH-RD	DOUBLE SHELF and ROD	LVP	LUXURY VINYL PLANK	S.Y.P.	SOUTHERN YELLOW PINE
D.H.	DOUBLE HUNG	LVT	LUXURY VINYL TILE	T&G	TONGUE AND GROOVE
DR. or DRR	DRAWER	O.C.	ON CENTER	TEMP.	TEMPERED
D.S.	DRAWER SPACE	O.H.	OVERHEAD	T.O.P.	TOP OF PLATE
EVP	ENGINEERED VINYL PLANK	OPT.	OPTIONAL	TRAP.	TRAPEZOID (WINDOW)
EXT.	EXTERIOR	O.W.H.	OVER THE WALL HEIGHT	U.N.O.	UNLESS NOTED OTHERWISE
F.J.	FLOOR JOIST	P.T.	PRESSURE TREATED	UTIL	UTILITY
F.S.	SUPPLY IN FLOOR (HVAC)	PANT.	PANTRY	VAN.	VANITY
FTG.	FOOTING	R/A	RETURN AIR (HVAC)	WH	WATER HEATER
GYP. BD.	GYPSUM BOARD	REINF.	REINFORCED	W.H.H.	WINDOW HEADER HEIGHT
				W.I.C.	WALK IN CLOSET


PLAN/PRICE
SUBJECT TO APPROVAL

SPECIAL NOTES

- UPGRADE GUTTERS TO PREMIUM COLOR
- STAINLESS HOOD
- BRONZE WINDOWS - ESTIMATE ONLY
- INTERIOR DOOR STYLE - MADISON
- BRONZE LIGHTING, FAUCETS AND DOOR HARDWARE
- BLACK APPLIANCES



FRONT VIEW

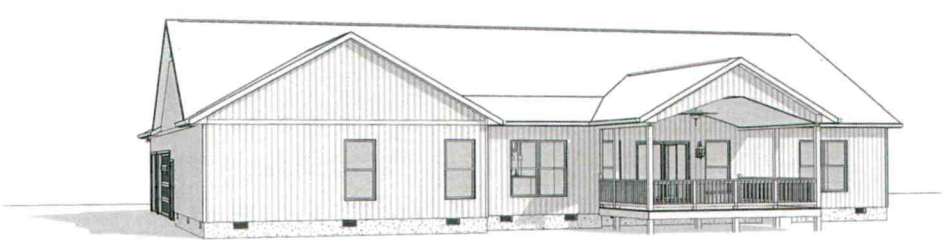

REAR VIEW

OPT. PAPER SIZE: for 1/4" = 1'-0" on 24" x 36" PAPER SIZE ENLARGE PRINTS TO 200%

PRELIMINARY DESIGN PLANS

PAPER SIZE: 11" x 17"

REVISION SCHEDULE		
REV #	DESCRIPTION	DATE

AREAS:	
FIRST FLOOR HEATED	2,739 SF
	33
	170 SF
FRONT PORCH	174 SF
GARAGE	964 SF
TOTAL UNDER ROOF	1,139 SF 3,877 SF

TYPE: CARNEGIE II

FOR: DOTSON, CARIE & CHRISTOPHER

170 HIDDEN RIVER
STATESVILLE, NC 28625

VENDEE:

SOLD BY: J. SCHOOLEY

JOB #: 87-23-059

2x4 EXTERIOR WALLS

FOUNDATION TYPE: CRAWLSPACE

DRAWN BY: DANIEL A.

CHECKED BY: JB

PRINTED: 11/6/2024 11:22:40 AM

PROPERTY OF:

©COPYRIGHT - 2003

SHEET #: DP-0


SCALE: 1/8" = 1'-0"

COVER SHEET


TO REPORT COPYRIGHT VIOLATIONS CALL (770) 532-1128 THE USE OF THIS PLAN BY ANYONE OTHER THAN AN AGENT OF "AMERICA'S HOME PLACE, INC." IS IN VIOLATION OF THE FEDERAL COPYRIGHT VIOLATION ACT. $1000 REWARD FOR RECOVERING AN ACTUAL COPYRIGHT INFRINGEMENT.
© COPYRIGHT-ALL RIGHTS RESERVED NOTE:VIOLATORS OF THE COPYRIGHT WILL BE PROSECUTED TO THE FULLEST EXTENT OF THE LAW. THIS WORK IS THE INTELLECTUAL PROPERTY OF AMERICA'S HOME PLACE AND SHALL NOT BE REPRODUCED WITHOUT PERMISSION.

PLAN/PRICE
SUBJECT TO APPROVAL

FINAL GRADE TO BE DETERMINED ON SITE

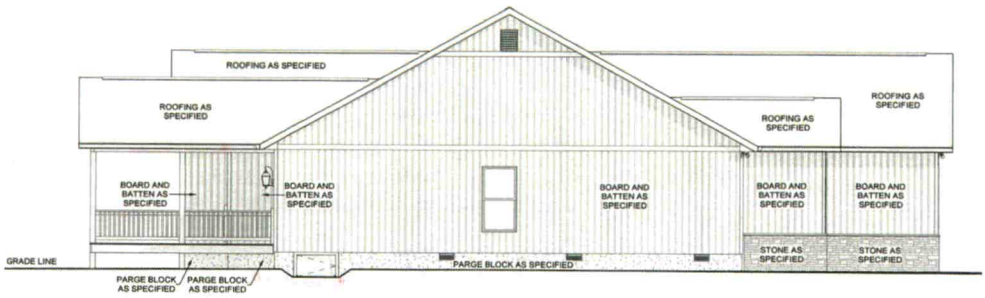

LEFT ELEVATION

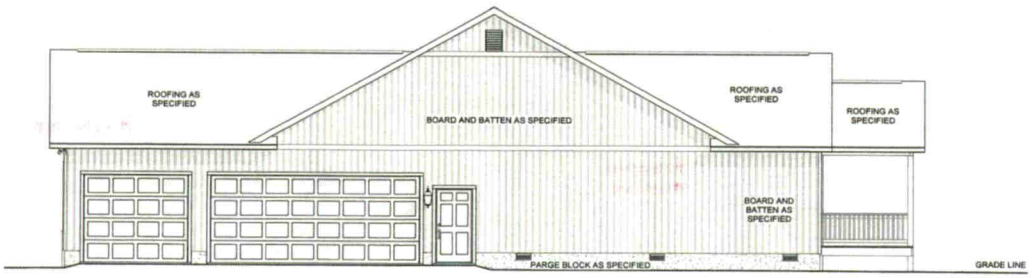

RIGHT ELEVATION

REVISION SCHEDULE

REV #	DESCRIPTION	DATE

AREAS:

FIRST FLOOR HEATED	2,799 SF
	2,799 SF
FRONT PORCH	74 SF
GARAGE	964 SF
TOTAL UNDER ROOF	1,139 SF
	3,877 SF

TITLE: CARNEGIE II

JOB #: 87-23-059

FOUNDATION TYPE: CRAWLSPACE

FOR: DOTSON, CARIE & CHRISTOPHER

170 HIDDEN RIVER
STATESVILLE, NC 28625

OFFICE: STATESVILLE

SALES BY: J. SCHOOLEY

DRAWN BY: DANIEL A.

CHECKED BY: JB

PRINTED: 1/16/2024 11:22:32 AM

PROPERTY OF:

© COPYRIGHT - 2022

SHEET #: DP-2

SHEET NAME: LEFT & RIGHT ELEVATIONS


SCALE: 1/8" = 1'-0"

OPT. PAPER SIZE: for 1/4" = 1'-0" on 24" x 36" PAPER SIZE ENLARGE PRINTS TO 200%

PRELIMINARY DESIGN PLANS


PAPER SIZE: 11" x 17"

TO REPORT COPYRIGHT VIOLATIONS CALL (770) 532-1128 THE USE OF THIS PLAN BY ANYONE OTHER THAN AN AGENT OF "AMERICA'S HOME PLACE, INC." IS IN VIOLATION OF THE FEDERAL COPYRIGHT VIOLATION ACT. $1000 REWARD FOR RECOVERING AN ACTUAL COPYRIGHT INFRINGEMENT.
© COPYRIGHT-ALL RIGHTS RESERVED NOTE:VIOLATORS OF THE COPYRIGHT WILL BE PROSECUTED TO THE FULLEST EXTENT OF THE LAW. THIS WORK IS THE INTELLECTUAL PROPERTY OF AMERICA'S HOME PLACE AND SHALL NOT BE REPRODUCED WITHOUT PERMISSION.

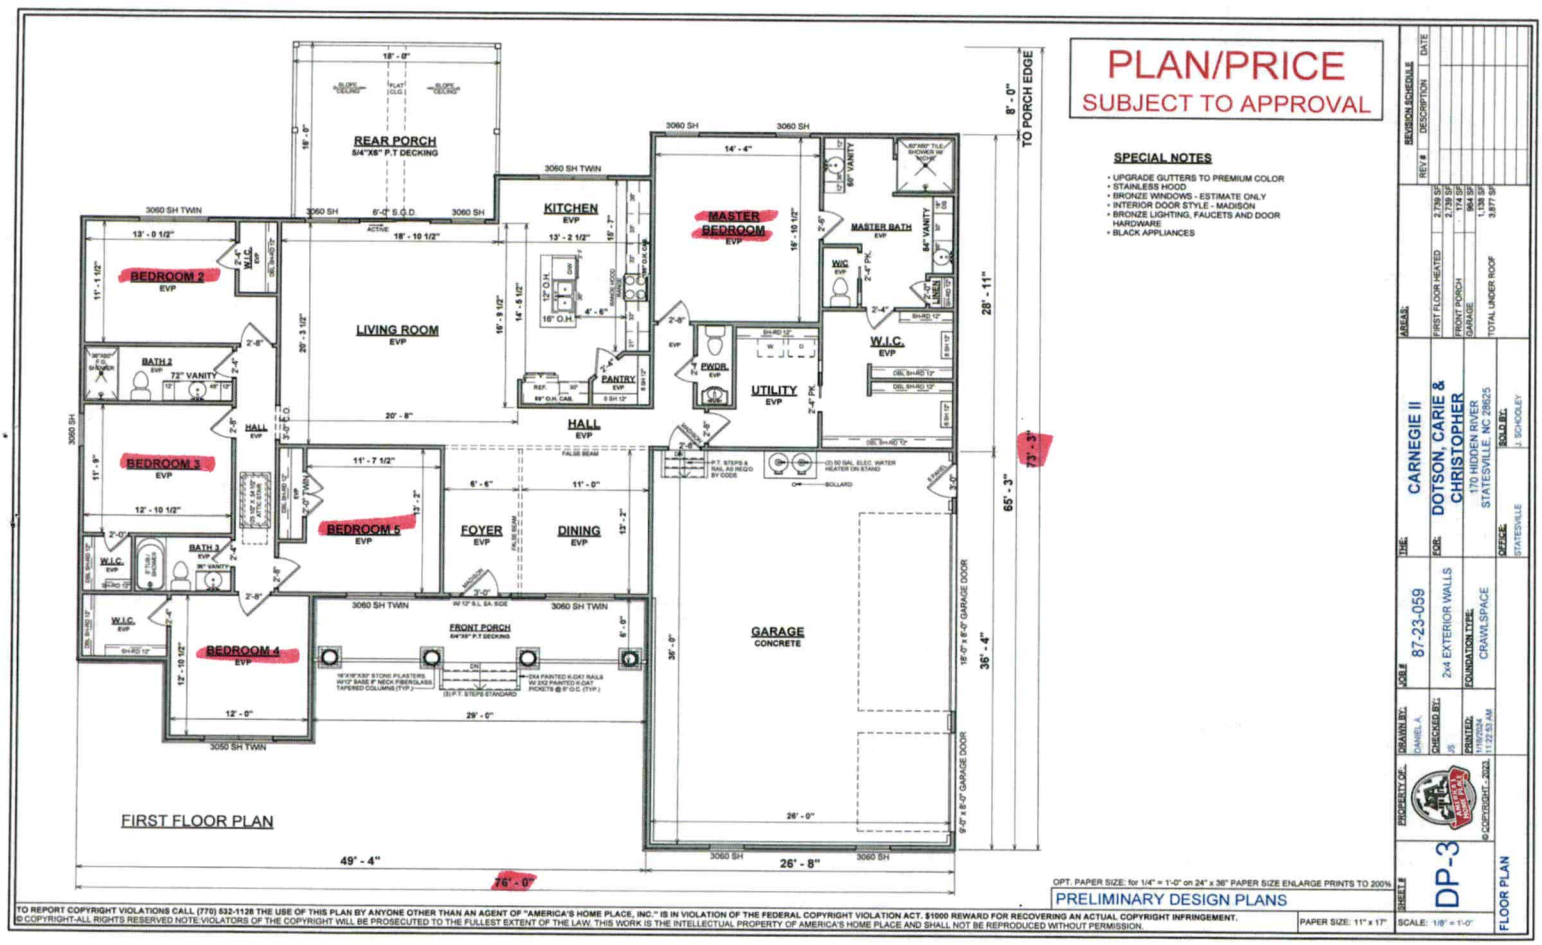

TO REPORT COPYRIGHT VIOLATIONS CALL (770) 632-1128 THE USE OF THIS PLAN BY ANYONE OTHER THAN AN AGENT OF "AMERICA'S HOME PLACE, INC." IS IN VIOLATION OF THE FEDERAL COPYRIGHT VIOLATION ACT. $1000 REWARD FOR RECOVERING AN ACTUAL COPYRIGHT INFRINGEMENT.
© COPYRIGHT-ALL RIGHTS RESERVED NOTE:VIOLATORS OF THE COPYRIGHT WILL BE PROSECUTED TO THE FULLEST EXTENT OF THE LAW. THIS WORK IS THE INTELLECTUAL PROPERTY OF AMERICA'S HOME PLACE AND SHALL NOT BE REPRODUCED WITHOUT PERMISSION.

PLAN/PRICE
SUBJECT TO APPROVAL

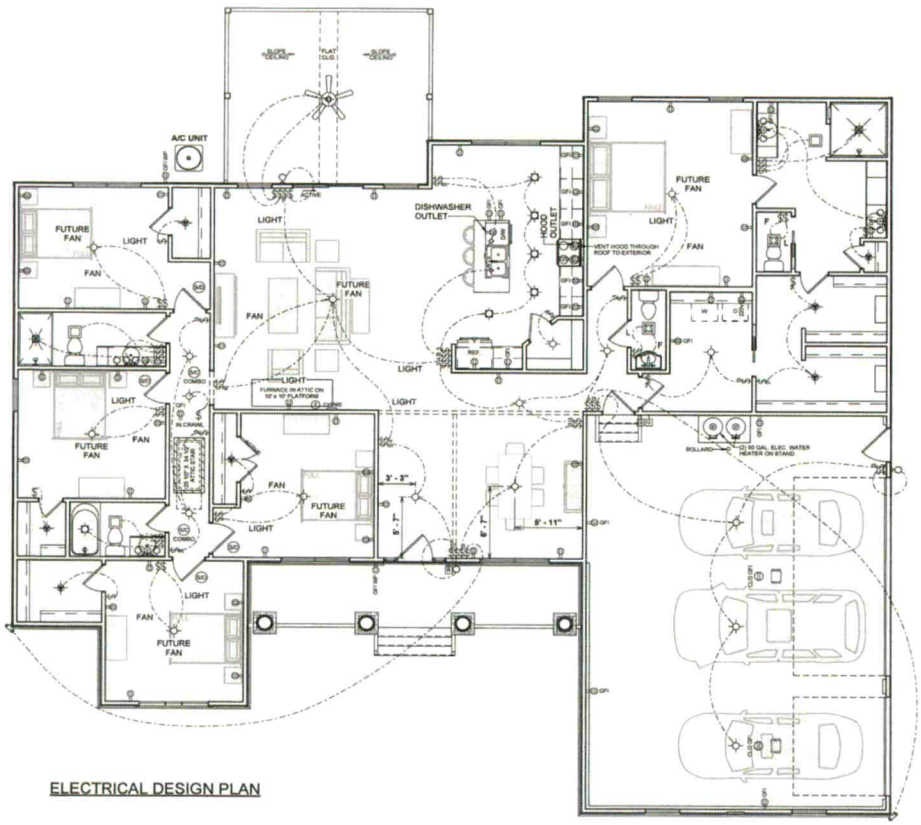

ELECTRICAL DESIGN PLAN

ELECTRICAL NOTES:

- BRANCH CIRCUITS THAT SUPPLY 125V, SINGLE PHASE, 15 & 20 AMP RECEPTACLE OUTLETS IN ALL ROOMS AS REQUIRED BY CODE, SHALL BE PROTECTED BY ARC-FAULT CIRCUIT INTERRUPTER, COMBINATION TYPE, INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUIT N.C. ELECT.CODE SECT.210.12(b)
- CONFORM ELECT. WRING & COMPONENTS TO CURRENT NEC PROVISIONS FOR 1 & 2 FAMILY DWELLINGS AS REQUIRED BY CODE
- OUTLET, FIXTURE, & COMPONENT LOCATIONS ARE APPROXIMATE AND WILL VARY DUE TO DESIGN AND CODE RESTRICTIONS & REQUIREMENTS
- SERVICE DISCONNECT REQUIRED
- CONDENSATE PUMP REQUIRED

ELECTRICAL LEGEND	
LIGHT FIXTURES	
CEILING FAN	
CEILING MOUNT	
COACH / SCONCE	
EXHAUST FAN	
EXHAUST FAN W LIGHT	
EXTERIOR FLOOD	
FLUORESCENT - CEILING	
FLUORESCENT - WALL	
LED	
PENDANT	
RECESSED CAN	
RECESSED EYEBALL CAN	
UNDER / OVER CABINET LIGHT	
VANITY	
ELECTRICAL FIXTURES	
DOOR BELL BUTTON	
DOOR BELL CHIME	CHIME
GARAGE DOOR OPENER	CLG GFI
MEDIA	TV TV DATA
OUTLET	
OUTLET - CEILING	
OUTLET - FLOOR	
OUTLET - GFI	GFI GFI WP
OUTLET - 220v	220
SWITCH	$ $ $ $
SMOKE & CARBON DETECTOR	COMBO
SMOKE DETECTOR	SD
THERMOSTAT	T

- OUTLET, FIXTURE, & COMPONENT LOCATIONS ARE APPROXIMATE. ACTUAL WILL VARY DUE TO DESIGN AND CODE RESTRICTIONS & REQUIREMENTS
- BUILDER AND HVAC CONTRACTOR RESERVE THE RIGHT TO LOCATE SUPPLY VENTS AND/OR LINES TO ACCOMODATE OPTIMUM USAGE AND RESTRICTIONS DUE TO CODE & DESIGN REQUIREMENTS

OPT. PAPER SIZE: for 1/4" = 1'-0" on 24" x 36" PAPER SIZE ENLARGE PRINTS TO 200%

PRELIMINARY CONSTRUCTION PLANS

TO REPORT COPYRIGHT VIOLATIONS CALL (770) 532-1128 THE USE OF THIS PLAN BY ANYONE OTHER THAN AN AGENT OF "AMERICA'S HOME PLACE, INC." IS IN VIOLATION OF THE FEDERAL COPYRIGHT VIOLATION ACT. $1000 REWARD FOR RECOVERING AN ACTUAL COPYRIGHT INFRINGEMENT.
© COPYRIGHT-ALL RIGHTS RESERVED NOTE-VIOLATORS OF THE COPYRIGHT WILL BE PROSECUTED TO THE FULLEST EXTENT OF THE LAW. THIS WORK IS THE INTELLECTUAL PROPERTY OF AMERICA'S HOME PLACE AND SHALL NOT BE REPRODUCED WITHOUT PERMISSION.

PAPER SIZE: 11" x 17"

REVISION SCHEDULE

REV #	DESCRIPTION	DATE

AREAS:

FIRST FLOOR HEATED	2,739 SF
	2,739 SF
FRONT PORCH	151 SF
GARAGE	864 SF
	1,138 SF
TOTAL UNDER ROOF	3,877 SF

PLAN: CARNEGIE II

FOR: DOTSON, CARIE & CHRISTOPHER

170 HIDDEN RIVER
STATESVILLE, NC 28625

SOLD BY: J. SCHOOLEY

OFFICE: STATESVILLE

JOB #: 87-23-059

2x4 EXTERIOR WALLS

FOUNDATION TYPE: CRAWLSPACE

DRAWN BY: DANIEL A.

CHECKED BY: JB

PRINTED: 1/16/2024 11:22:34 AM

PROPERTY OF:

© COPYRIGHT - 2003

SHEET #: DP-4

SCALE: 1/8" = 1'-0"

ELECTRICAL DESIGN PLAN

DEPARTMENT OF HEALTH AND HUMAN SERVICES
DIVISION OF PUBLIC HEALTH, ENVIRONMENTAL HEALTH SECTION
ON-SITE WATER PROTECTION BRANCH

Sheet 1 of 2
PROPERTY ID #:
COUNTY: ~~IREDELL~~
4718-92-3722

SOIL/SITE EVALUATION
***for* ON-SITE WASTEWATER SYSTEM**
(Complete all fields in full)

OWNER: Carne Dotson / Chad Holloway
ADDRESS: 186 Carriage Road Statesville NC 28677
PROPOSED FACILITY: SFR
PROPOSED DESIGN FLOW (.1949): 600
LOCATION OF SITE: 170 Hidden River Ln Statesville NC 28625
WATER SUPPLY: Private Public (Well) Spring Other —
EVALUATION METHOD: Auger Boring (Pit) Cut
TYPE OF WASTEWATER: (Sewage) Industrial Process Mixed

APPLICATION DATE 7/29/2023
DATE EVALUATED: 8/24/2023
PROPERTY SIZE: 5AC
PROPERTY RECORDED: Y

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	LINEAR 8-10	0-14	CL SBK	S P SE FR		50	—	—	U
		14-31	SC WSBK	VS P SE FR	MATRIX 5YR4/6				
		31-50	SC WSBK	VS P SE FR	MATRIX 10YR7/1				
					10YR 7/2 +	7/1 17"+			X
2	LINEAR 8-10	0-10	CL SBK	S P SE FR		48	—	—	U
		10-48	SC WSBK	VS P SE FR					
					10YR 7/2 +	7/1 10"+			X
3	LINEAR 12-15	0-23	C SBK	SS SP SE FR		48	—	—	PS 0.3
		23-48	CL WSBK	⊥					
					Some Litho	Incl 30"+			(R)
4	LINEAR 12-15	0-26	C ABK	SS SP SE FR		50	—	—	PS 0.3
		26-50	CL SBK	⊥					
					Litho incl throughout profile				(R)

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	500'	500'
System Type(s)	PM 25%	PM 25%
Site LTAR	0.3	0.3

OTHER FACTORS (.1946): —
SITE CLASSIFICATION (.1948): PSO.3
EVALUATED BY: S. Williams
OTHER(S) PRESENT: B. Bowkins

COMMENTS:

Updated February 2014

LEGEND

use the following standard abbreviations

LANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL .1955 LTAR*	LPP .1957 LTAR*	MINERALOGY/ CONSISTENCE	STRUCTURE
CC (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	SEXP (Slightly Expansive)	G (Single Grain)
CV (Convex Slope)		LS (Loamy Sand)			EXP (Expansive)	M (Massive)
D (Drainage Way)						CR (Crumb)
DS (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
FP (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
FS (Foot Slope)						ABK (Angular Blocky)
H (Head Slope)	III	Si (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
L (Linear Slope)		SiCL (Silty Clay Loam)				PR (Prismatic)
N (Nose Slope)		CL (Clay Loam)				
R (Ridge)		SCL (Sandy Clay Loam)			**MOIST**	**WET**
S (Shoulder Slope)		SiL (Silt Loam)				
T (Terrace)					VFR (Very Friable)	NS (Non-sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FR (Friable)	SS (Slightly Sticky)
		SiC (Silty Clay)			FI (Firm)	S (Sticky)
		C (Clay)			VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
		O (Organic)	None	None	EFI (Extremely Firm)	NP (Non-plastic)
						SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)

*Adjust LTAR due to depth, consistence, structure, soil wetness, landscape, position, wastewater flow and quality.


NOTES

HORIZON DEPTH	In inches below natural soil surface
DEPTH OF FILL	In inches from land surface
RESTRICTIVE HORIZON	Thickness and depth from land surface
SAPROLITE	S(suitable) or U(unsuitable)
SOIL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
CLASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

Evaluation of saprolite shall be by pits.

Long-term Acceptance Rate (LTAR): gal/day/ft^2

Show profile locations and other site features (dimensions, reference or benchmark, and North).

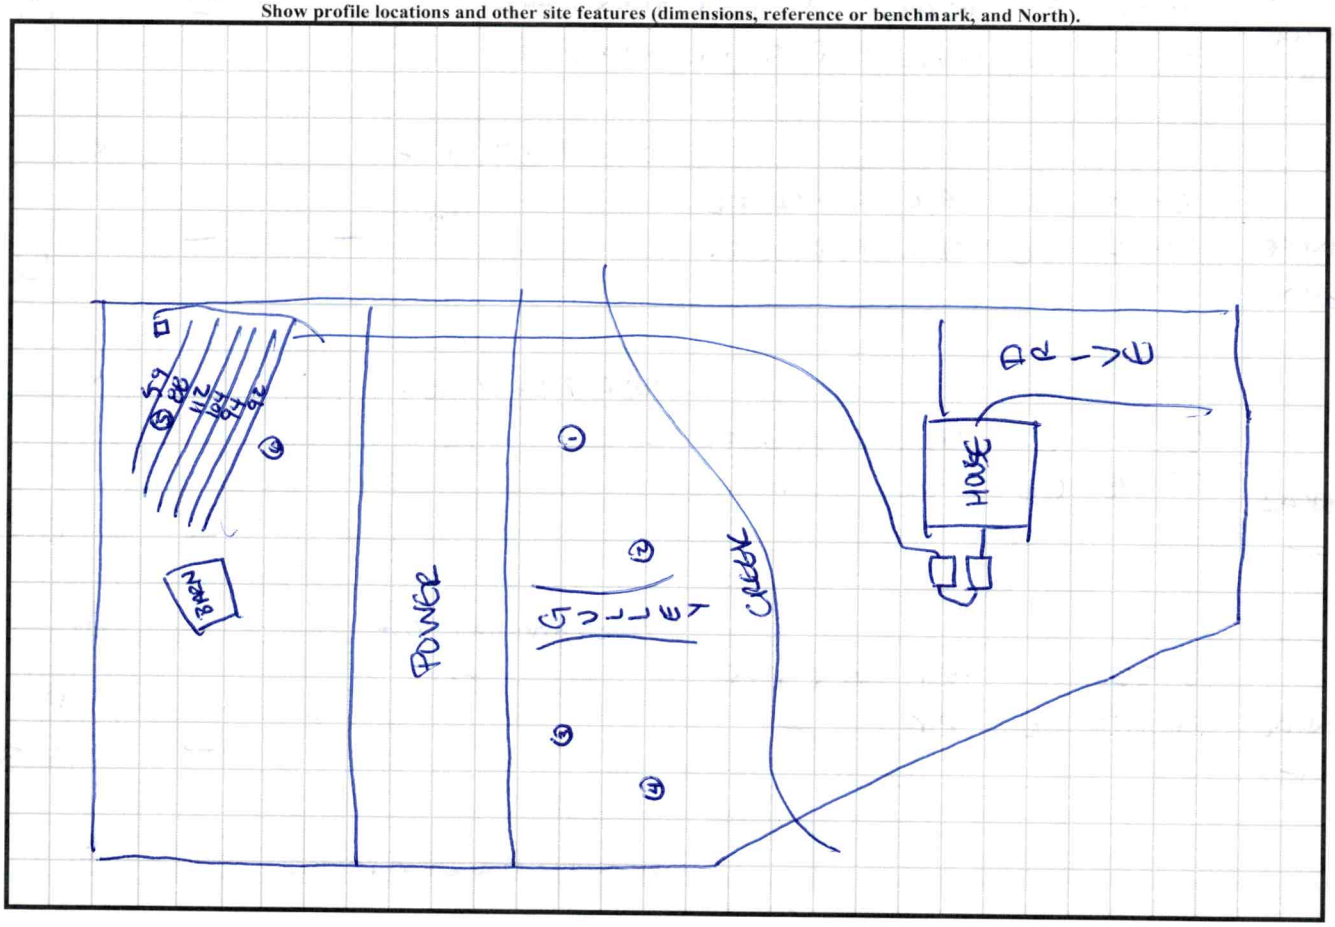

SOIL/SITE EVALUATION

(Continuation Sheet-Complete all field in full)

DEPARTMENT OF HEALTH AND HUMAN SERVICES
DIVISION OF PUBLIC HEALTH
ENVIRONMENTAL HEALTH SECTION
ON-SITE WATER PROTECTION BRANCH

PROPERTY ID #: 4718-92-3722
DATE OF EVALUATION: 8/24/2023
COUNTY: IREDELL

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
5	LINEAR 12-15	0-8	CL SBK	SS SP SE FR	MATRIX 2.5YR 3/4	48	–	–	PS 0.3
		8-36	C ABK	↓					
		36-48	CL SBK						
6	LINEAR 12-15	0-6	CL SBK	SS SP SE FR	MATRIX 2.5YR 3/6	48	–	–	PS 0.3
		6-33	C ABK	↓					
		33-48	CL SBK						

COMMENTS: _____