
ATTACHMENT TO P.D.# 176815

TAX MAP # 4720053442

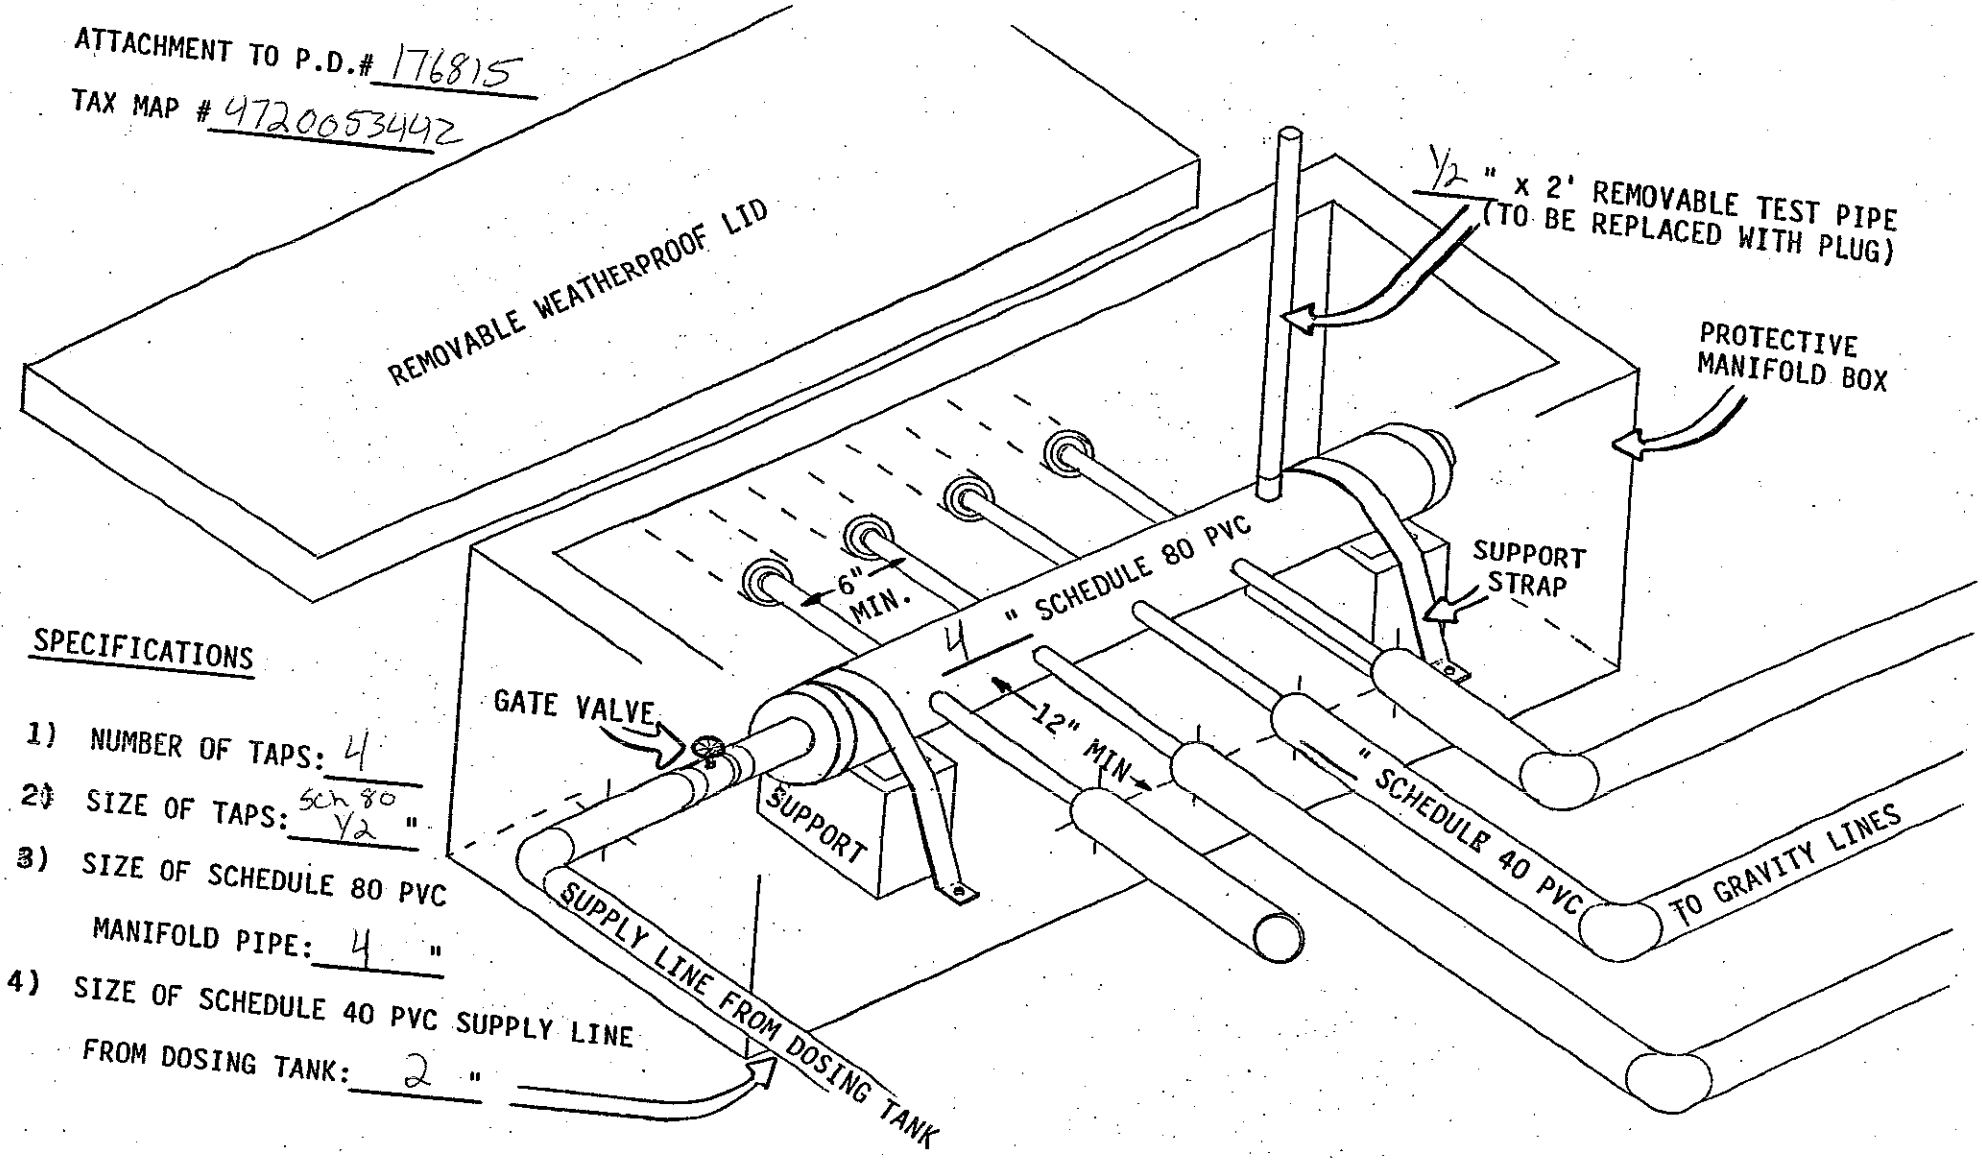

SPECIFICATIONS

1) NUMBER OF TAPS: 4

2) SIZE OF TAPS: Sch 80 1/2 "


3) SIZE OF SCHEDULE 80 PVC MANIFOLD PIPE: 4 "

4) SIZE OF SCHEDULE 40 PVC SUPPLY LINE FROM DOSING TANK: 2 "

PUMP TANK DESIGN

ATTACHMENT TO PROPERTY DESCRIPTION # 176815

TAX MAP # 472 0053442

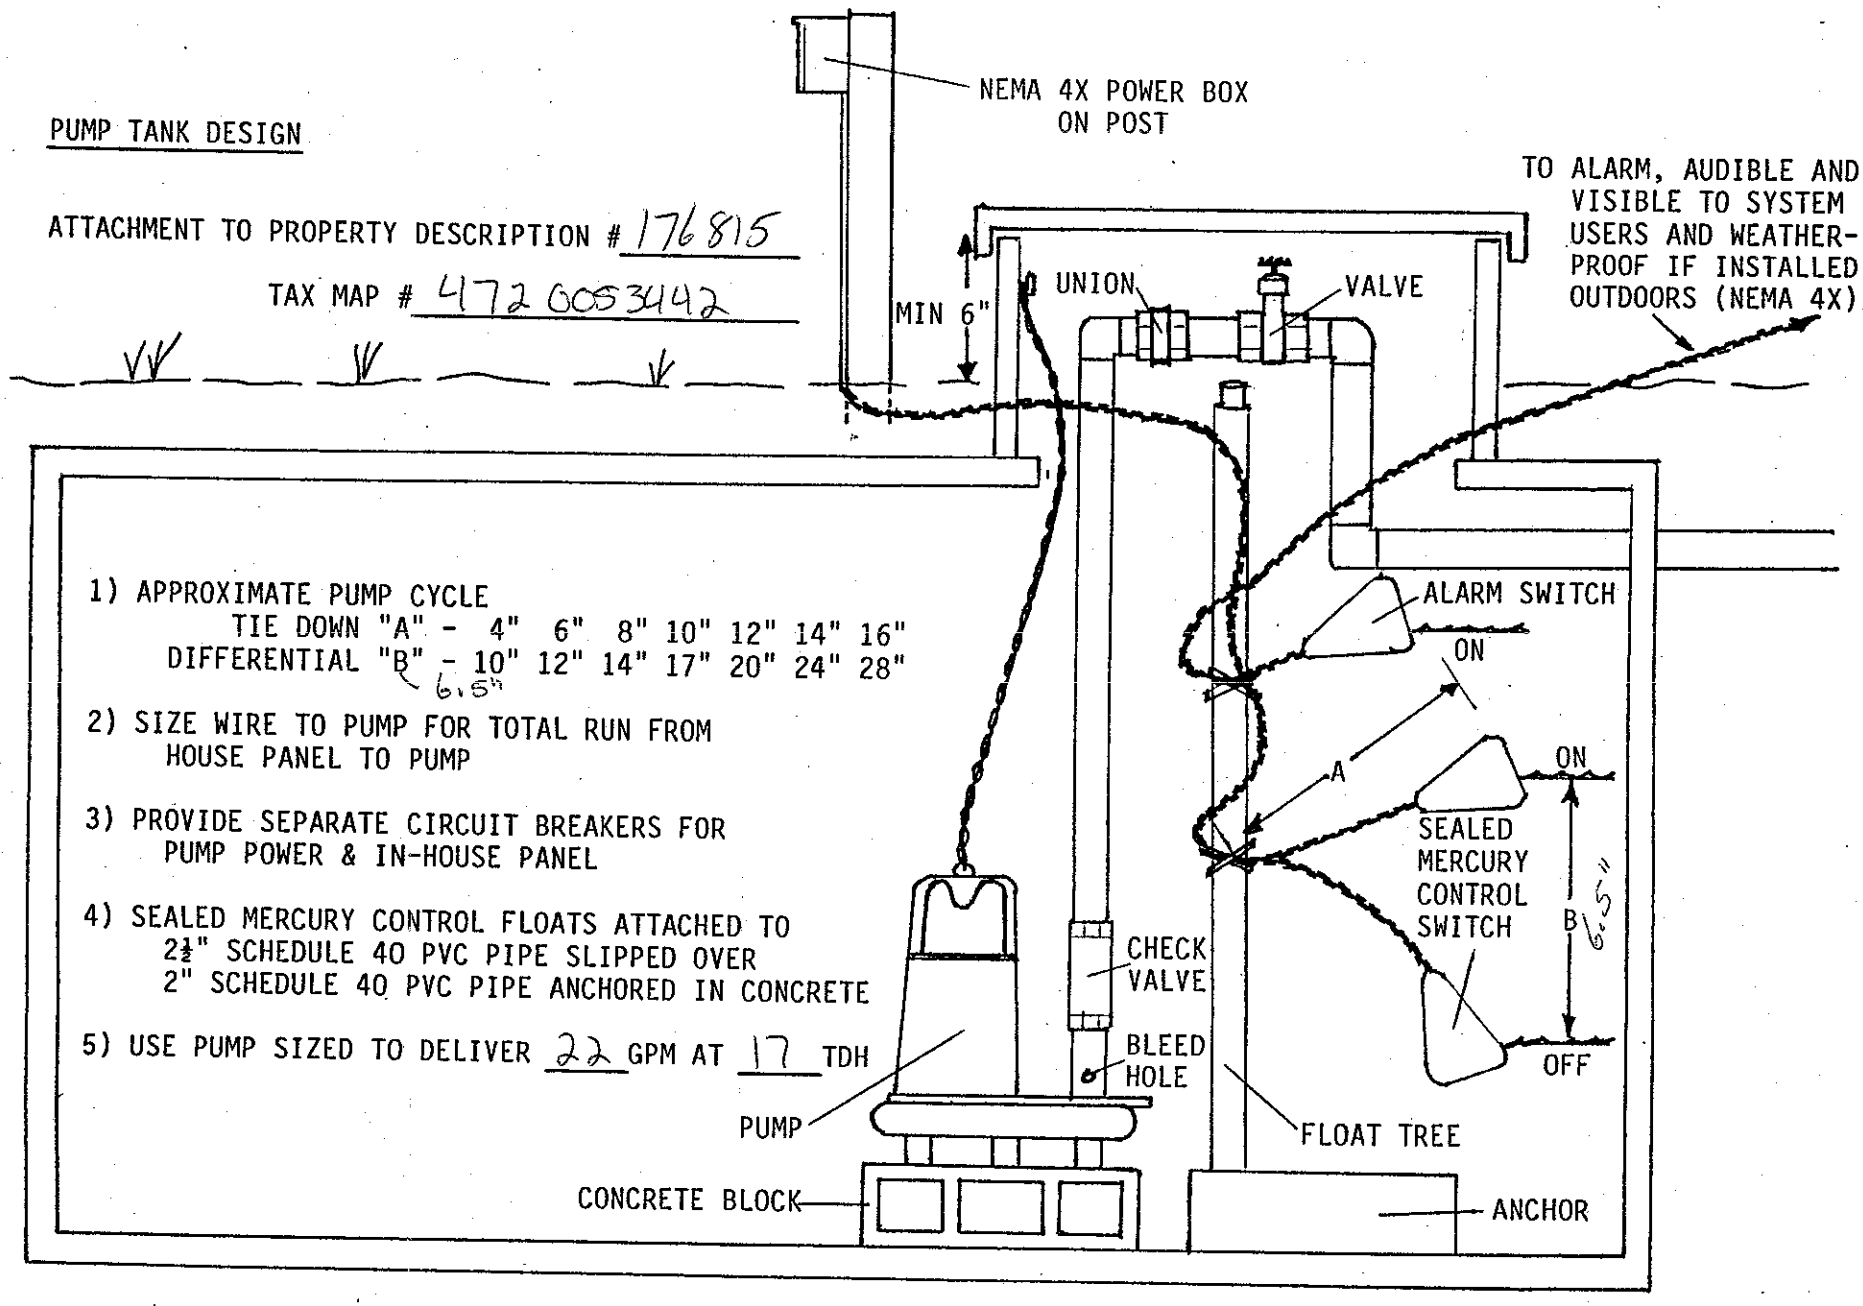

1) APPROXIMATE PUMP CYCLE
   TIE DOWN "A" - 4" 6" 8" 10" 12" 14" 16"
   DIFFERENTIAL "B" - 10" 12" 14" 17" 20" 24" 28"
   6.5"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO
   2½" SCHEDULE 40 PVC PIPE SLIPPED OVER
   2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

5) USE PUMP SIZED TO DELIVER 22 GPM AT 17 TDH