IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Mountain Rd. Baptist Church DATE 5/25/77 PERMIT NO. ______

PHONE: Business ______ Home ______


LOCATION Old Mountain road just below Kyles X Rd - T.R. on Rd #1335 - Church on Rt. at Rd 1453 S. R. No. ______

SUBDIVISION NAME ______ LOT NO. ______ SECTION OR BLOCK NO. ______

House ( ) Mobile Home ( ) Business ( ) Other Church

No. Bedrooms ______ No. Bathrooms 3
Garbage Disposal Unit Yes ( ) No ( )
Auto. Dishwasher Yes ( ) No ( )
Auto. Wash. Machine Yes ( ) No ( )
Site Suitable Yes ( ) No ( )
Lot Area ______

Character & Porosity of Soil Cecil Clay
Percolation Rate ______
Topography Slight Slope
Depth to Water Table Low
Rock or other impervious formations None

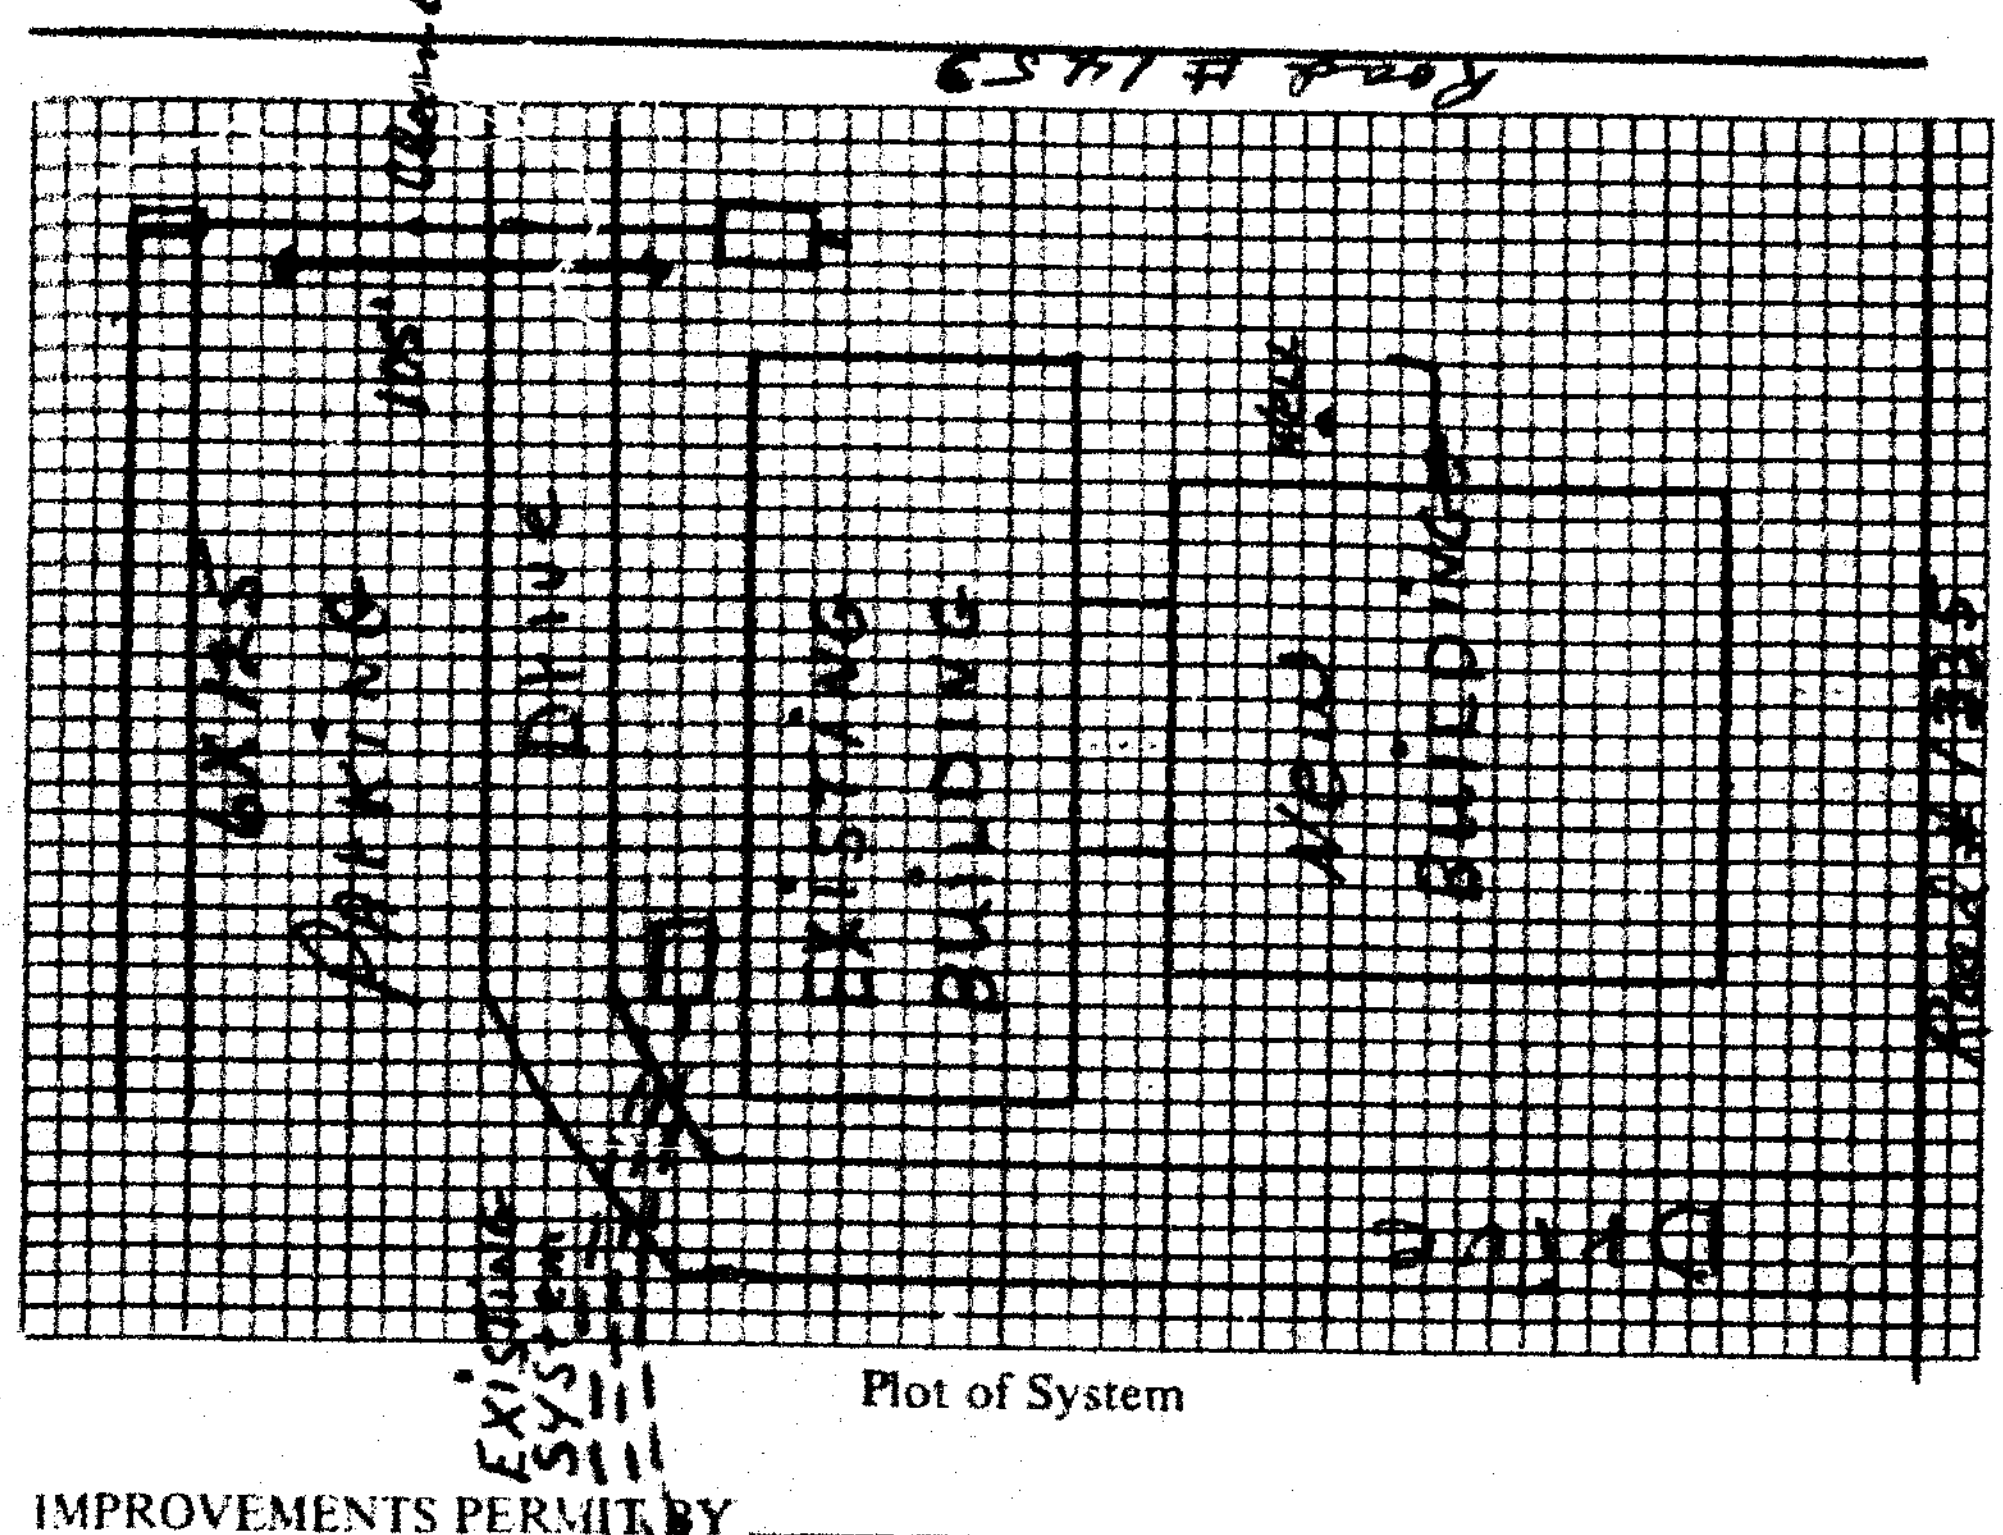

Plot of System

Size of Tank 1250 Gals.
Nitrification Field:
No. of Lines 2
Sq. Ft. 750 Linear Ft. 250
Depth of Stone in Lines 10"
Water Supply: Individual (✓)
Public ( )

Installed by Hoke Septic Tank Co

IMPROVEMENTS PERMIT BY ______

COMMENTS: Heavy Duty P.V.C. used from septic Tank to distribution box.

CERTIFICATE OF COMPLETION BY E. A. Stevenson DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold