IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR LAWRENCE HOLTON DATE 8-28-81 PERMIT NO. ______

PHONE: Business ______ Home ______

LOCATION 64-70 west - mobile home behind Holton's Airport Rd. grocery - across from Harley Dawson place.

S. R. No. ______

SUBDIVISION NAME ______ LOT NO. ______ SECTION OR BLOCK NO. ______

House ( ) Mobile Home (✓) Business ( ) Other ______


No. Bedrooms 2 No. Bathrooms 1

Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes ( ) No (✓)
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes (✓) No ( )

Lot Area Ample

Character & Porosity of Soil: ferial gravelly clay
Percolation Rate: .6 gal/sq. ft.
Topography: 2-6%
Depth to Water Table: 10+
Rock or other impervious formations: none observed.

___ Basement with Plumbing ___ Basement without Plumbing ✓ No Basement

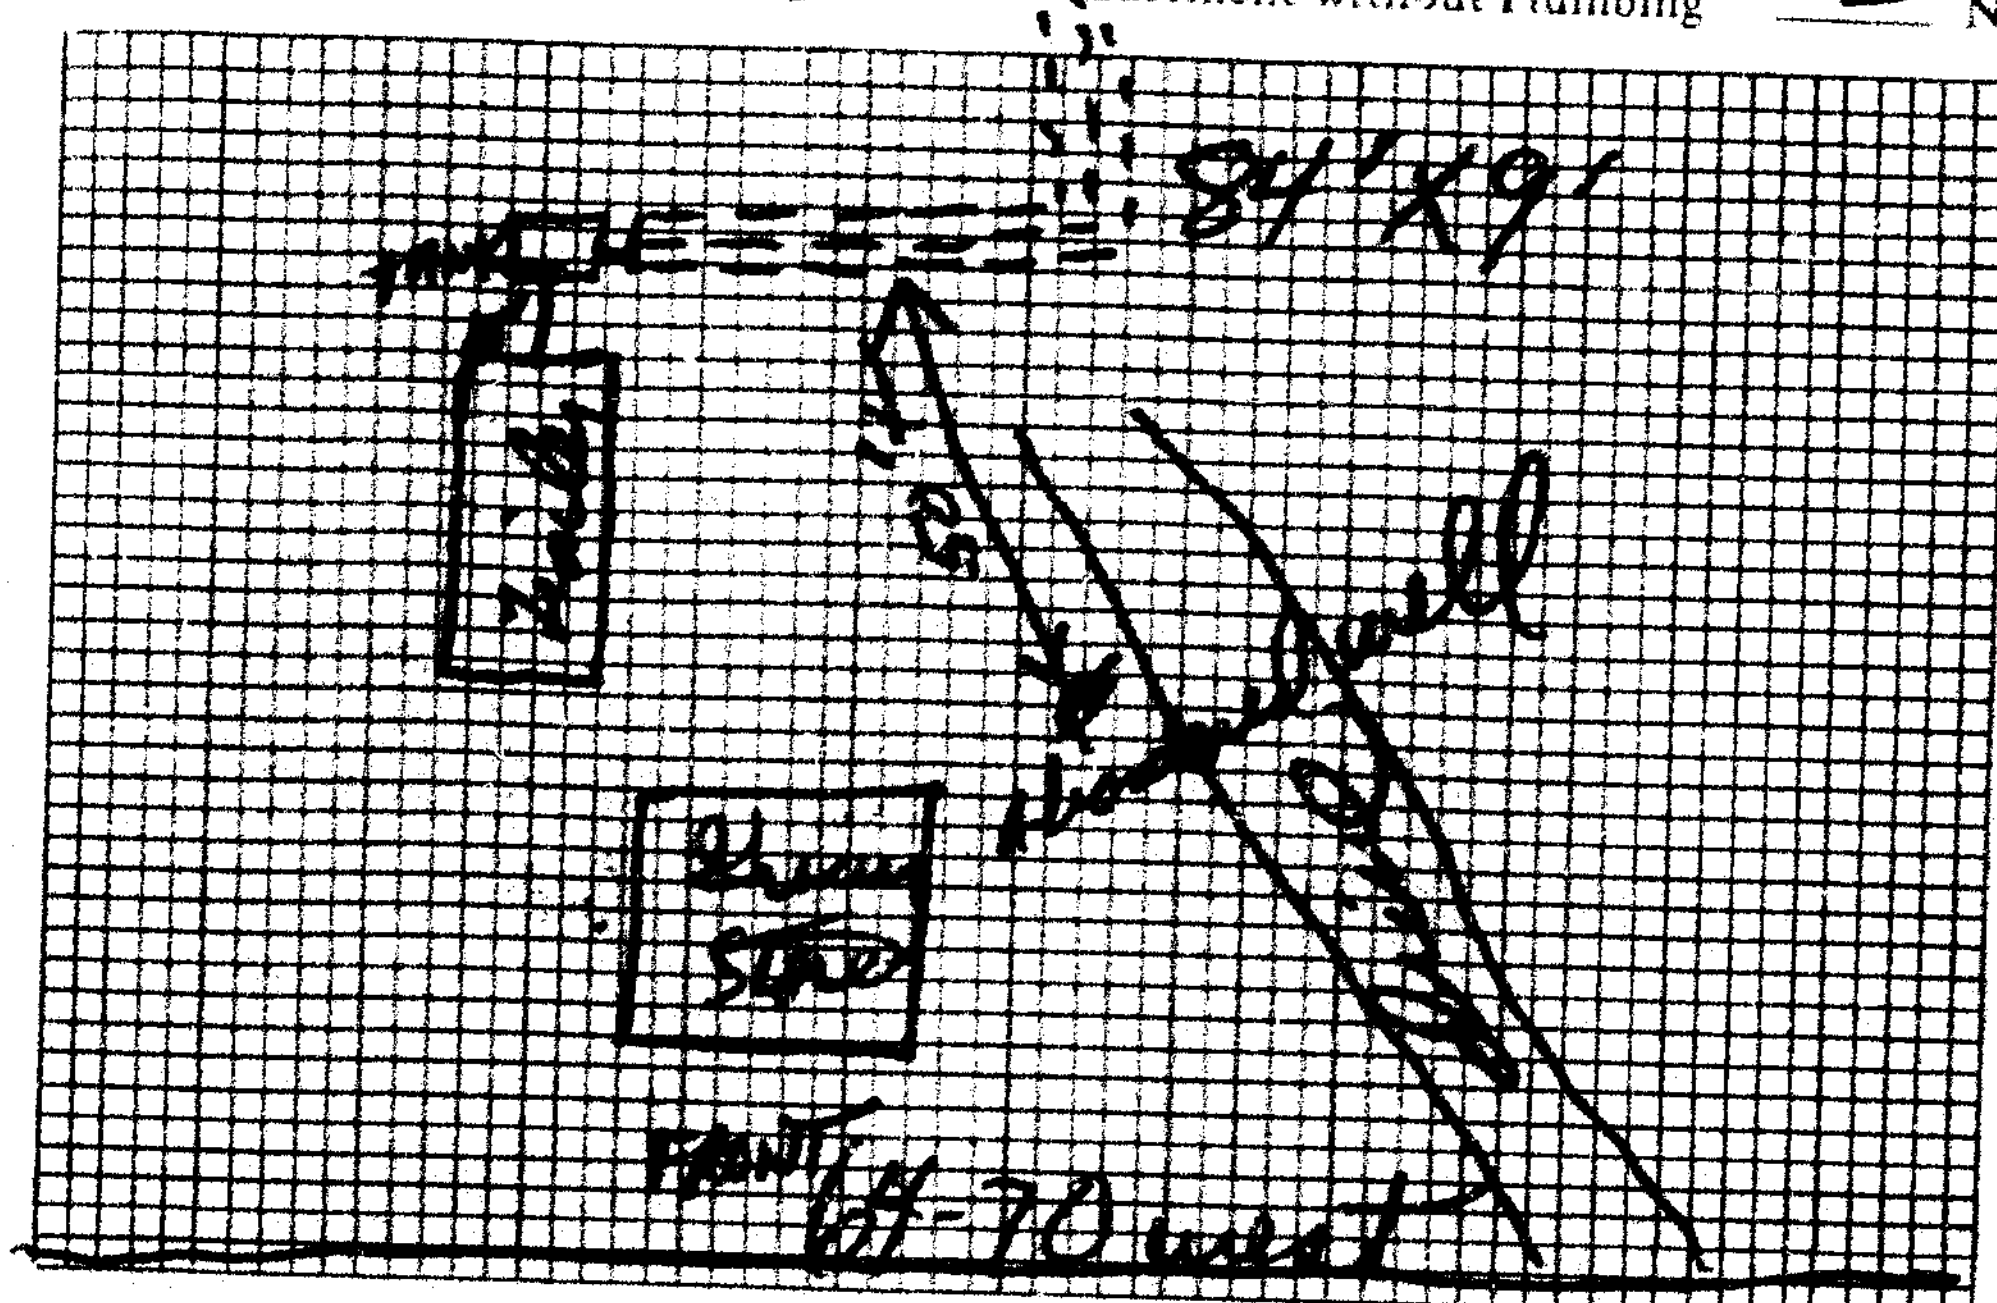

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 3
Sq. Ft. 750 Linear Ft. 250
Depth of Stone in Lines 16"

Water Supply: Individual ( )
Public (✓)

Installed by James Hartness

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ______

IMPROVEMENTS PERMIT BY Steve Brown

COMMENTS: ______

CERTIFICATE OF COMPLETION BY Steve Brown DATE 8-28-81

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.
Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold