
PRESSURE MANIFOLD DESIGN

ATTACHMENT TO P.D.# STATESVILLE

~~TAX MAP #~~ STERRILL EST. II #18

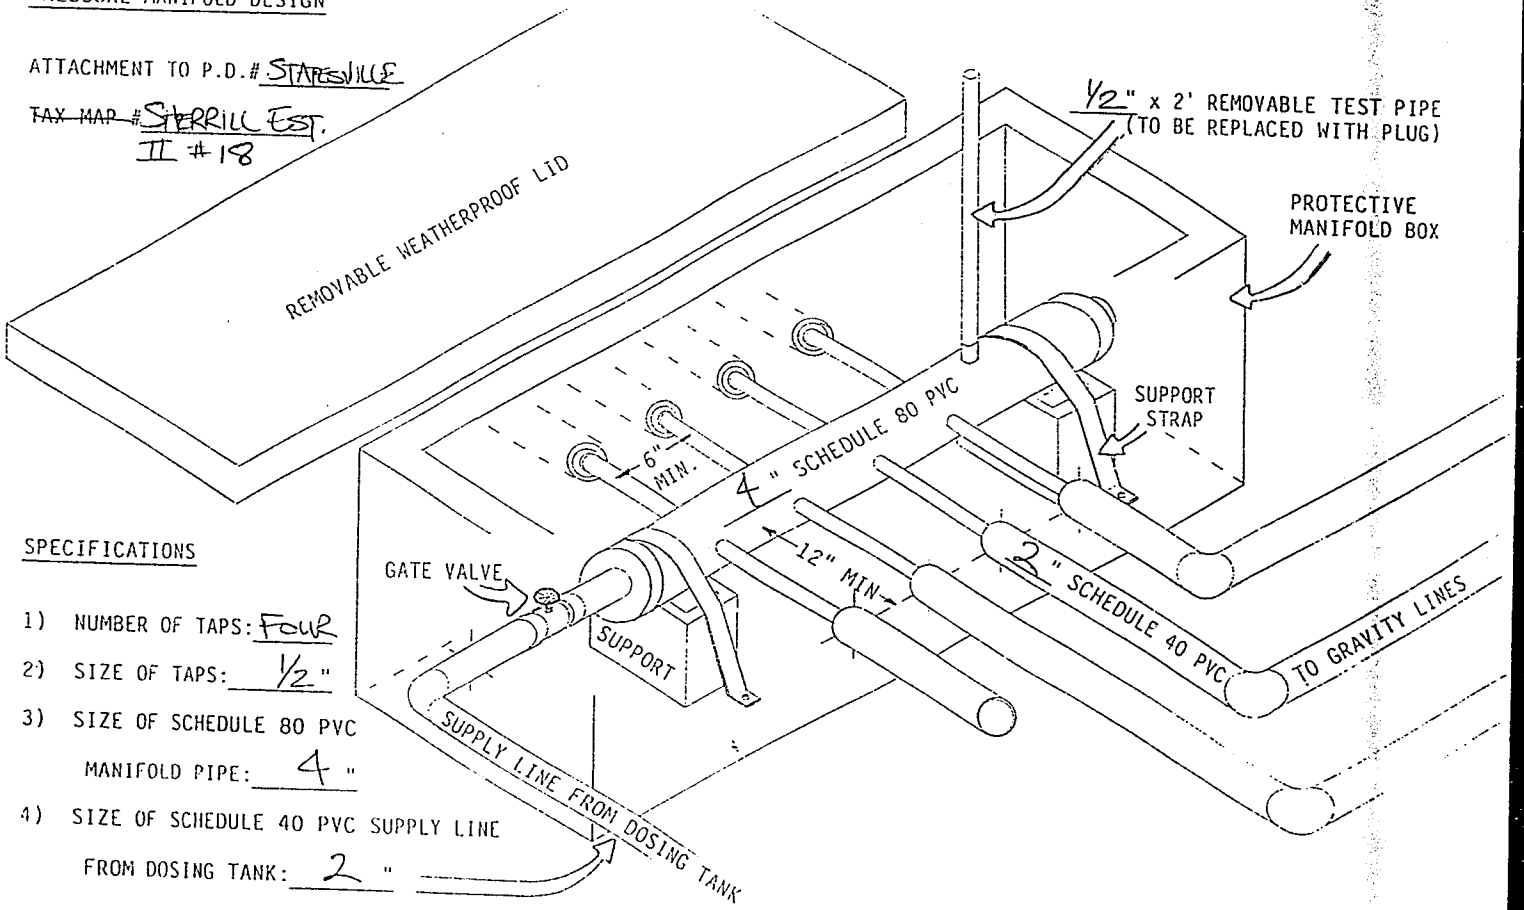

SPECIFICATIONS

1) NUMBER OF TAPS: FOUR
2) SIZE OF TAPS: ½"
3) SIZE OF SCHEDULE 80 PVC MANIFOLD PIPE: 4"
4) SIZE OF SCHEDULE 40 PVC SUPPLY LINE FROM DOSING TANK: 2"