
ATTACHMENT #1
FRANK DAY, JR.
NC 90 W

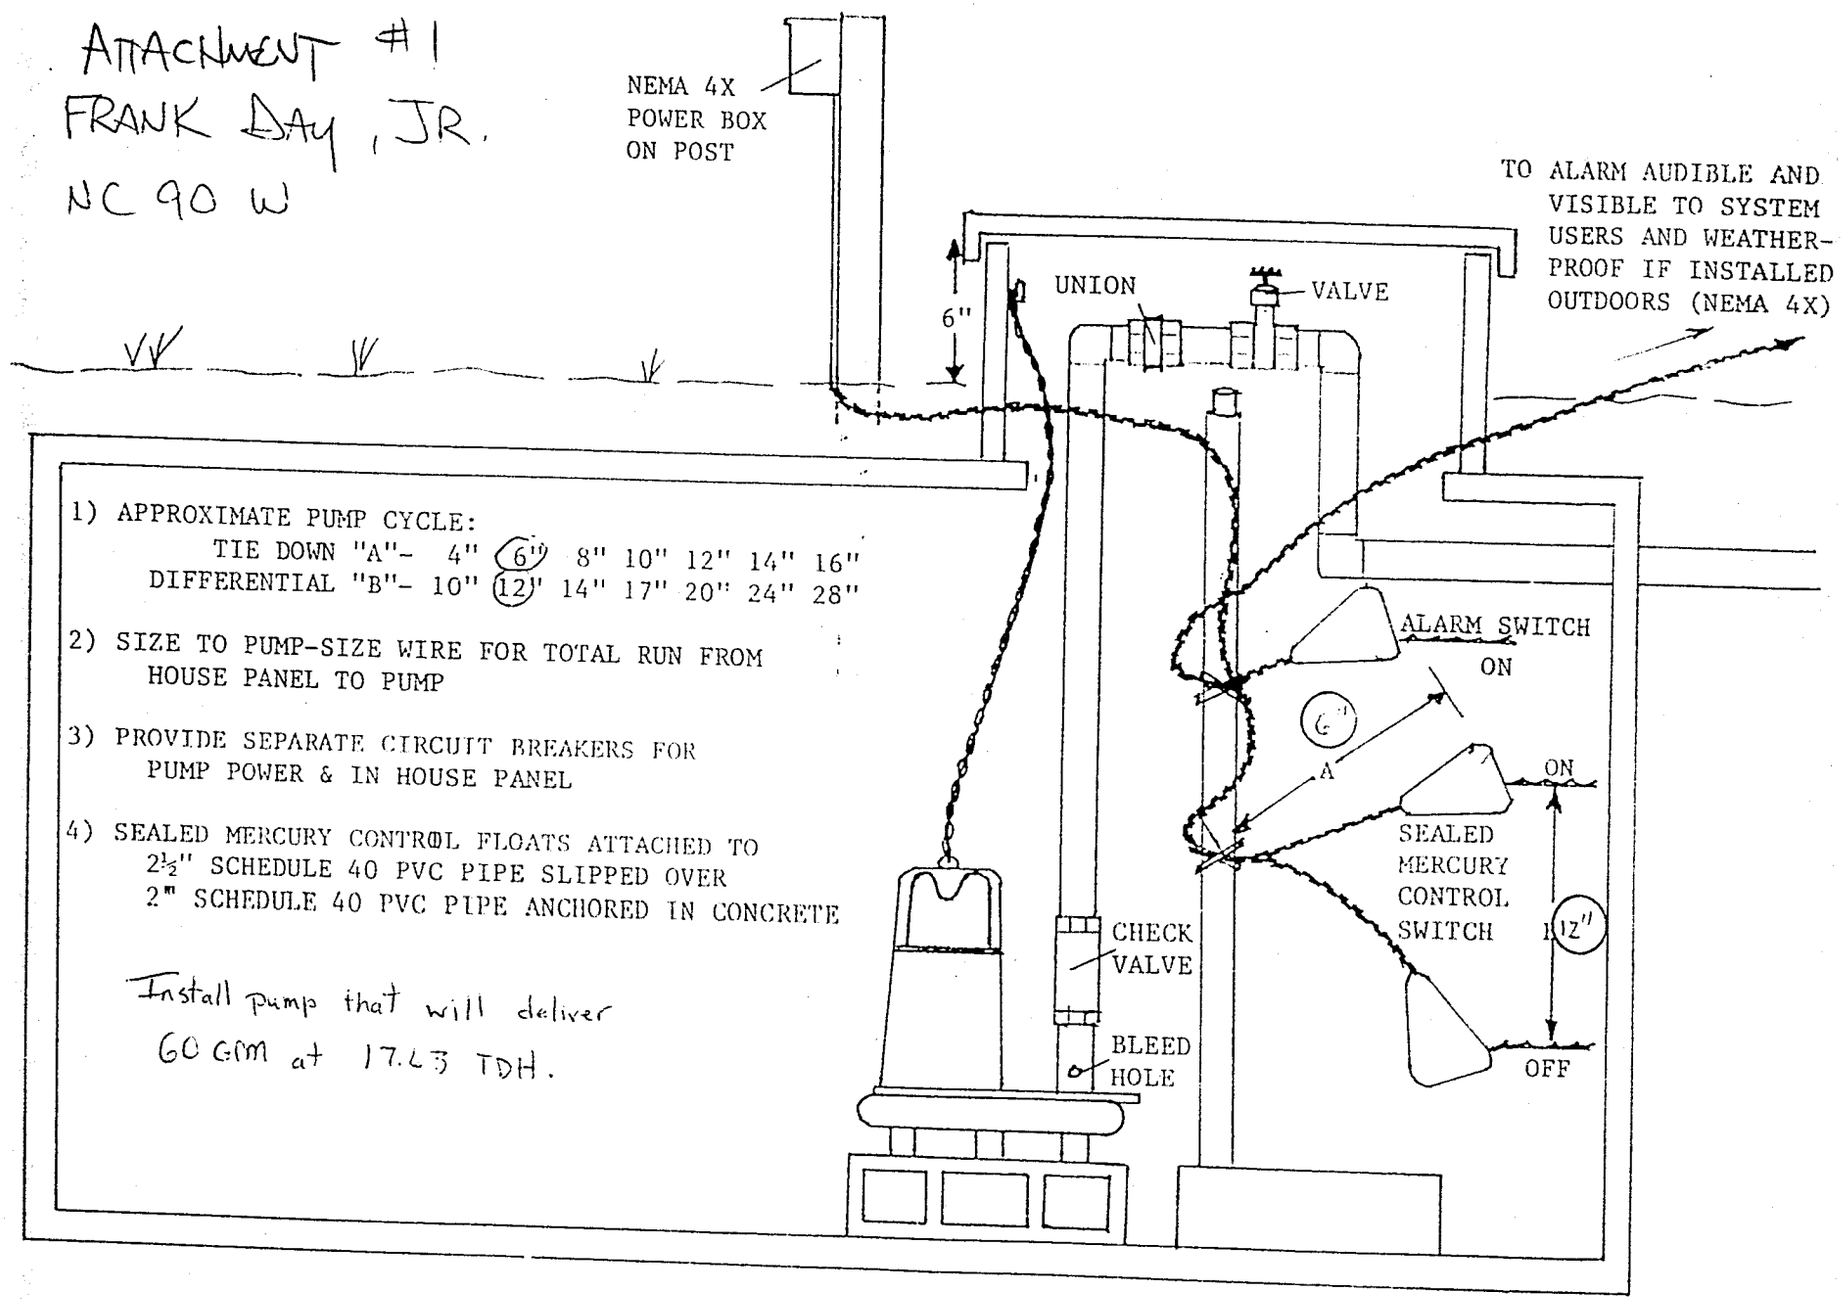

1) APPROXIMATE PUMP CYCLE:
   TIE DOWN "A"- 4" (6") 8" 10" 12" 14" 16"
   DIFFERENTIAL "B"- 10" (12") 14" 17" 20" 24" 28"

2) SIZE TO PUMP-SIZE WIRE FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

Install pump that will deliver 60 GPM at 17.63 TDH.

- PUMP TANK DESIGN -