
PUMP TANK DESIGN

TWIN CREEKS II #58/58A

ATTACHMENT TO PROPERTY DESCRIPTION # 148883

TAX MAP # 4730-46-2033

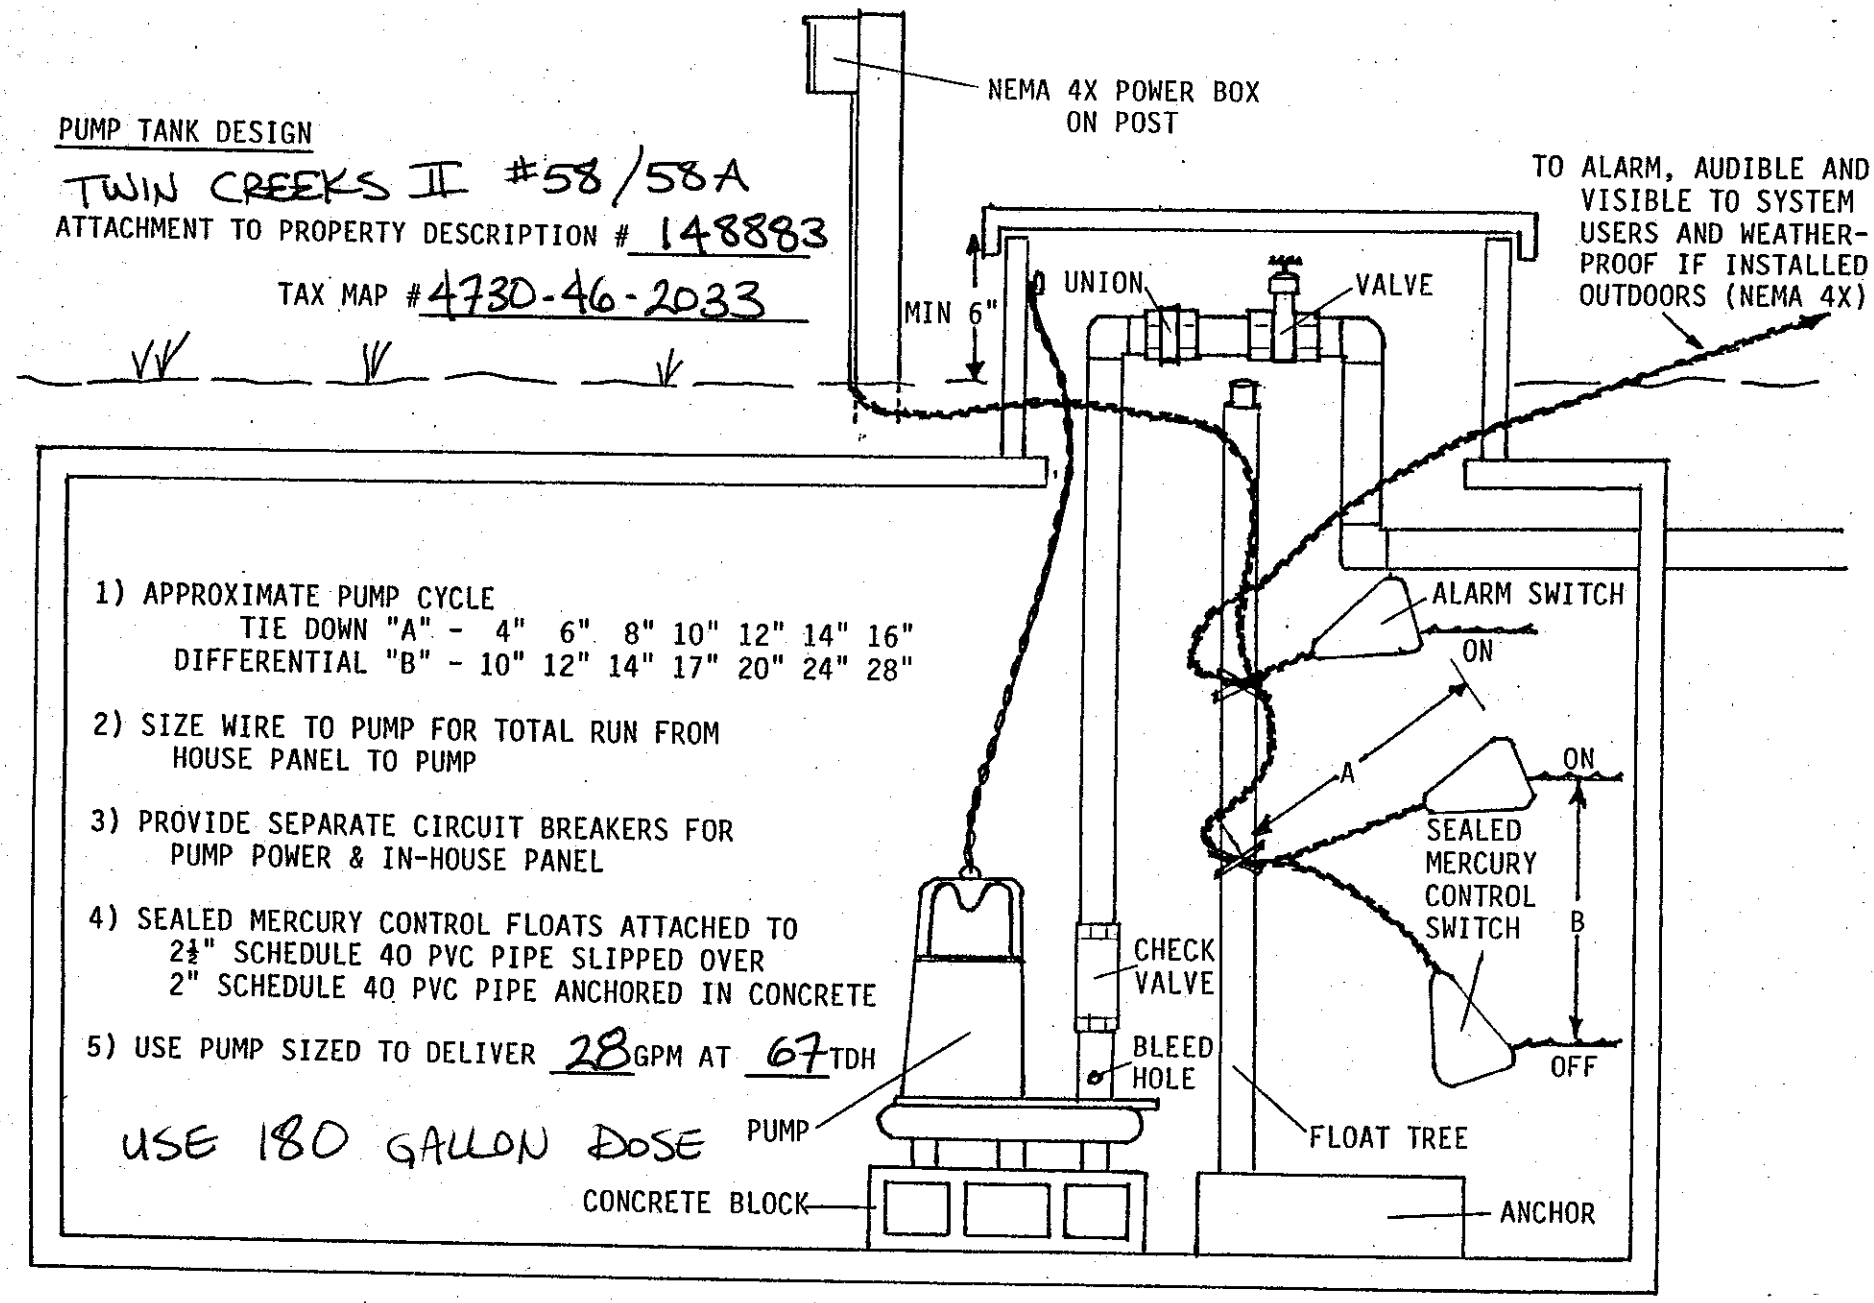

1) APPROXIMATE PUMP CYCLE
   TIE DOWN "A" - 4" 6" 8" 10" 12" 14" 16"
   DIFFERENTIAL "B" - 10" 12" 14" 17" 20" 24" 28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

5) USE PUMP SIZED TO DELIVER 28 GPM AT 67 TDH


USE 180 GALLON DOSE

PRESSURE MANIFOLD DESIGN

TWIN CREEKS II #58/58A

ATTACHMENT TO P.D.# 148883

TAX MAP # 4730-46-2033

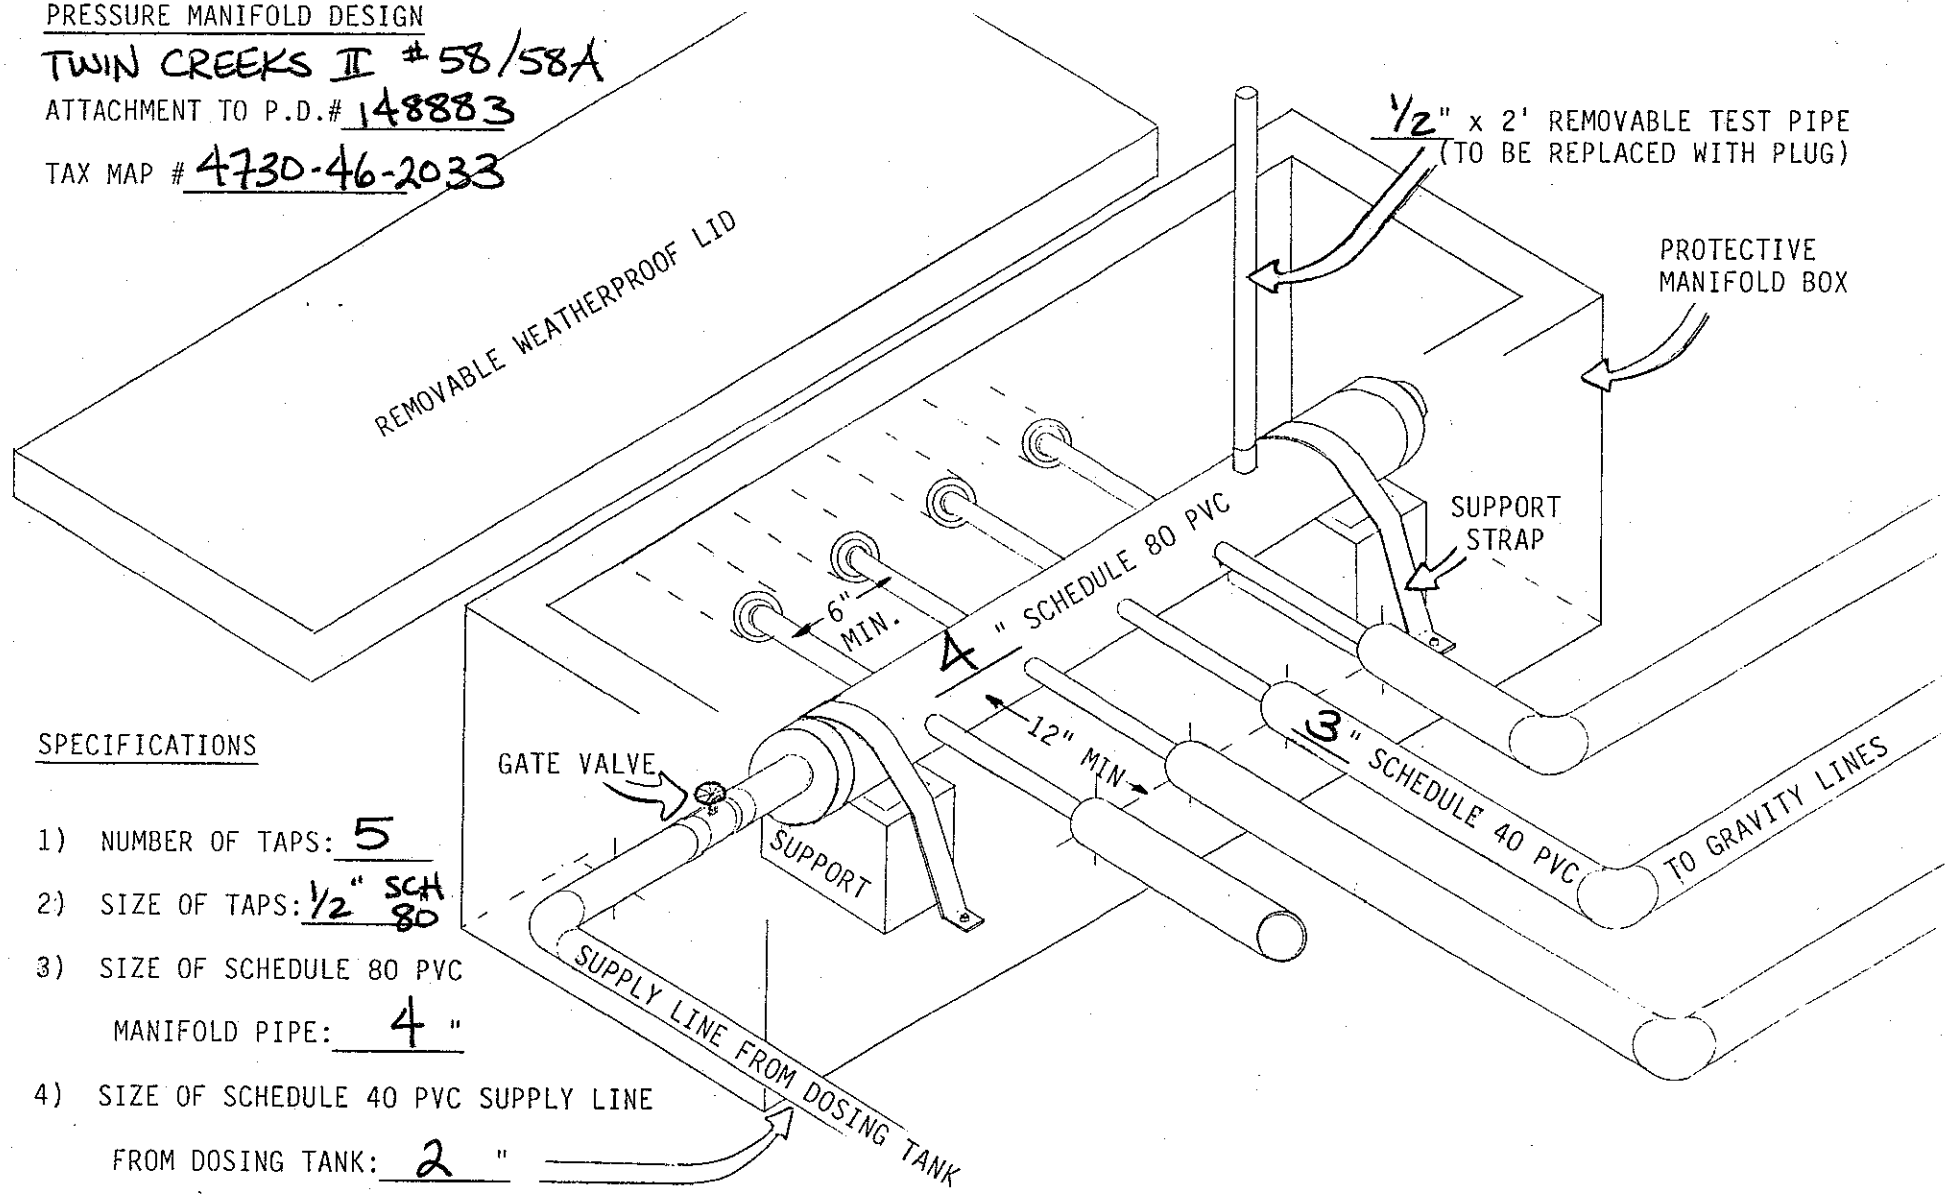

SPECIFICATIONS

1) NUMBER OF TAPS: 5

2) SIZE OF TAPS: ½" SCH 80

3) SIZE OF SCHEDULE 80 PVC MANIFOLD PIPE: 4 "


4) SIZE OF SCHEDULE 40 PVC SUPPLY LINE FROM DOSING TANK: 2 "

PUMP TANK DESIGN

TWIN CREEKS II #58/58A

ATTACHMENT TO PROPERTY DESCRIPTION # 148883

TAX MAP # 4730-46-2033

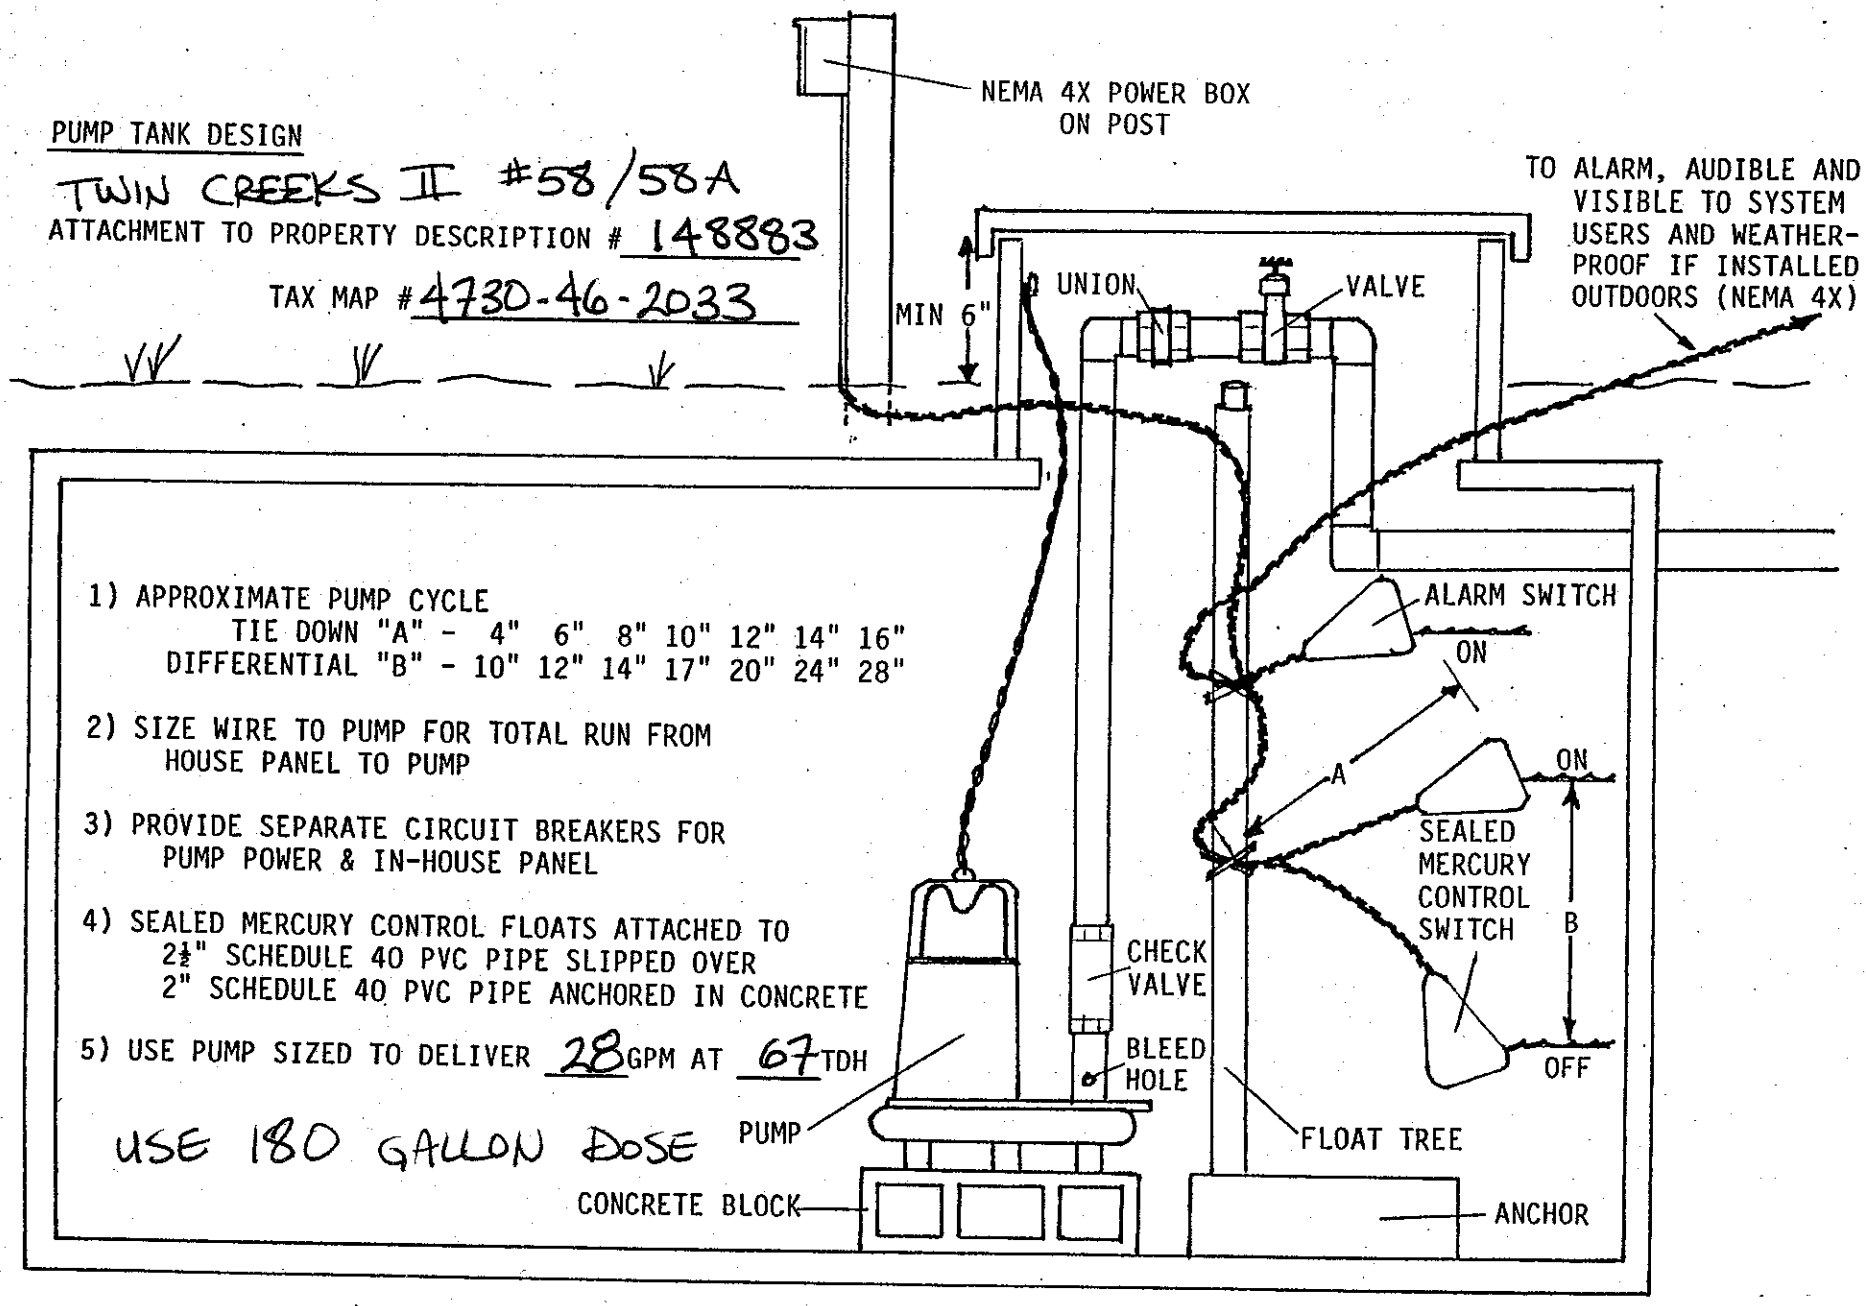

1) APPROXIMATE PUMP CYCLE
   TIE DOWN "A" - 4" 6" 8" 10" 12" 14" 16"
   DIFFERENTIAL "B" - 10" 12" 14" 17" 20" 24" 28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

5) USE PUMP SIZED TO DELIVER 28 GPM AT 67 TDH


USE 180 GALLON DOSE

PRESSURE MANIFOLD DESIGN

TWIN CREEKS II #58/58A

ATTACHMENT TO P.D.# 148883

TAX MAP # 4730-46-2033

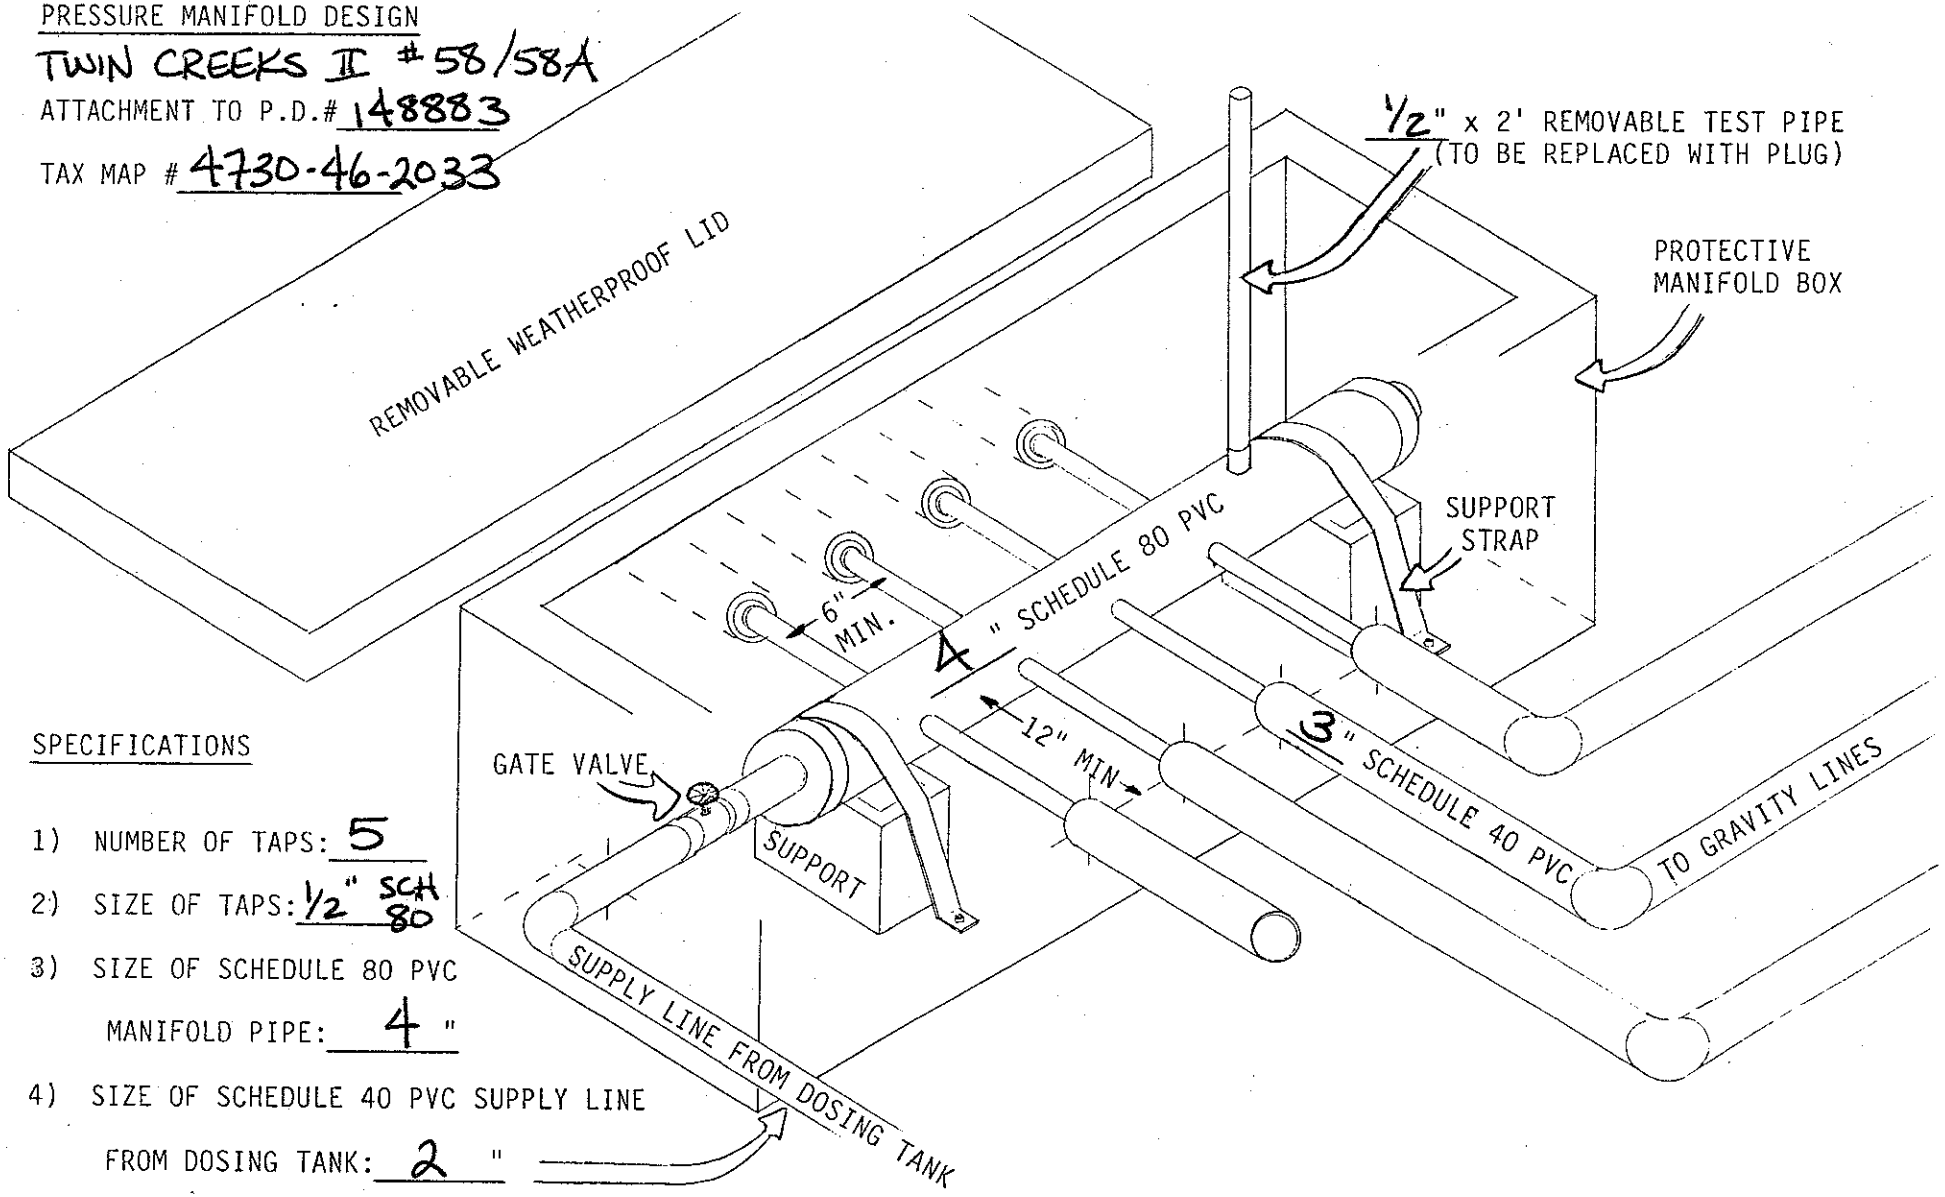

SPECIFICATIONS

1) NUMBER OF TAPS: 5

2) SIZE OF TAPS: ½" SCH 80

3) SIZE OF SCHEDULE 80 PVC MANIFOLD PIPE: 4 "

4) SIZE OF SCHEDULE 40 PVC SUPPLY LINE FROM DOSING TANK: 2 "