
PUMP TANK DESIGN

ATTACHMENT TO PROPERTY DESCRIPTION # 13473

TAX MAP # 473046 9227

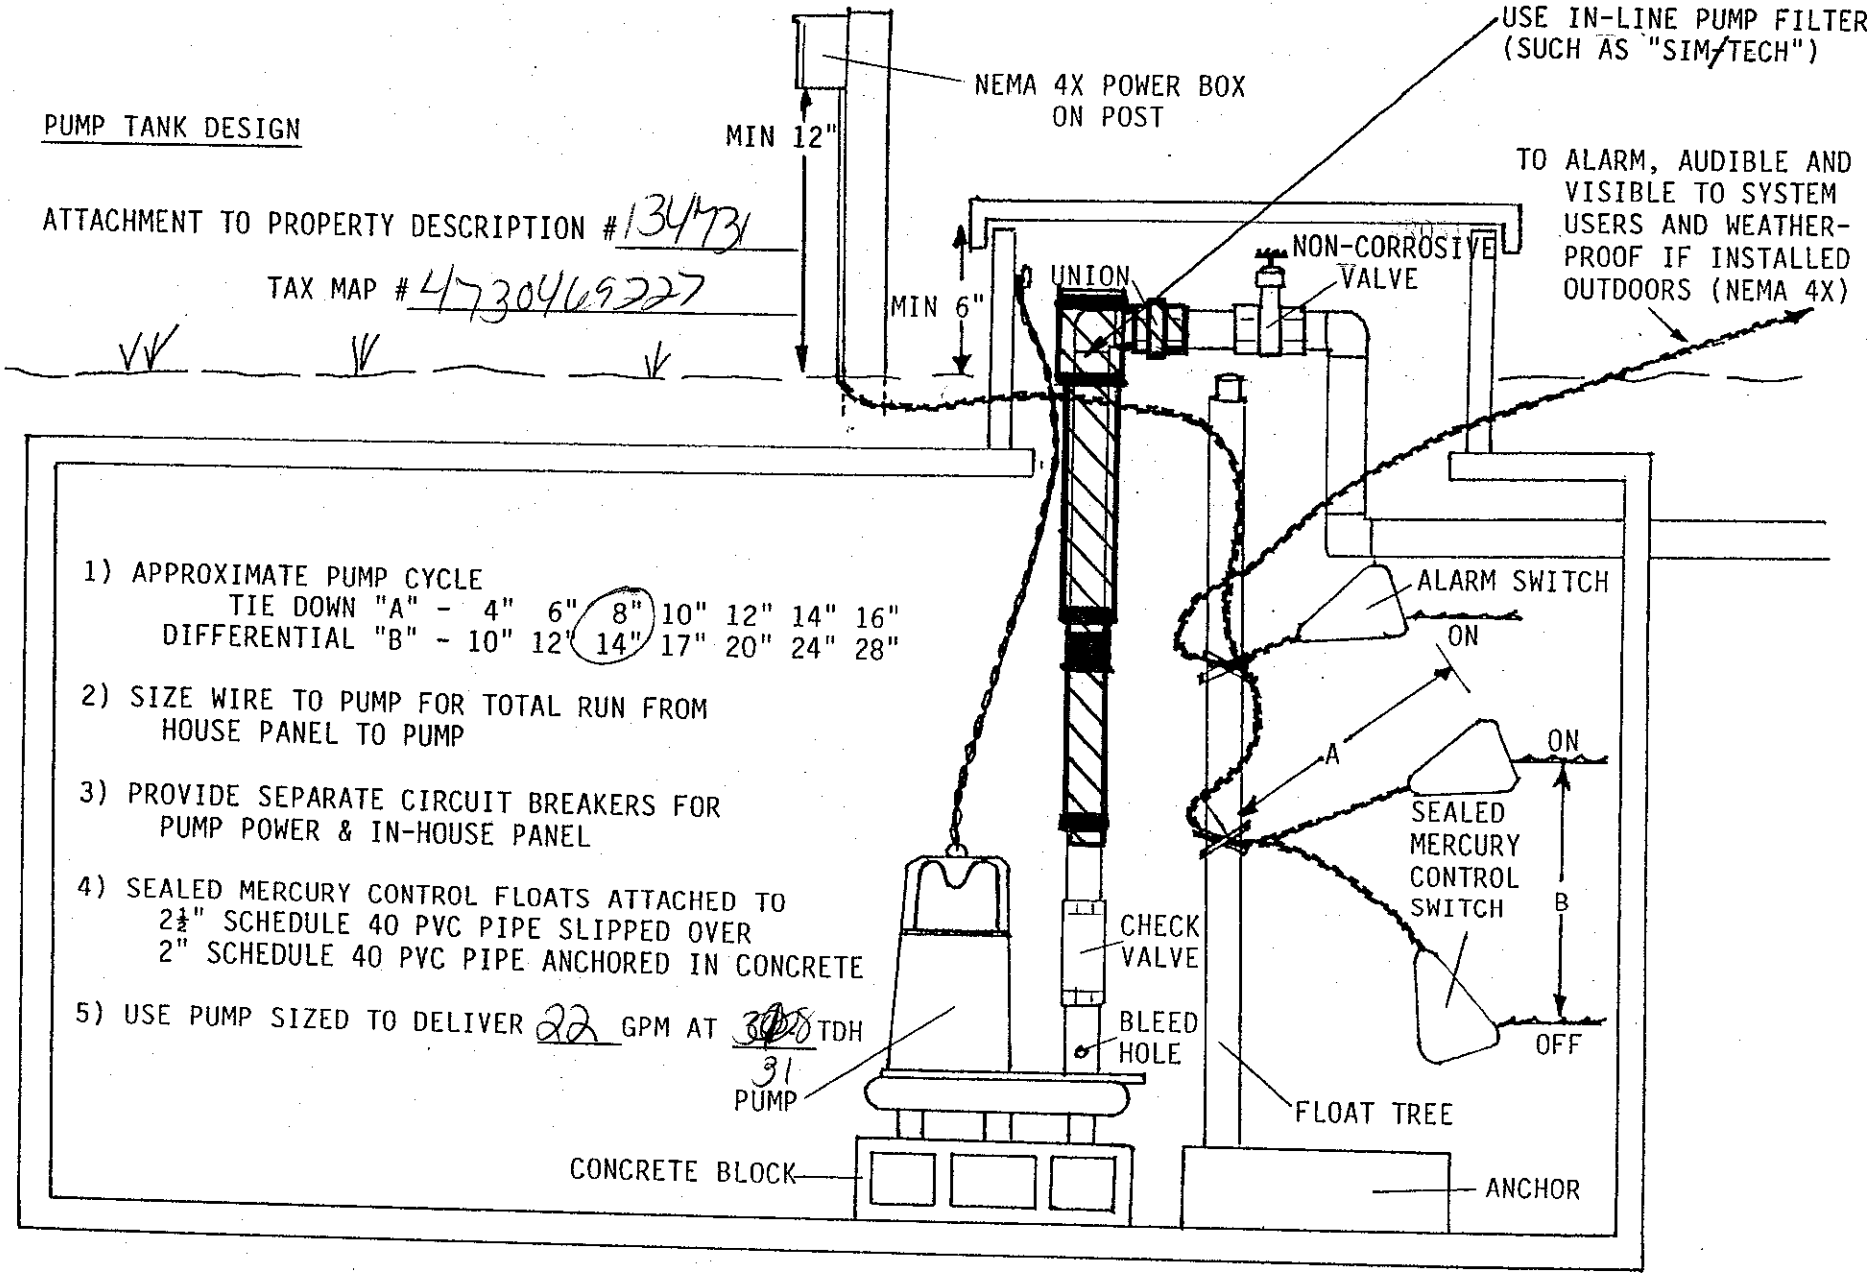

1) APPROXIMATE PUMP CYCLE


TIE DOWN "A" -	4"	6"	(8")	10"	12"	14"	16"
DIFFERENTIAL "B" -	10"	12"	(14")	17"	20"	24"	28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

5) USE PUMP SIZED TO DELIVER 22 GPM AT ~~300~~ 31 TDH

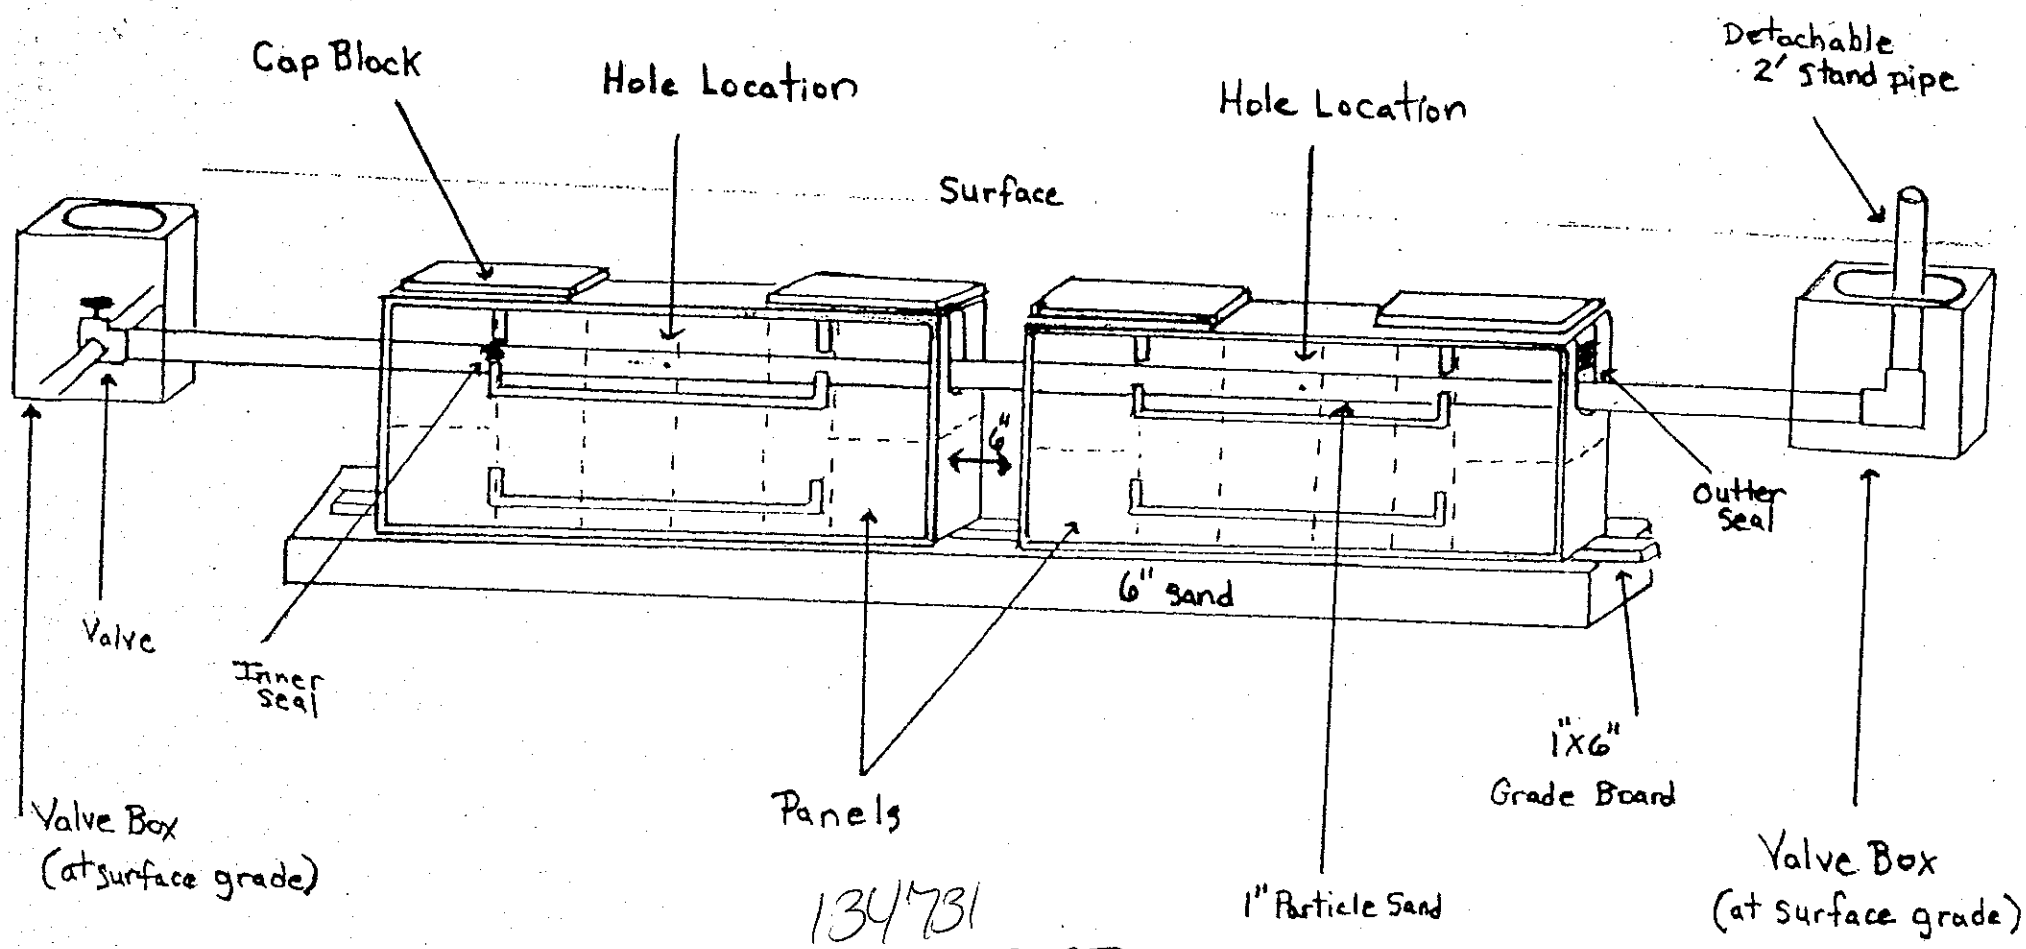

134731
4736469227

Pressure Dosed PPBPS

# of panels 48.
Size holes 5/32. 1 hole per panel.
Approximate amount of sand needed 34.
100 lbs. of partical sand per 8 panels.
Sidewalls raked and limed.
GPM 22.
TDH 31.

Comments