IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR JERRY HAGER DATE 8-8-83 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION Perth Ch. Rd. from Troutman, T.R. on St. Lark Rd, T.L. at Bruce Metals, then T.L. on St. paving, go to intersection – house straight across rd. S. R. No. _____

SUBDIVISION NAME _____ LOT NO _____ SECTION OR BLOCK NO. _____


House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2-3

Garbage Disposal Unit	Yes ( )	No (✓)	Character & Porosity of Soil	sandy clay
Auto. Dishwasher	Yes (✓)	No ( )	Percolation Rate	4 gal/sq. ft.
Auto. Wash. Machine	Yes (✓)	No ( )	Topography	2-6%
Site Suitable	Yes (✓)	No ( )	Depth to Water Table	10'+
			Rock or other impervious formations	none observed.

Lot Area Ample

(✓) Basement with Plumbing ( ) Basement without Plumbing ( ) No Basement

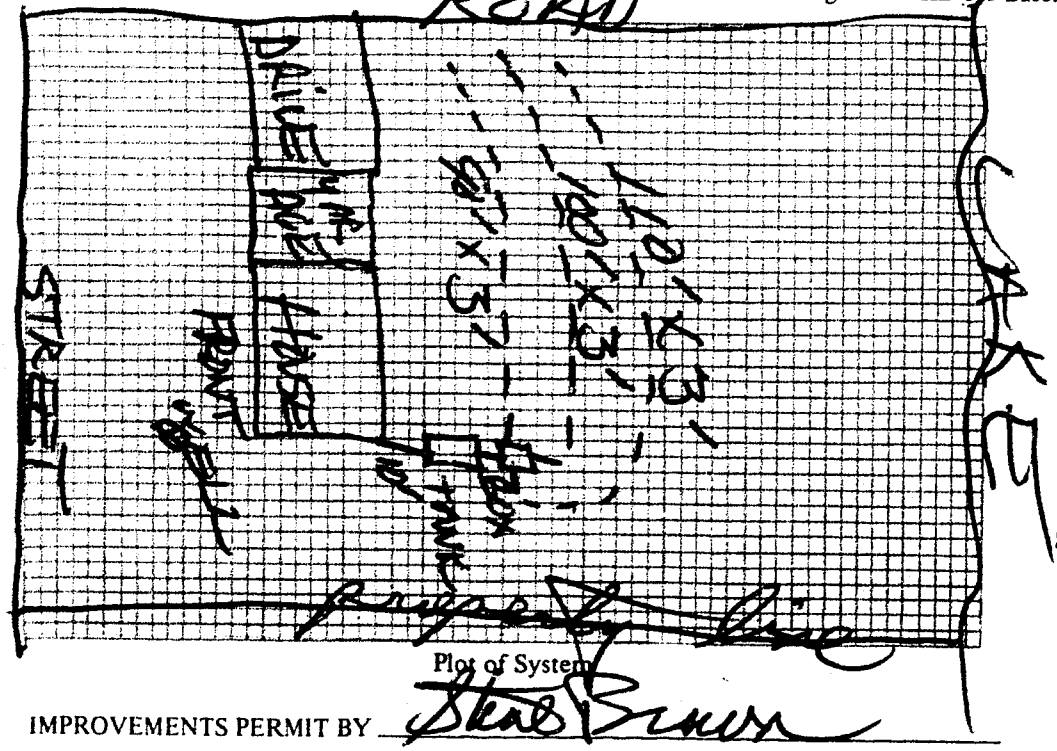

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 3
Sq. Ft. 900 Linear Ft. 300
Depth of Stone in Lines 12"

Water Supply: Individual (✓)
Public ( )

Installed by Jim + Jerry Lackey

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY Steve Brown

COMMENTS: _____

CERTIFICATE OF COMPLETION BY Steve Brown DATE 8-8-83

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold