Blanton + Moore
Repair


use Simplex Panel with Built In Alarm

Ball valve

PUMP TANK DESIGN

ATTACHMENT TO PROPERTY DESCRIPTION #_____

TAX MAP #_____

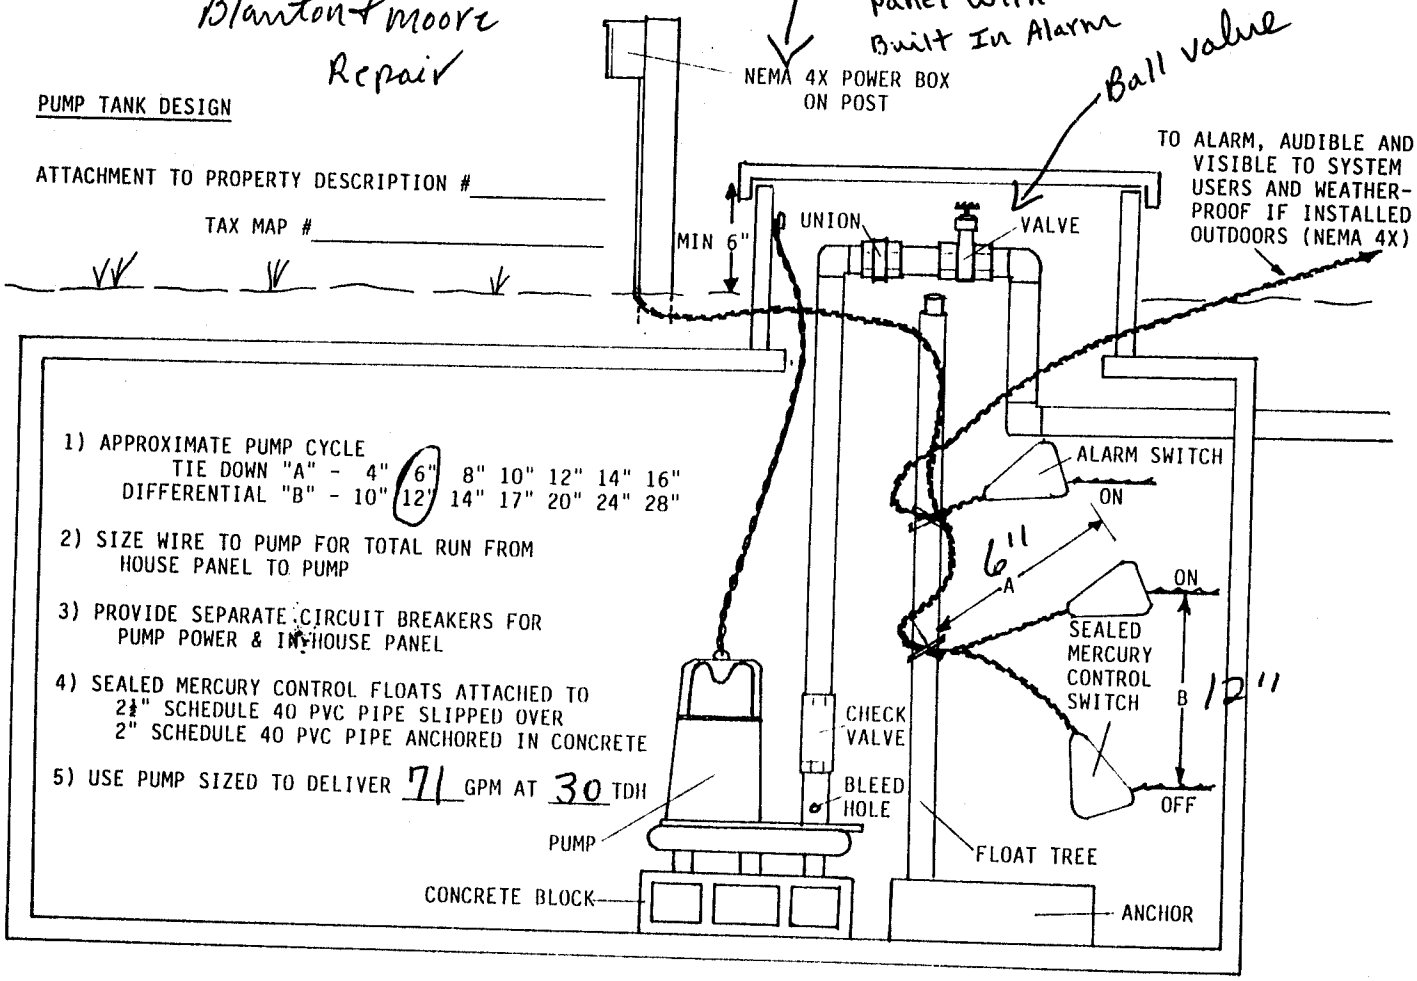

1) APPROXIMATE PUMP CYCLE
TIE DOWN "A" - 4" (6") 8" 10" 12" 14" 16"
DIFFERENTIAL "B" - 10" (12") 14" 17" 20" 24" 28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO
2½" SCHEDULE 40 PVC PIPE SLIPPED OVER
2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

5) USE PUMP SIZED TO DELIVER 7 GPM AT 30 TDH