Lou Eginhardt


Meadow Oaks #113

Attachment "A"

PUMP TANK DESIGN

ATTACHMENT TO PROPERTY DESCRIPTION # 106616

TAX MAP # 4735-38-4966

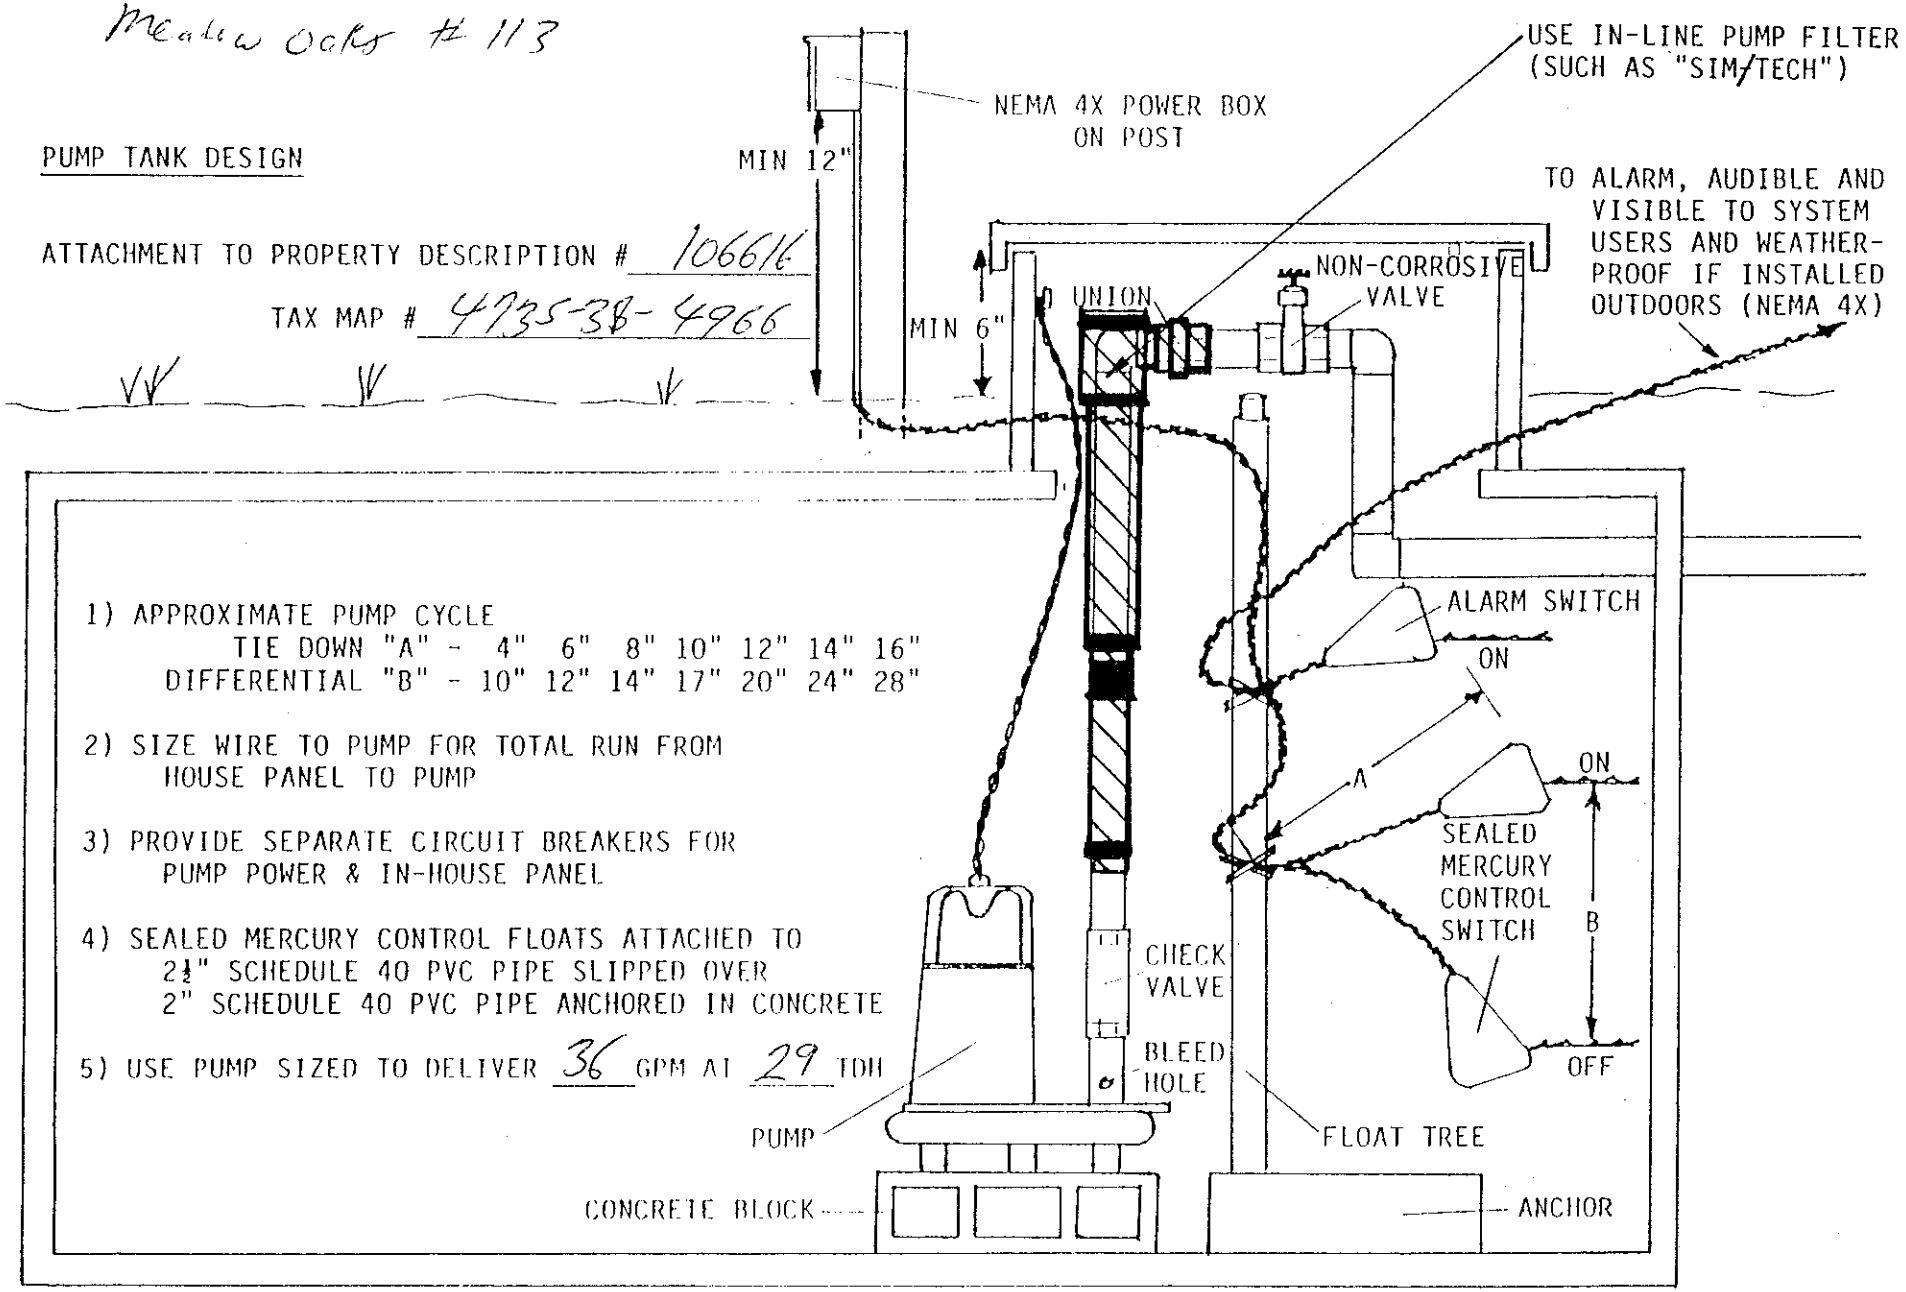

1) APPROXIMATE PUMP CYCLE
   TIE DOWN "A" - 4" 6" 8" 10" 12" 14" 16"
   DIFFERENTIAL "B" - 10" 12" 14" 17" 20" 24" 28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL


4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

5) USE PUMP SIZED TO DELIVER 36 GPM AT 29 TDH

Lou Eckhardt

Meadow Oaks #113

Attachment "B"

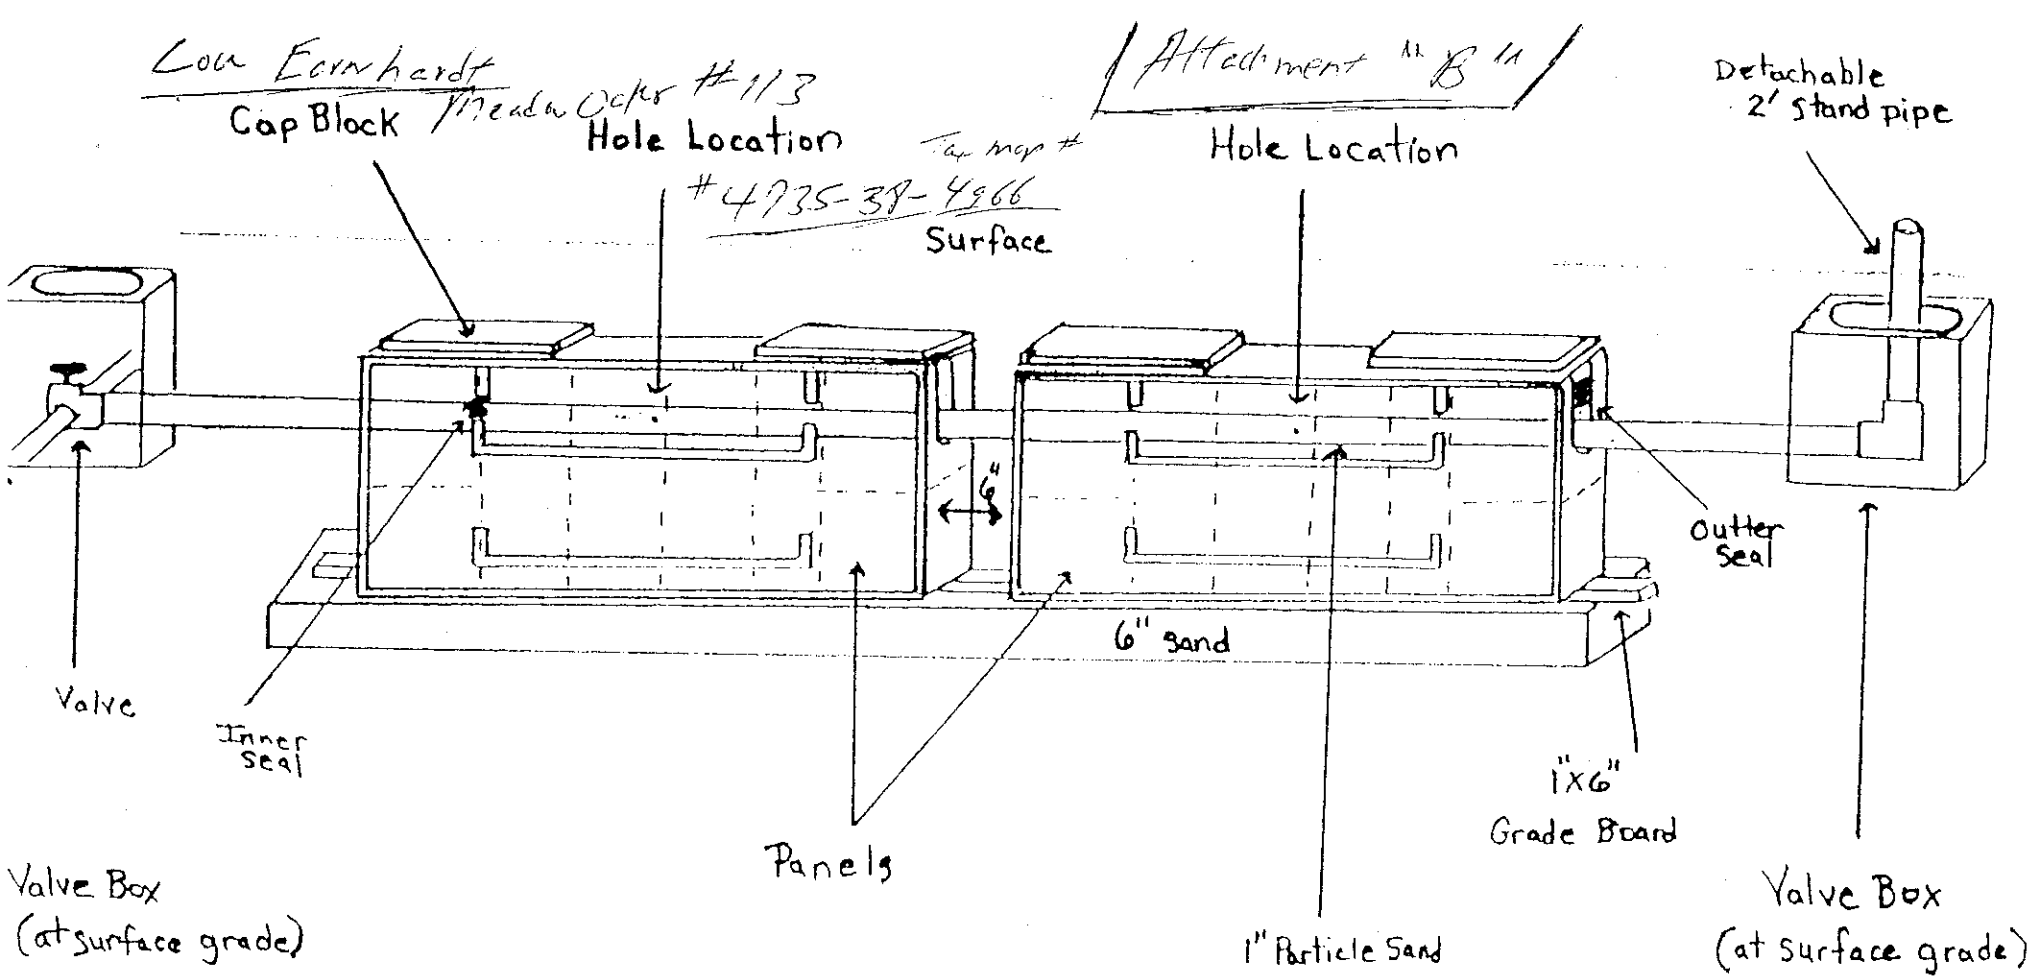

Pressure Dosed PPBPS

# of panels 62.

Size holes 3/16. 1 hole per panel.

Approximate amount of sand needed 45 tons

100 lbs. of partical sand per 8 panels.

Sidewalls raked and limed.

GPM 36.

TDH 29.

Comments