C1

IREDELL COUNTY HEALTH DEPARTMENT

STATESVILLE 704-878-5305 MOORESVILLE 704-664-5281

IMPROVEMENT PERMIT / AUTHORIZATION TO CONSTRUCT / OPERATION PERMIT / EXISTING SYSTEM INSPECTION

PERMIT# 146693 PIN# 4736-02-3984 DATE 20 November 07

OWNER OR APPLICANT Darrell C. Jones PHONE: Business 704-902-9016 Home

ADDRESS 179 Gilead Ln. Statesville NC

LOCATION South Creek Rd. TR Old Wilkesboro Rd TL First left

SUBDIVISION Brandy's Acres BLOCK / SECTION LOT 5 LOT AREA 0.47 SITE CLASS. PS DESIGN FLOW 240gpd L.T.A.R. 0.3 gpd/ft²

Septic Tank: 1000 g Gallons: STB 1007 Date 10-10-07

Pump Tank: 1000 Gallons: P.T 274 Date 10-10-07

Pump Make: BJU-963 HP 1 Model Zoeller Serial No.

Nitrification Field: No Fields 1 Square Feet Endeo Linear Feet 300

No Lines 3 Trench Width 36 Max Trench Bottom Depth 36" Gravel Depth ☐ Gravity ☑ Pressure ☐ Slab ☑ Crawl Space ☐ Basement w/plumbing ☐ Basement wo/plumbing

☑ New System ☐ Repair ☐ Expansion System Type: I II III IV V VI

System Description: 3.52 Reduction pump

Repair System Description: 2.52 Reduction pump

Maintenance Agreement Required: ☐ Yes ☑ No

☐ House/Mod. Home No. Bedrooms 2

☑ Mobile Home No. Persons

☐ Business No. Employees

☐ Other

Water Supply: ☐ Individual ☑ Public ☐ Community

Comments:/Conditions: Follow contour/

Pump & Manifold info attached.

Comments:/Conditions:

INITIAL SITE SKETCH

Please see Attached Layout Design

AS BUILT SKETCH

4 lines

7

13

15

15

Permit can be suspended or revoked if any false information is supplied toward securing the permit/any unauthorized changes are made to the site/any unauthorized changes are made in the installation of the system. Improvement Permit with plat valid without expiration ☐ Improvement Permit with site plan valid for sixty months ☑ Authorization to Construct is valid for a period equal to that of Improvement Permit – not to exceed sixty months.

Signed: Darrell Jones date

Installed by: Derrick Barnes

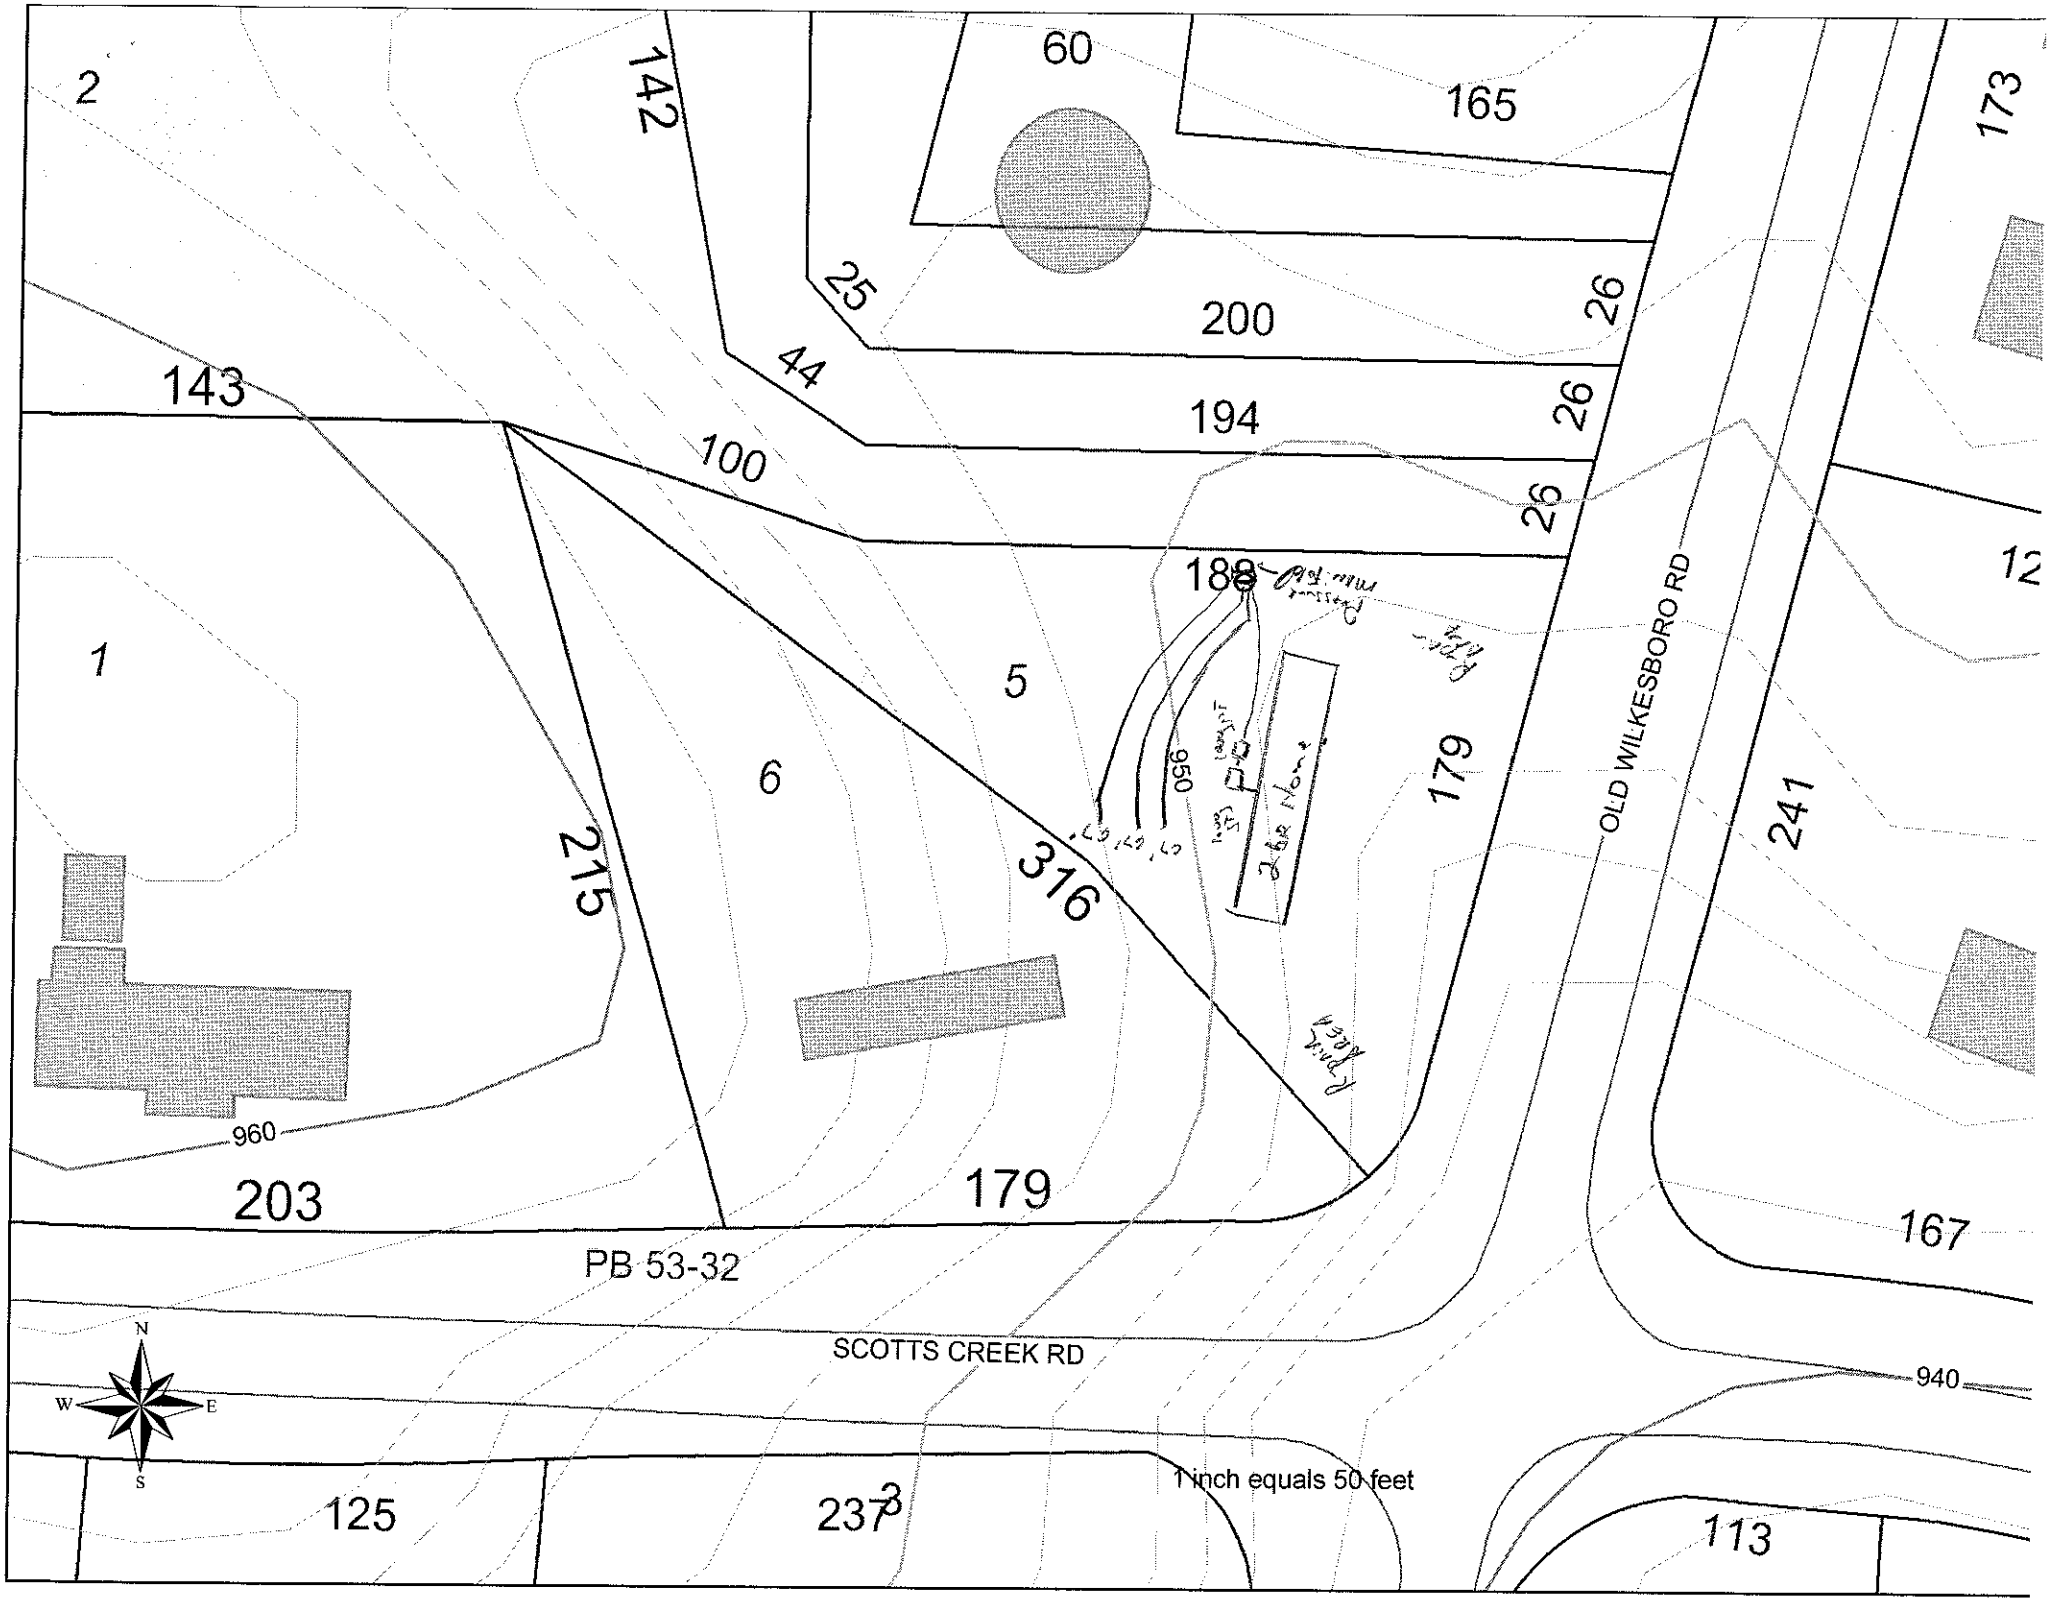
Improvement Permit by: R.S. date 20 Nov 07

Operation Permit by: R.S. date 14 Dec 07

Authorization to Construct by: R.S. date 20 Nov 07

Existing System Inspection by: date

HEALTH DEPT. COPY: WHITE OWNER COPY (FINAL): YELLOW OWNER COPY (INITIAL): PINK


2
142
60
165
173
25
200
26
44
143
194
26
100
26
188
12
1
5
6
179
OLD WILKESBORO RD
241
950
215
316
960
203
179
167
PB 53-32
SCOTTS CREEK RD
940
N
W
E
S
1 inch equals 50 feet
125
237
113