# IREDELL COUNTY HEALTH DEPARTMENT

## (SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Pete Scott DATE 1-5-83 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION Chipley Ford Rd Cross 4th Creek TR Paved Rd Then 1st Rt TL 200' on R S. R. No. _____

SUBDIVISION NAME Clearview acres LOT NO. 10 SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other _____


No. Bedrooms 3 No. Bathrooms 1 1/2

| | | | |
|---|---|---|---|
| Garbage Disposal Unit | Yes ( ) | No (✓) | |
| Auto. Dishwasher | Yes ( ) | No (✓) | |
| Auto. Wash. Machine | Yes (✓) | No ( ) | |
| Site Suitable | Yes (✓) | No ( ) | |

Character & Porosity of Soil Cecil Sandy Clay
Percolation Rate 2 1/2 gal/sq'
Topography 2 to 6 %
Depth to Water Table 10'+
Rock or other impervious formations none

Lot Area 100' X 200'

_____ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

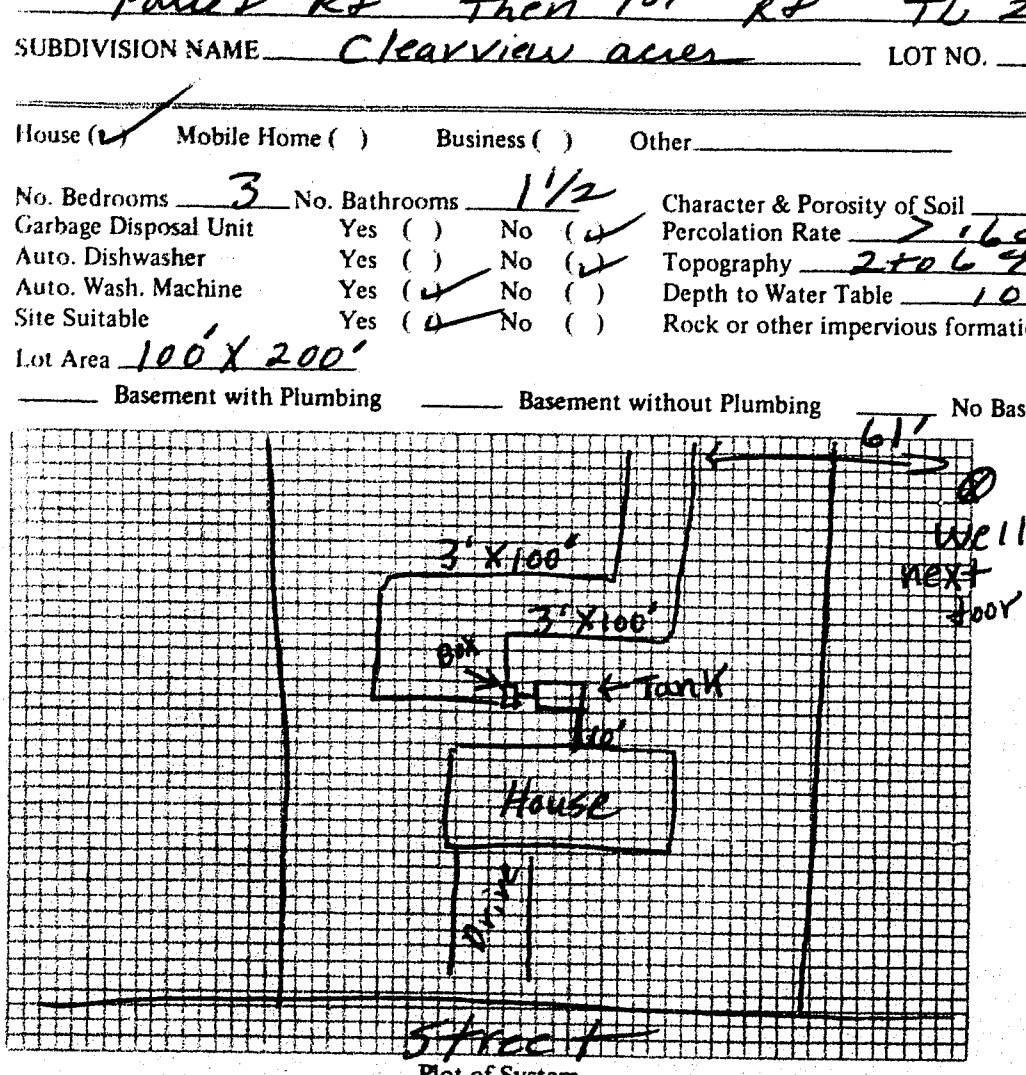

Plot of System

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 2
Sq. Ft. 600 Linear Ft. 200
Depth of Stone in Lines 12"
Water Supply: Individual ( )
Public (✓)

Installed by Eddie Younts Son

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY J. C. Moore

COMMENTS: _____

CERTIFICATE OF COMPLETION BY J. C. Moore DATE 1-5-83

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold