
PUMP TANK DESIGN

ATTACHMENT TO PROPERTY DESCRIPTION # 206021

TAX MAP # 4736806321

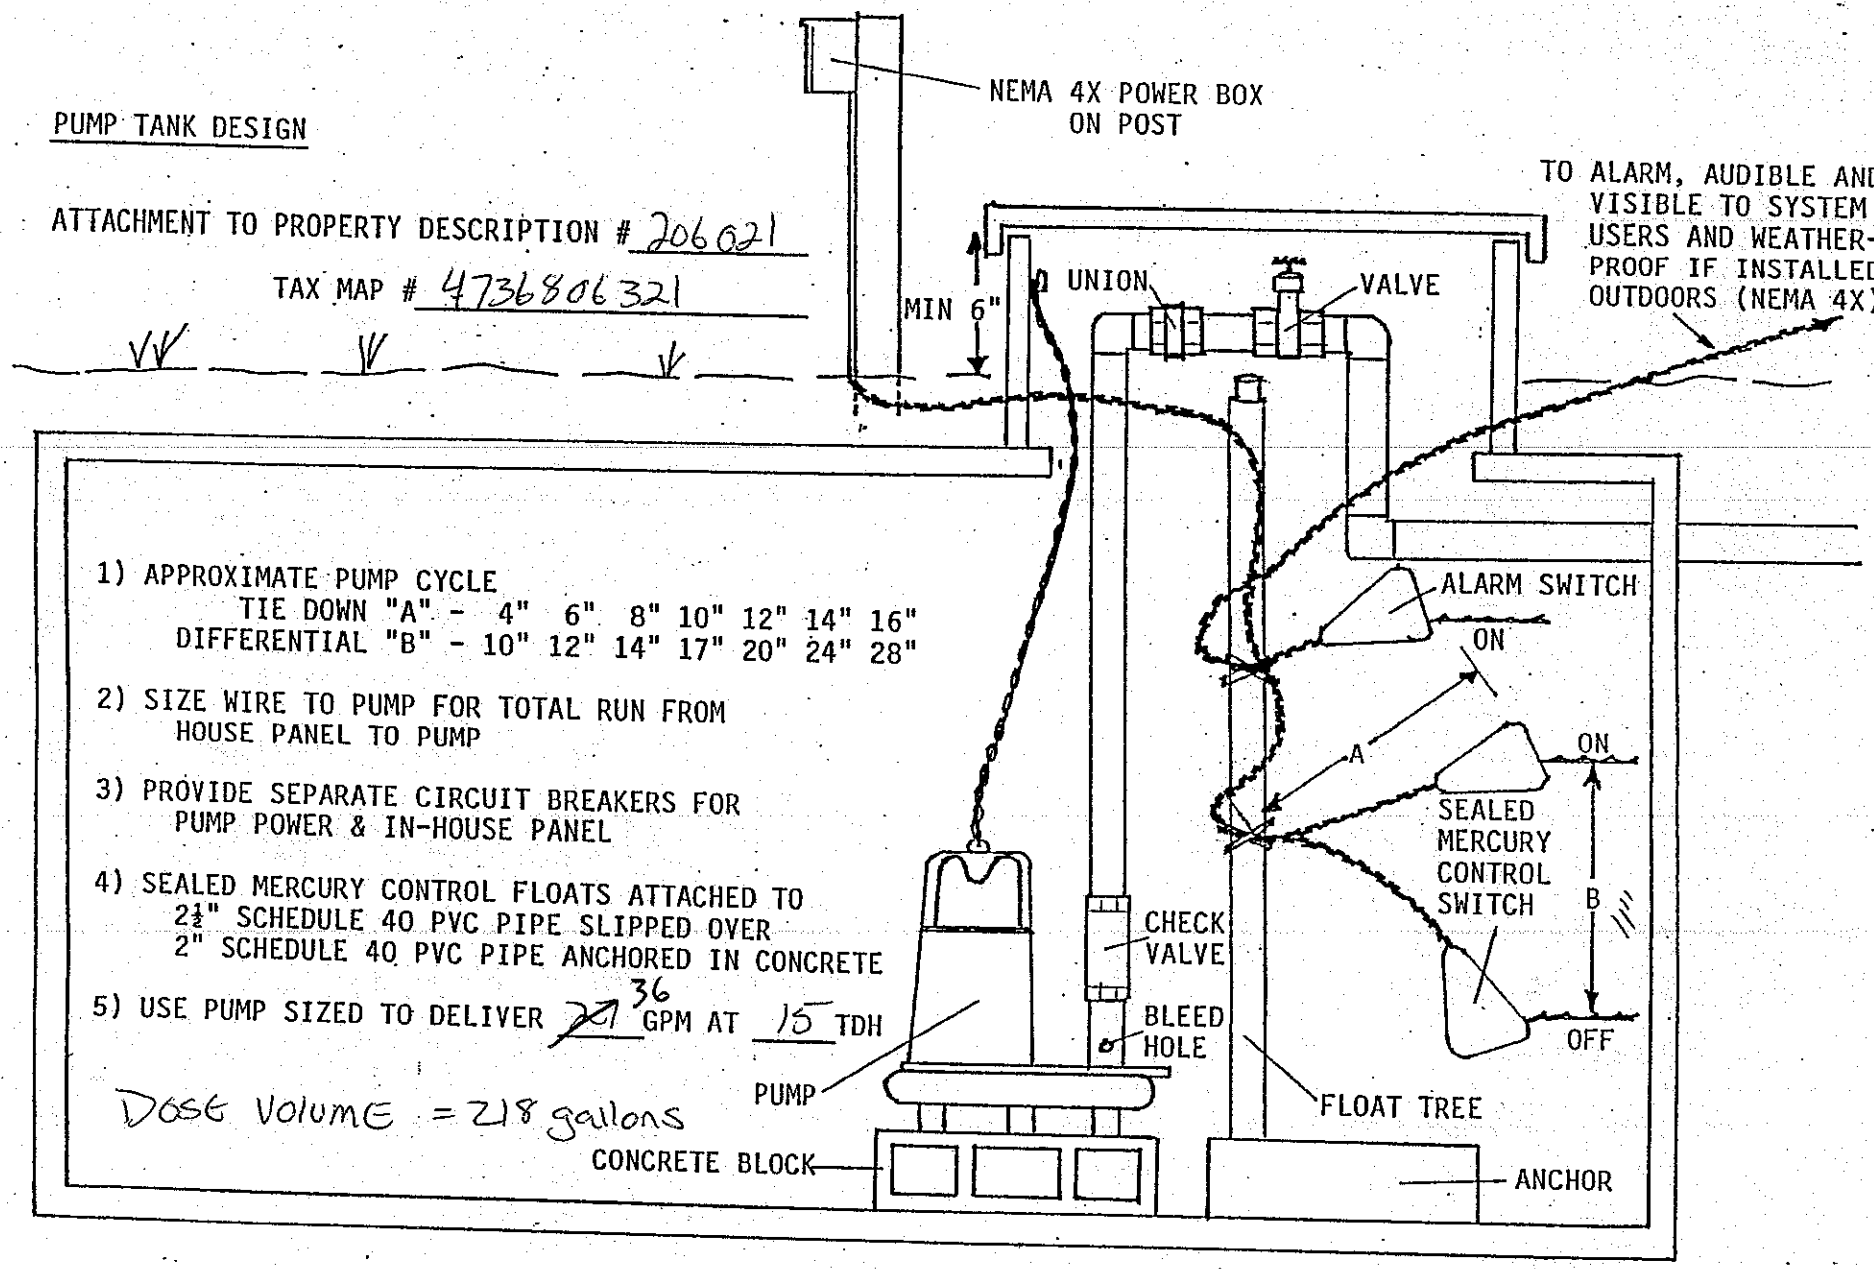

1) APPROXIMATE PUMP CYCLE
   TIE DOWN "A" - 4" 6" 8" 10" 12" 14" 16"
   DIFFERENTIAL "B" - 10" 12" 14" 17" 20" 24" 28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE


5) USE PUMP SIZED TO DELIVER ~~27~~ 36 GPM AT 15 TDH

Dose Volume = 218 gallons

PRESSURE MANIFOLD DESIGN

ATTACHMENT TO P.D.# 26021

TAX MAP # 473680321

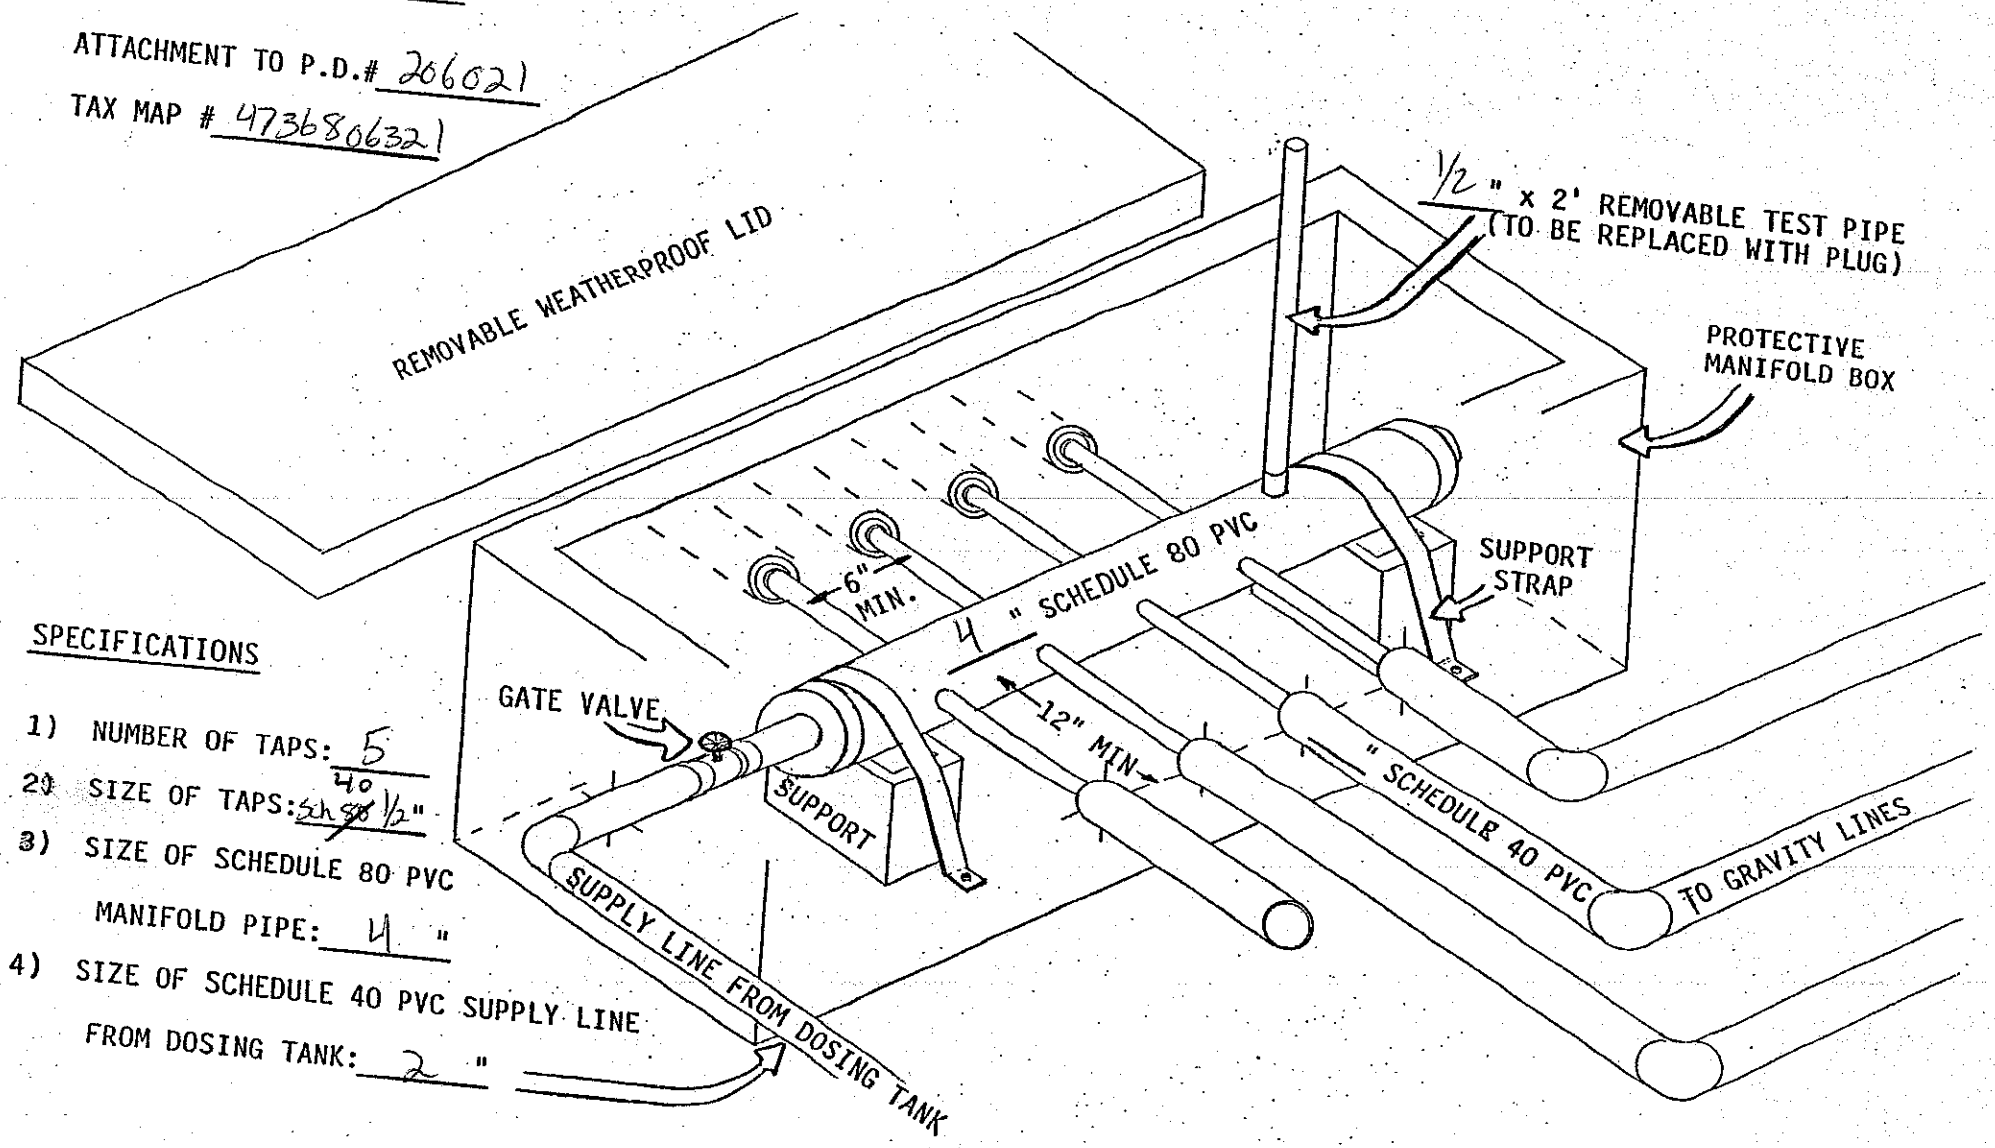

SPECIFICATIONS

1) NUMBER OF TAPS: 5
2) SIZE OF TAPS: ~~Sch 80~~ 40 1/2"
3) SIZE OF SCHEDULE 80 PVC MANIFOLD PIPE: 4 "
4) SIZE OF SCHEDULE 40 PVC SUPPLY LINE FROM DOSING TANK: 2 "