DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet 1 of 1
4738-59-7074 PROPERTY ID #:
COUNTY: Iredell

RIVER RUN LOT #39

SOIL/SITE EVALUATION *for* ON-SITE WASTEWATER SYSTEM

OWNER: HOPE BROTHERS BUILDERS, INC. APPLICATION DATE 10-13-04
ADDRESS: 601 BOND ST STATESVILLE NC 28677 DATE EVALUATED: 11-16-04
PROPOSED FACILITY: 3BR PROPOSED DESIGN FLOW (.1949): 360 PROPERTY SIZE:
LOCATION OF SITE: 21N TL FT DOBBS TR CHIPLEY FORD TL RIVER RUN PROPERTY RECORDED:
WATER SUPPLY: ☐ Private ☑ Public ☐ Well ☐ Spring ☐ Other TR YADKIN RIVER LN LOT ONRT
EVALUATION METHOD: ☑ Auger Boring ☐ Pit ☐ Cut TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	L	0-4	WK GR SL	VFR NS/NP SEXP	—	42"	—	—	PS 0.3
		4-24	MO SBK C	FR S/P SEXP					
		24-42	MO SBK C+SAP	FR S/P SEXP					
		42+	SL MA SAP	—					
2	L	0-5	WK GR SL	VFR NS/NP SEXP	—	40"	—	—	PS 0.3
		5-18	MO SBK C	FR S/P SEXP					
		18-40	MO SBK C+SAP	FR S/P SEXP					
		40+	SL MA SAP	—					
3	L	0-6	WK GR SL	VFR NS/NP SEXP	—	>48"	—	—	PS 0.3
		6-17	MO SBK C	FR S/P SEXP					
		17-48	MO SBK C+SAP	FR S/P SEXP					
4	L	0-2	WK GR SL	VFR NS/NP SEXP	—	45"	—	—	PS 0.3
		2-24	MO SBK C	FR S/P SEXP					
		24-45	MO SBK C+SAP	FR S/P SEXP					
		45+	SL MA SAP	—					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	GRAVITY 25%	LP 50%
Site LTAR	0.3	0.3

OTHER FACTORS (.1946): NO
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: CS
OTHER(S) PRESENT: JOHNNY HOPE

COMMENTS:

LEGEND

use the following standard abbreviations

LANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL .1955 LTAR*	LPP .1957 LTAR*	MINERALOGY/ CONSISTENCE	STRUCTURE
CC (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
CV (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
D (Drainage Way)					EXP (Expansive)	CR (Crumb)
DS (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
FP (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
FS (Foot Slope)						ABK (Angular Blocky)
H (Head Slope)	III	Si (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
L (Linear Slope)		SiCL (Silty Clay Loam)				PR (Prismatic)
N (Nose Slope)		CL (Clay Loam)				
R (Ridge)		SCL (Sandy Clay Loam)			**MOIST**	**WET**
S (Shoulder Slope)		SiL (Silt Loam)				
T (Terrace)					VFR (Very Friable)	NS (Non-sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FR (Friable)	SS (Slightly Sticky)
		SiC (Silty Clay)			FI (Firm)	S (Sticky)
		C (Clay)			VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
		O (Organic)	None	None	EFI (Extremely Firm)	NP (Non-plastic)
						SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)

*Adjust LTAR due to depth, consistence, structure, soil wetness, landscape, position, wastewater flow and quality.


NOTES

HORIZON DEPTH	In inches below natural soil surface
DEPTH OF FILL	In inches from land surface
RESTRICTIVE HORIZON	Thickness and depth from land surface
SAPROLITE	S(suitable) or U(unsuitable)
SOIL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
CLASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

Evaluation of saprolite shall be by pits.

Long-term Acceptance Rate (LTAR): gal/day/ft^2

Show profile locations and other site features (dimensions, reference or benchmark, and North).

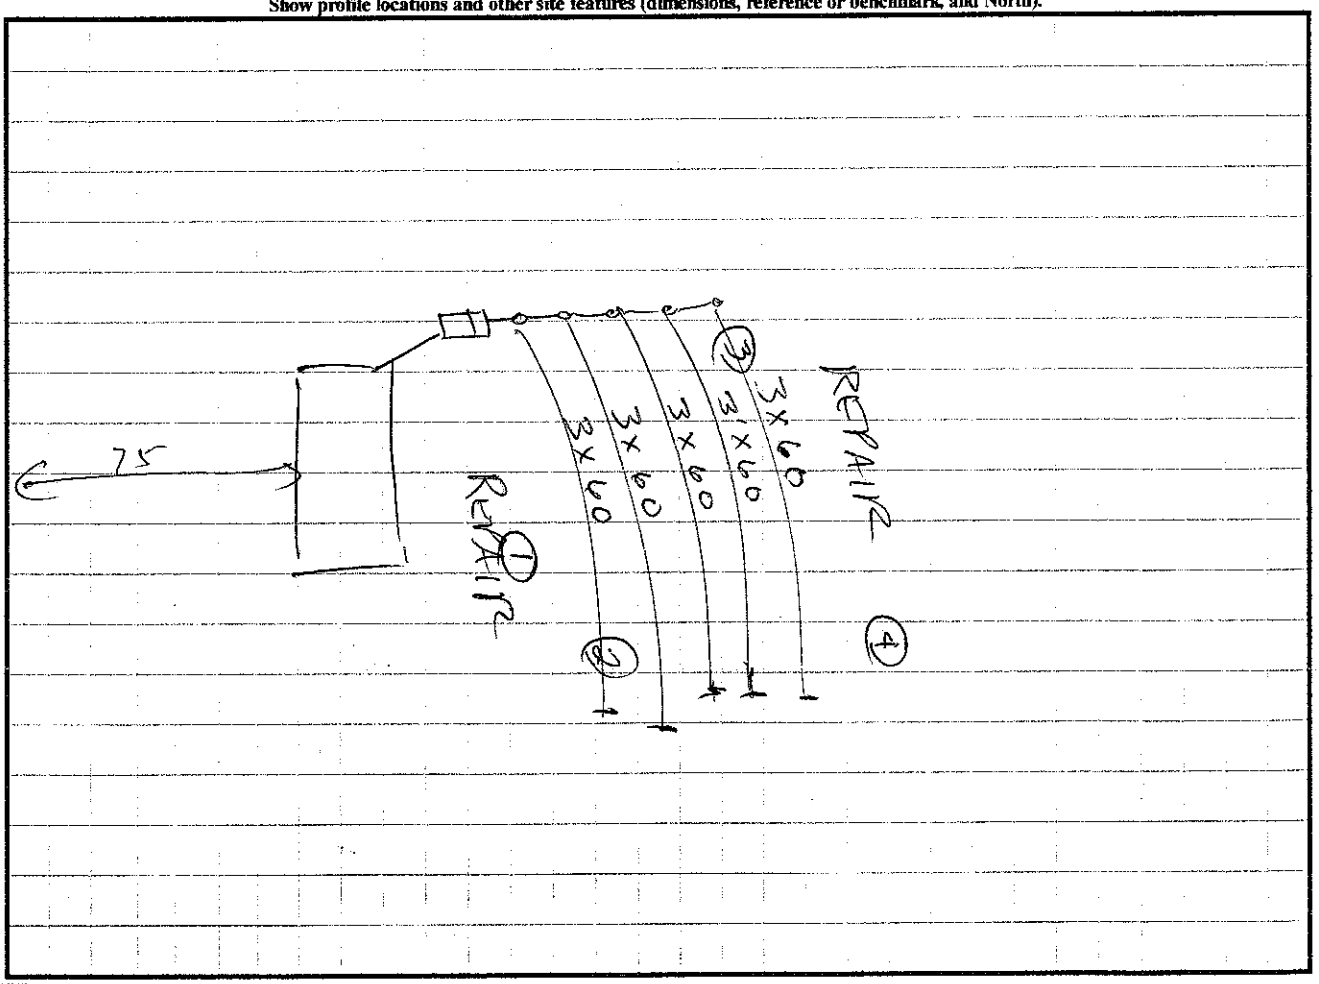

DENR (######)
Review (#####)