4740000 0815

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Scott Bruton DATE 5-19-87 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION 1303 N. TR 1314 (Clontz Hill Rd.) ~ ¼ mile on Rt. _____ S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House ( ) Mobile Home (✓) Business ( ) Other _____

No. Bedrooms 2 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site Suitable Yes (✓) No ( )

Lot Area 6.5 Ac

Character & Porosity of Soil shallow clay


Percolation Rate 2.35

Topography 10-15%

Depth to Water Table 3'+

Rock or other impervious formations none obs.

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

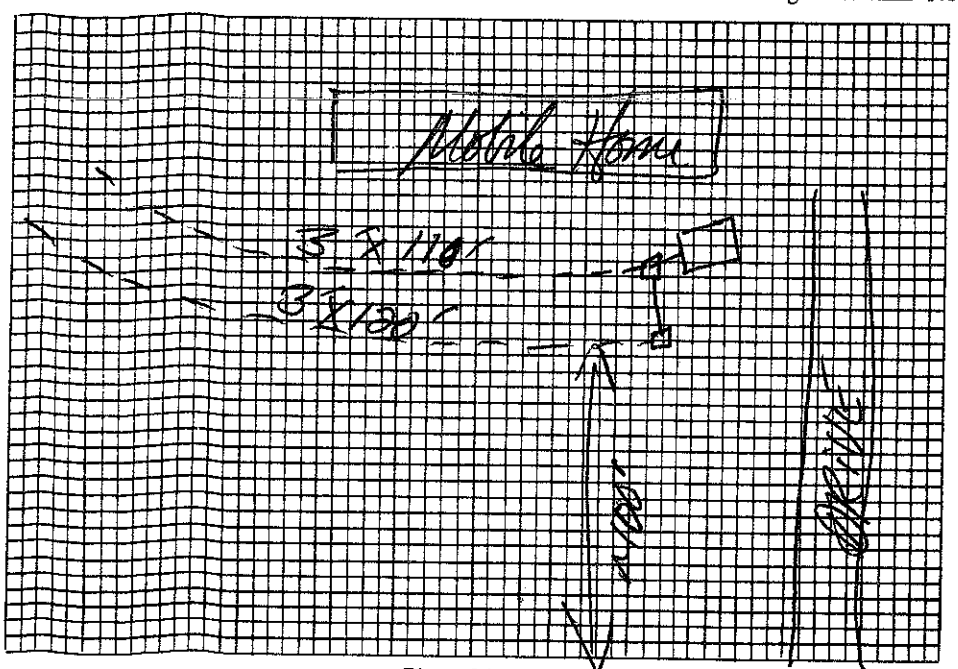

Plot of System

well site

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 2

Sq. Ft. 685 Linear Ft. 229

Depth of Stone in Lines 12"+

Water Supply: Individual (✓)

Public ( )

Installed by Wayne Potts

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY _____

COMMENTS: _____

CERTIFICATE OF COMPLETION BY _____ DATE 5-19-87

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Scott Bruton DATE 5-1-87 PERMIT NO.

PHONE: Business Home

LOCATION 1303 N. SR 1314 (Clontz-Hill Rd.) ~ 1/4 mile on Rt. 300' + Off road S. R. No.


SUBDIVISION NAME LOT NO. SECTION OR BLOCK NO.

House ( ) Mobile Home (✓) Business ( ) Other

No. Bedrooms 2 No. Bathrooms 2
Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes (✓) No ( )
Lot Area 6.5 Ac.

Character & Porosity of Soil shallow clay (drainage mottles 36"+)
Percolation Rate .35
Topography 10-15%
Depth to Water Table 3'+
Rock or other impervious formations none obs.

___\ Basement with Plumbing ___ Basement without Plumbing ___✓ No Basement

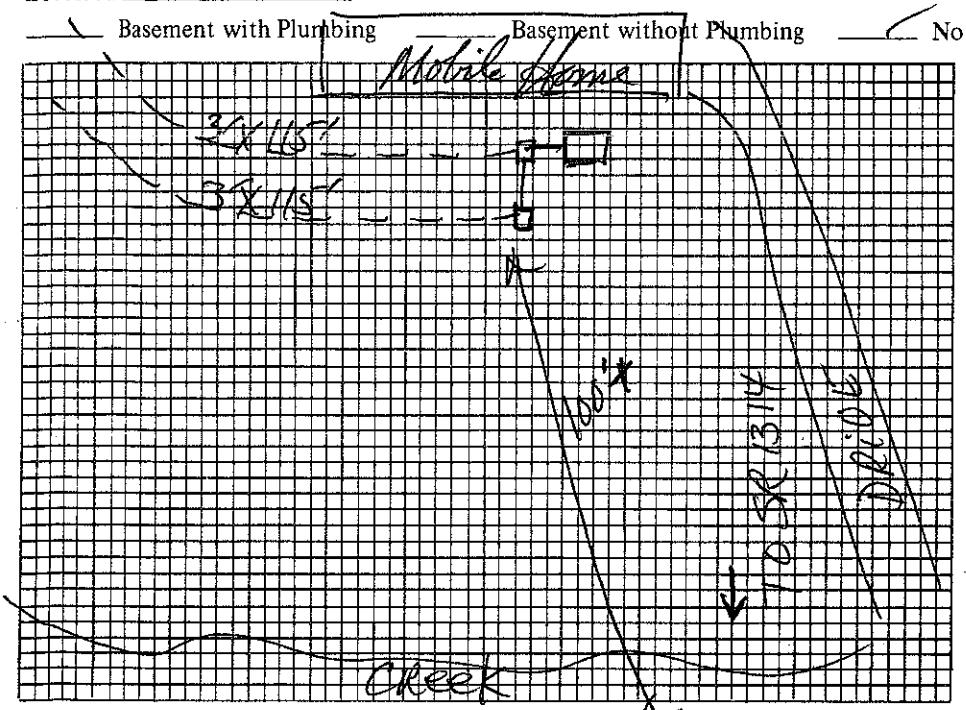

Plot of System

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 2
Sq. Ft. 685 Linear Ft. 229
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed Scott D. Bruton

IMPROVEMENTS PERMIT BY Chris Robinson

COMMENTS: Drainfield must be installed shallow (12" cover MAXIMUM) Distribute effluent using drop boxes. Follow contour

CERTIFICATE OF COMPLETION BY DATE

EXISTING SYSTEM CHECKED BY: DATE

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold