DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ____ of ____
PROPERTY ID #: ____
COUNTY: ____

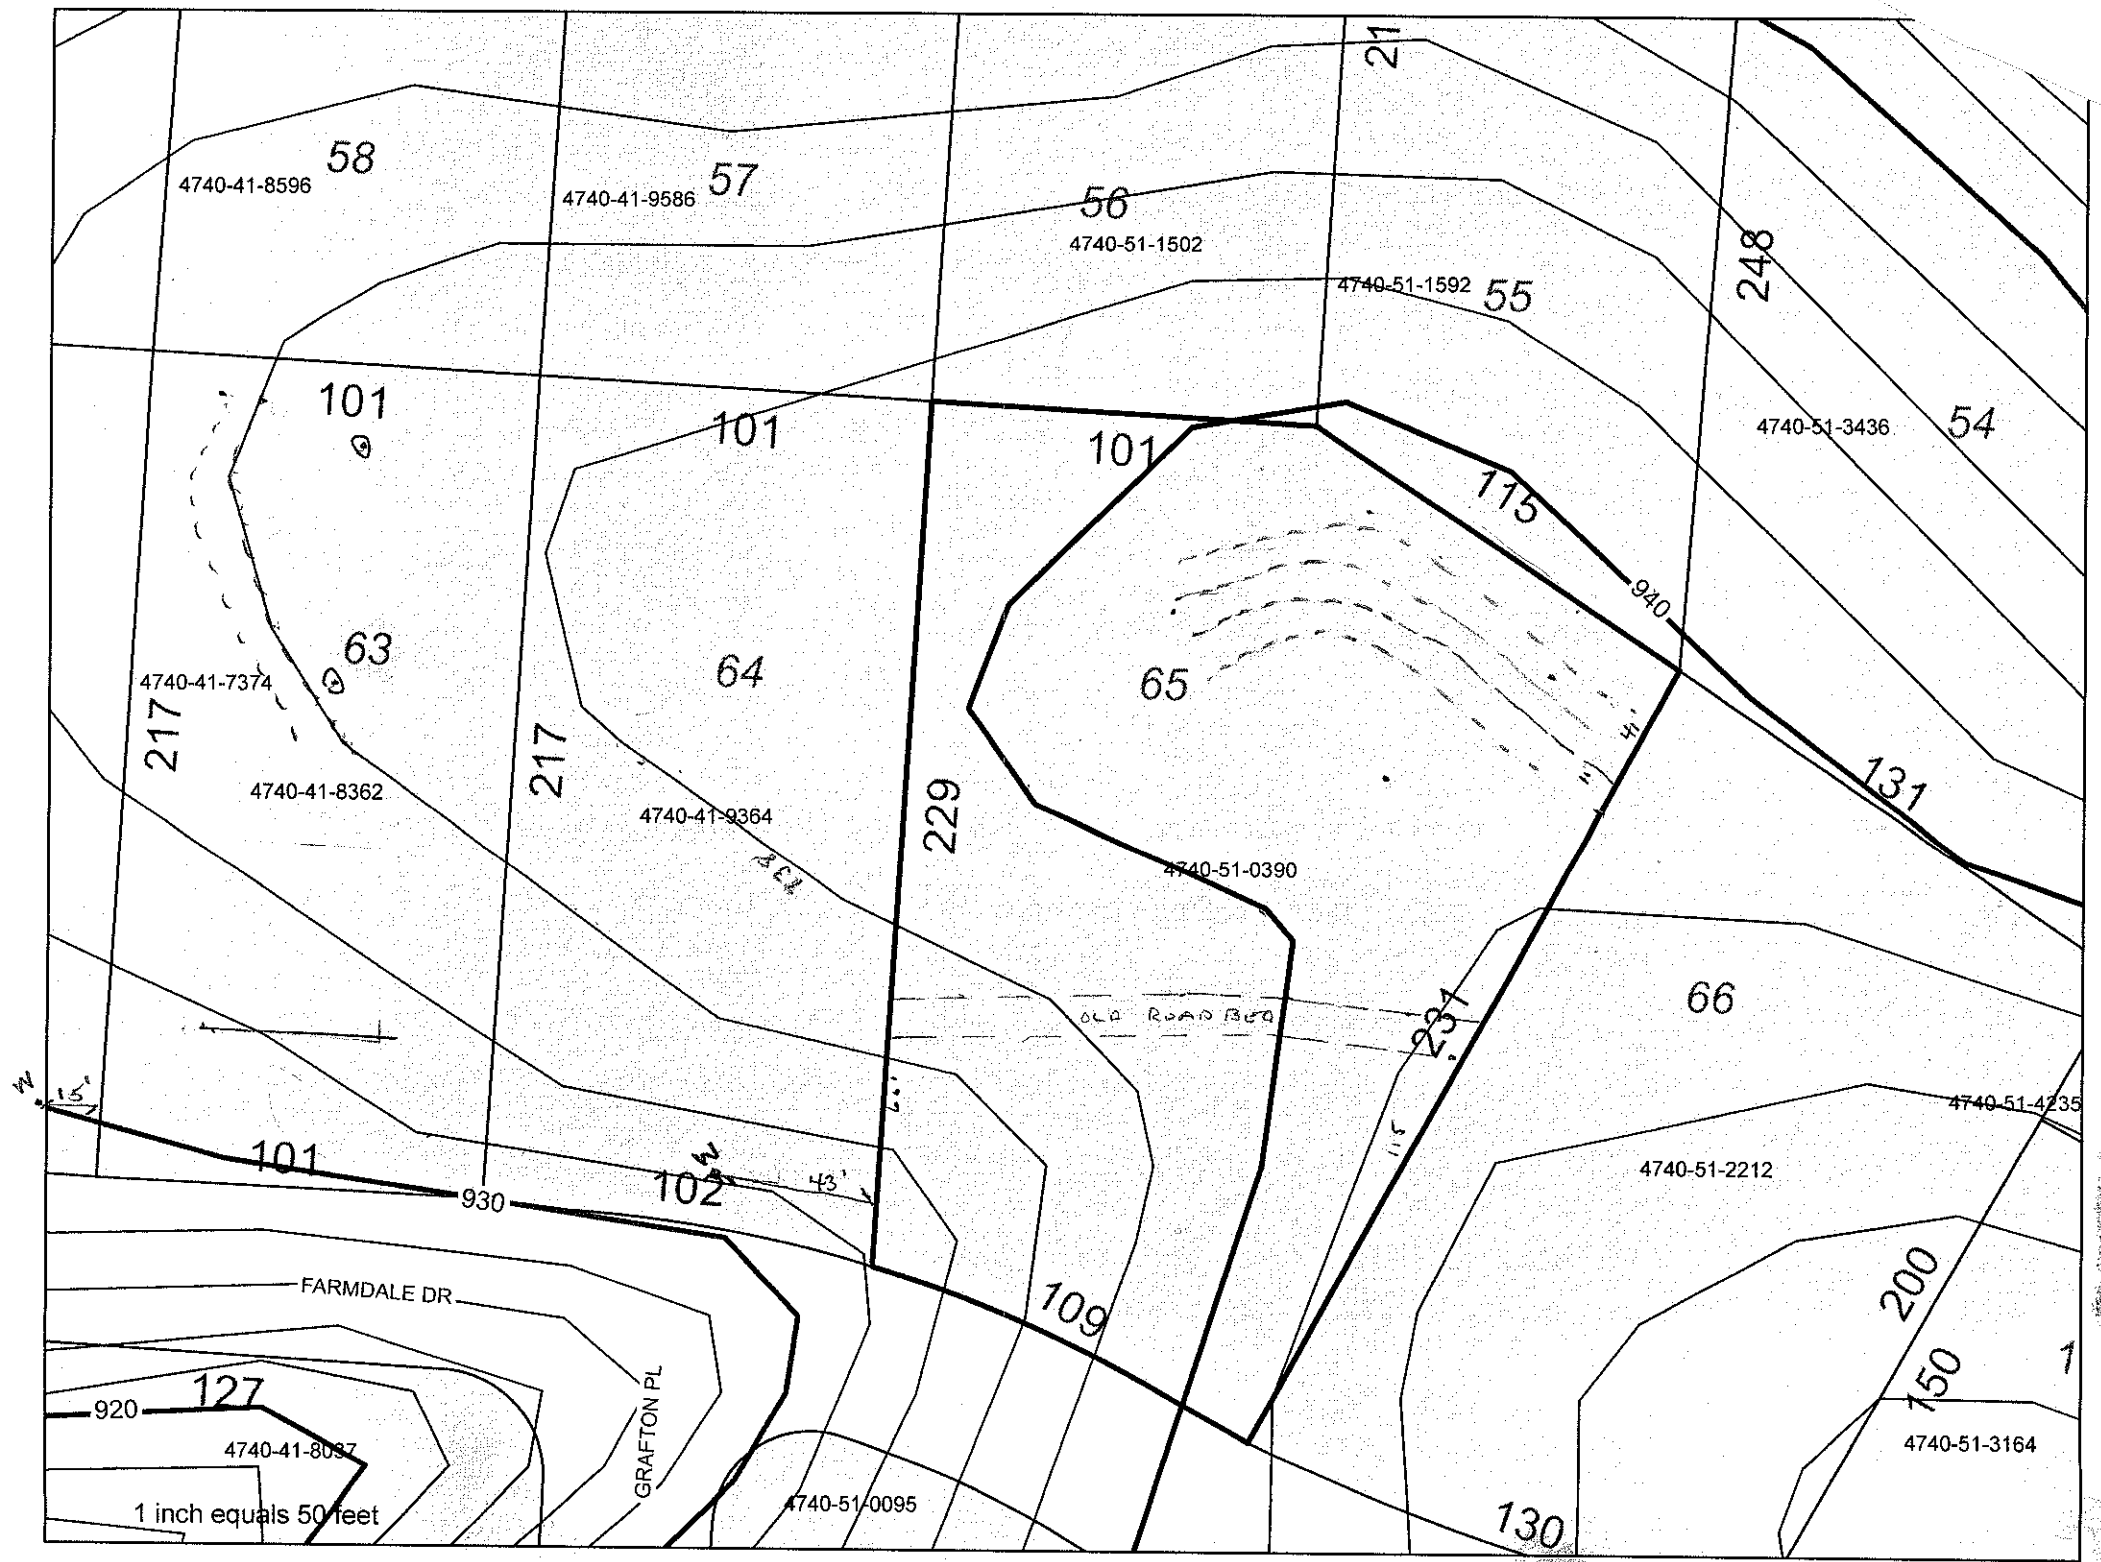
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Courthouse Builders APPLICANT: ____
ADDRESS: ____ APPLICATION DATE: ____ DATE EVALUATED: 3/11/06
PROPOSED FACILITY: ____ PROPOSED DESIGN FLOW (.1949): 360 PROPERTY SIZE: .50
LOCATION OF SITE: Carlyle Farms - L63 PROPERTY RECORDED: ____
WATER SUPPLY: ☒ Private ☐ Public ☐ Well ☐ Spring ☐ Other ____
EVALUATION METHOD: ☒ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	Rear 2%	48	MF GR | cl	VFR NS - NP.					.35
2	mid	48	MF SBK/GR cl	[illegible] VFR SS - NP					.35
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	P	P
System Type(s)	2570	2570
Site LTAR		

OTHER FACTORS (.1946): Pump → PM
SITE CLASSIFICATION (.1948): ____
EVALUATED BY: [signature]
OTHERS PRESENT: ____


4740-41-8596
58
4740-41-9586
57
56
4740-51-1502
4740-51-1592
55
4740-51-3436
54
21
248
101
101
101
115
940
63
64
65
4740-41-7374
217
4740-41-8362
217
4740-41-9364
229
4740-51-0390
131
OLD ROAD BED
66
231
4740-51-4235
4740-51-2212
101
930
102
43'
FARMDALE DR
109
200
150
920
127
4740-41-8087
GRAFTON PL
4740-51-0095
130
4740-51-3164
1 inch equals 50 feet