# IREDELL COUNTY HEALTH DEPARTMENT

## (SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR James T. Josey DATE 6-30-81 PERMIT NO. 199

PHONE: Business _____ Home _____

LOCATION 21 N. to under I 77 TR 1312 TR 1316 2.2 mi on left

SUBDIVISION NAME _____ S. R. No. _____

LOT NO. _____ SECTION OR BLOCK NO. _____

House ( ) Mobile Home (✓) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 1½

| | | | |
|---|---|---|---|
| Garbage Disposal Unit | Yes ( ) | No (✓) | |
| Auto. Dishwasher | Yes ( ) | No (✓) | |
| Auto. Wash. Machine | Yes (✓) | No ( ) | |
| Site Suitable | Yes (✓) | No ( ) | |

Lot Area 20000ft² +

Character & Porosity of Soil Clay loam


Percolation Rate 30

Topography 5-10%

Depth to Water Table unk.

Rock or other impervious formations none obs.

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

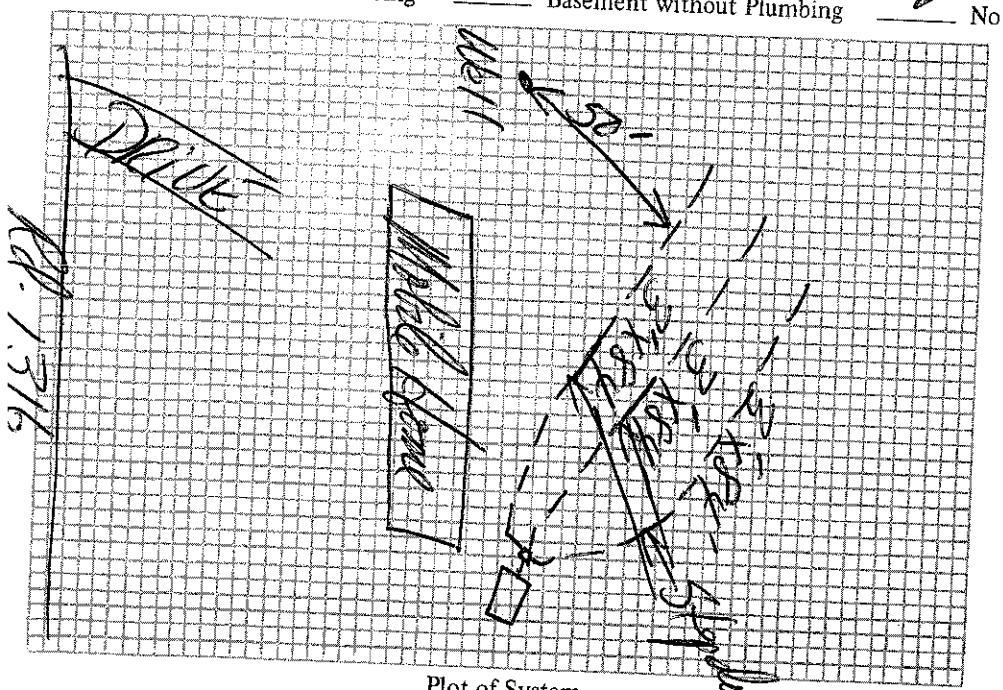


Plot of System

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 3

Sq. Ft. 750 Linear Ft. 250

Depth of Stone in Lines 10"

Water Supply: Individual (✓)

Public ( )

Installed by Sam Ostwalt

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY DRH

COMMENTS: Well not located in area designated on improvements permit. Had to install drainfield deep with one stepdown in each line.

CERTIFICATE OF COMPLETION BY David R. Hanson

EXISTING SYSTEM CHECKED BY: _____ DATE 6-30-81

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS. DATE _____

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

11:00

# IREDELL COUNTY HEALTH DEPARTMENT

## (SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR James I. Josey DATE 6-5-84 PERMIT NO. 129

PHONE: Business _____ Home _____

LOCATION 21 N. go under I 77 TR 1312 TR 1316 0.2 mi. on left

SUBDIVISION NAME _____ S. R. No. _____

LOT NO. _____ SECTION OR BLOCK NO. _____

House ( ) Mobile Home (✓) Business ( ) Other _____


No. Bedrooms 3 No. Bathrooms 1½

Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes ( ) No (✓)
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes (✓) No ( )

Character & Porosity of Soil Clay loam
Percolation Rate Prompt
Topography 8-10%
Depth to Water Table unk.
Rock or other impervious formations none obs.

Lot Area 20,000 SF±

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

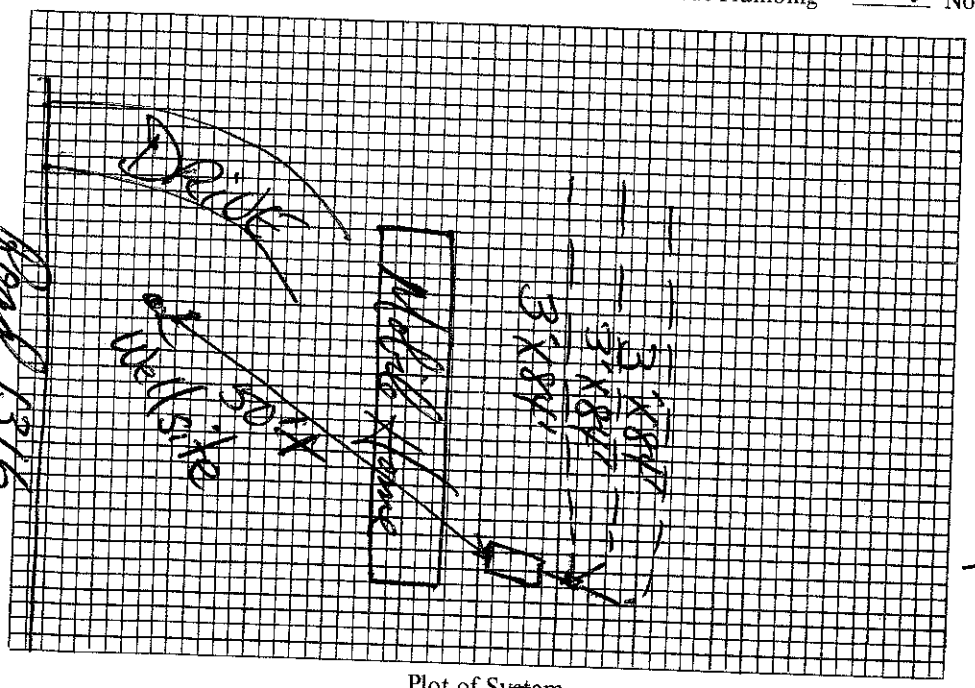


Plot of System

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 3
Sq. Ft. 750 Linear Ft 250
Depth of Stone in Lines 10"

Water Supply: Individual (✓)
Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

~~X~~ Signed: James I Josey

IMPROVEMENTS PERMIT BY David R. Hinson

COMMENTS: _____

CERTIFICATE OF COMPLETION BY _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.
Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold