DEPARTMENT OF ENVIRONMENTAL HEALTH
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

PROPERTY ID #:
COUNTY:

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM


05-P-12-63
4741-63-2479

OWNER: [redacted] DONNIE PIKE APPLICANT: JERRY DAWN PUTT
ADDRESS: PO BOX 1234 MOORESVILLE, NC 28115 APPLICATION DATE: [redacted] DATE EVALUATED: [redacted]
PROPOSED FACILITY: HOUSE PROPOSED DESIGN FLOW (.1949): 480 PROPERTY SIZE: 16.5 AC
LOCATION OF SITE: OSTWALT ANDY, (L) PERRY, (R) NO LOT W LEFT PAST LOVO PROPERTY RECORDED:
WATER SUPPLY: ☐ Private ☐ Public ☒ Well ☐ Spring ☐ Other
EVALUATION METHOD: ☒ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFIL CLASS & LTAR
1	0%	0-6"	scl wk gr	fns mpmsp		74"			A .3
		6-36	c mod sbk	fi s p sbk					
		36-48"	c mod sbk	fr ss p sbk					
			sap mix/sap < 50%						
2	1%	0-11"	scl wk gr	fr ns mp sbk		74"			PS .35
		11-30"	sap inclusions c mod sbk	fi s p sbk					
		30-48"	scl wk gr	fr ss p sbk					
3	5%	0-6"	scl wk gr	fr ns p mpm		78"			PS .3
		6-48"	c mod sbk	fi s p sbk					
			30-48" sap inclusions						
4		0-6	scl wk gr	fr ns mp mpg					PS .35
		6-24	c mod sbk	fi s p sbk					
		24-48"	SL wk gr	fr ns mp mpg					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	YES	YES
System Type(s)	CONV GRAV	GRAV PANEL
Site LTAR	.3	.3

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: L. LODIC
OTHER(S) PRESENT:

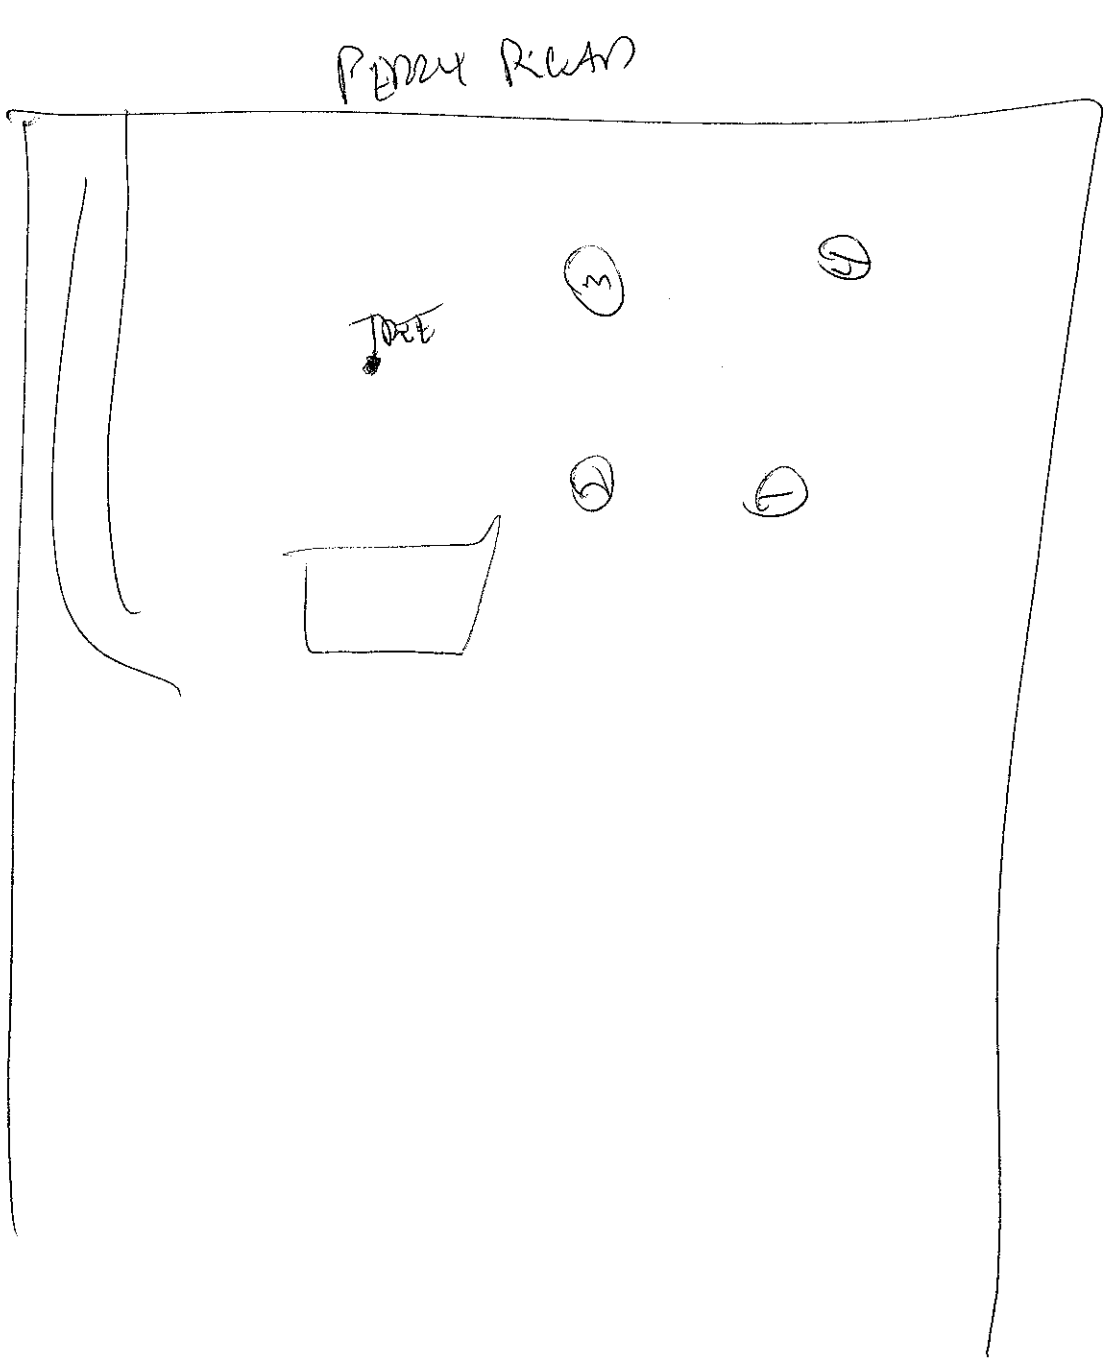

NOT TO SCALE