
Acknowledgement Of
Plans Submittal ONLY!
STEVE HEDRICK Date 5-17-06
Date 5.18.06

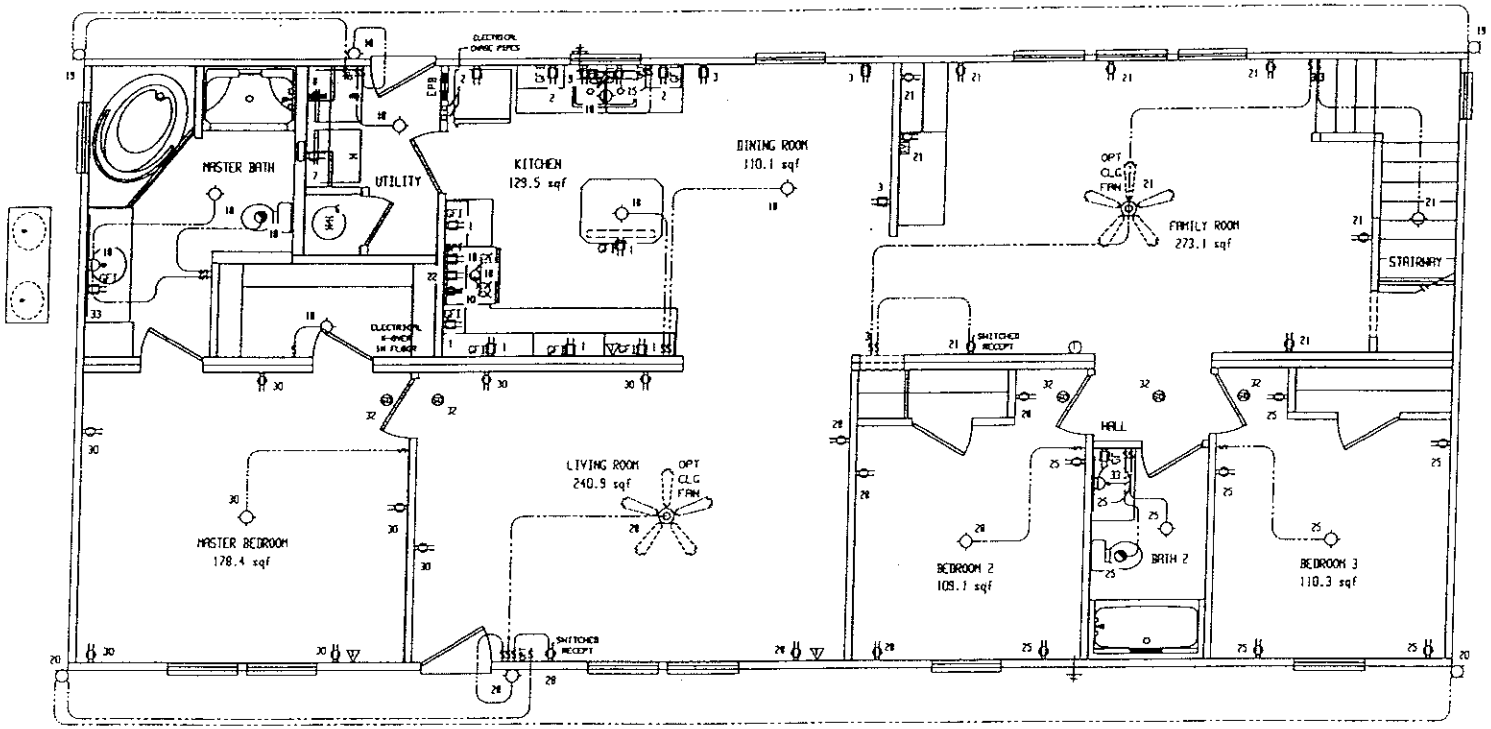

NOTE: ON MODULARS, ALL 15 & 20 AMP CIRCUITS FEEDING ELECTRICAL OUTLET IN BEDROOMS MUST BE PROTECTED BY AN ARC-FAULT INTERRUPTER IN ACCORDANCE WITH SECTION 210.12 OF THE NEC

ELECTRICAL SCHEDULE

CIR NO.	DESCRIPTION	QTY	VOLTS	CIRCUIT SIZE
1	PORTABLE APPLIANCES	20	120	12
2	PORTABLE APPLIANCES	20	120	12
3	PORTABLE APPLIANCES	20	120	12
4	SDL LIGHTING OFT RCPT.	15	120	14
5	SDL LIGHTING OFT RCPT.	15	120	14
6	ELECT. WATER HEATER	CIRCUITS VARY, SEE DIAGRAM PAGE PLM-1.1 FOR HUB, PLM-1.1 FOR MORE		
7	WASHER RECEPT.	20	120	12
8	DRYER RECEPT.	30	240	10
9	OPT. DISHWASHER	15	120	14
10	ELECT. RANGE/COOKTOP	40	240	8
11	CKG FURNACE	15	120	14
12	ELECTRIC FURNACE	CIRCUITS VARY, SEE DIAGRAM PAGE PLM-2.1 FOR HUB, PLM-1.5 FOR MORE		
13	SDL LIGHTING OFT RCPT.	15	120	14
14	OPT. COOLER BOX	15	120	14
15	OPT. GYMPIC DISPOSAL	15	120	14
16	FREEZER	20	120	12
17	OPT. WASH/DRY	20	120	12
18	SDL LIGHTING OFT RCPT.	15	120	14
19	SDL LIGHTING OFT RCPT.	15	120	14
20	SDL LIGHTING OFT RCPT.	15	120	14
21	OPT. MICROWAVE	20	120	12/2
22	ELECT. BUILT-IN OVEN	20	240	12/2
23	GENERAL LIGHTING	15	120	14
24	GENERAL LIGHTING	15	120	14
25	GENERAL LIGHTING	15	120	14
26	GENERAL LIGHTING	15	120	14
27	GENERAL LIGHTING	15	120	14
28	SDL LAUNDRY/DISH PUMP	40	240	8/2
29	SPARE PLANNED	15	120	14
30	SPARE OPT WSHR OUTLET	20	120	12
31	SPARE PLANNED	15	120	14
32	SPARE PLANNED	15	120	14
33	SPARE PLANNED	15	120	14

BRAND: SCHULT
SERIES: LGH0028
CMH

REVISIONS | BY | DATE

GENERAL NOTES
LOCK-OUT BREAKER ON CIRCUIT #6

APPROVED BY NTA INC. 05/02/06
Michael Fuller

DRAWING TITLE: ELECTRICAL PLAN

MODEL NAME | SQ. FT. 1600
PLANT 958 | DESCRIPTION 28X60 3BR-2BA | MODEL NO. 2772-CAPE
DRAWN BY MPS | ORIG. DATE 04/18/2005 | DATE PRINTED 05/25/2005 | SHEET NO 11-1