
PUMP TANK DESIGN

M. MILLER LOT # 1

ATTACHMENT TO PROPERTY DESCRIPTION # REPAIR

TAX MAP # 4743-69-0498

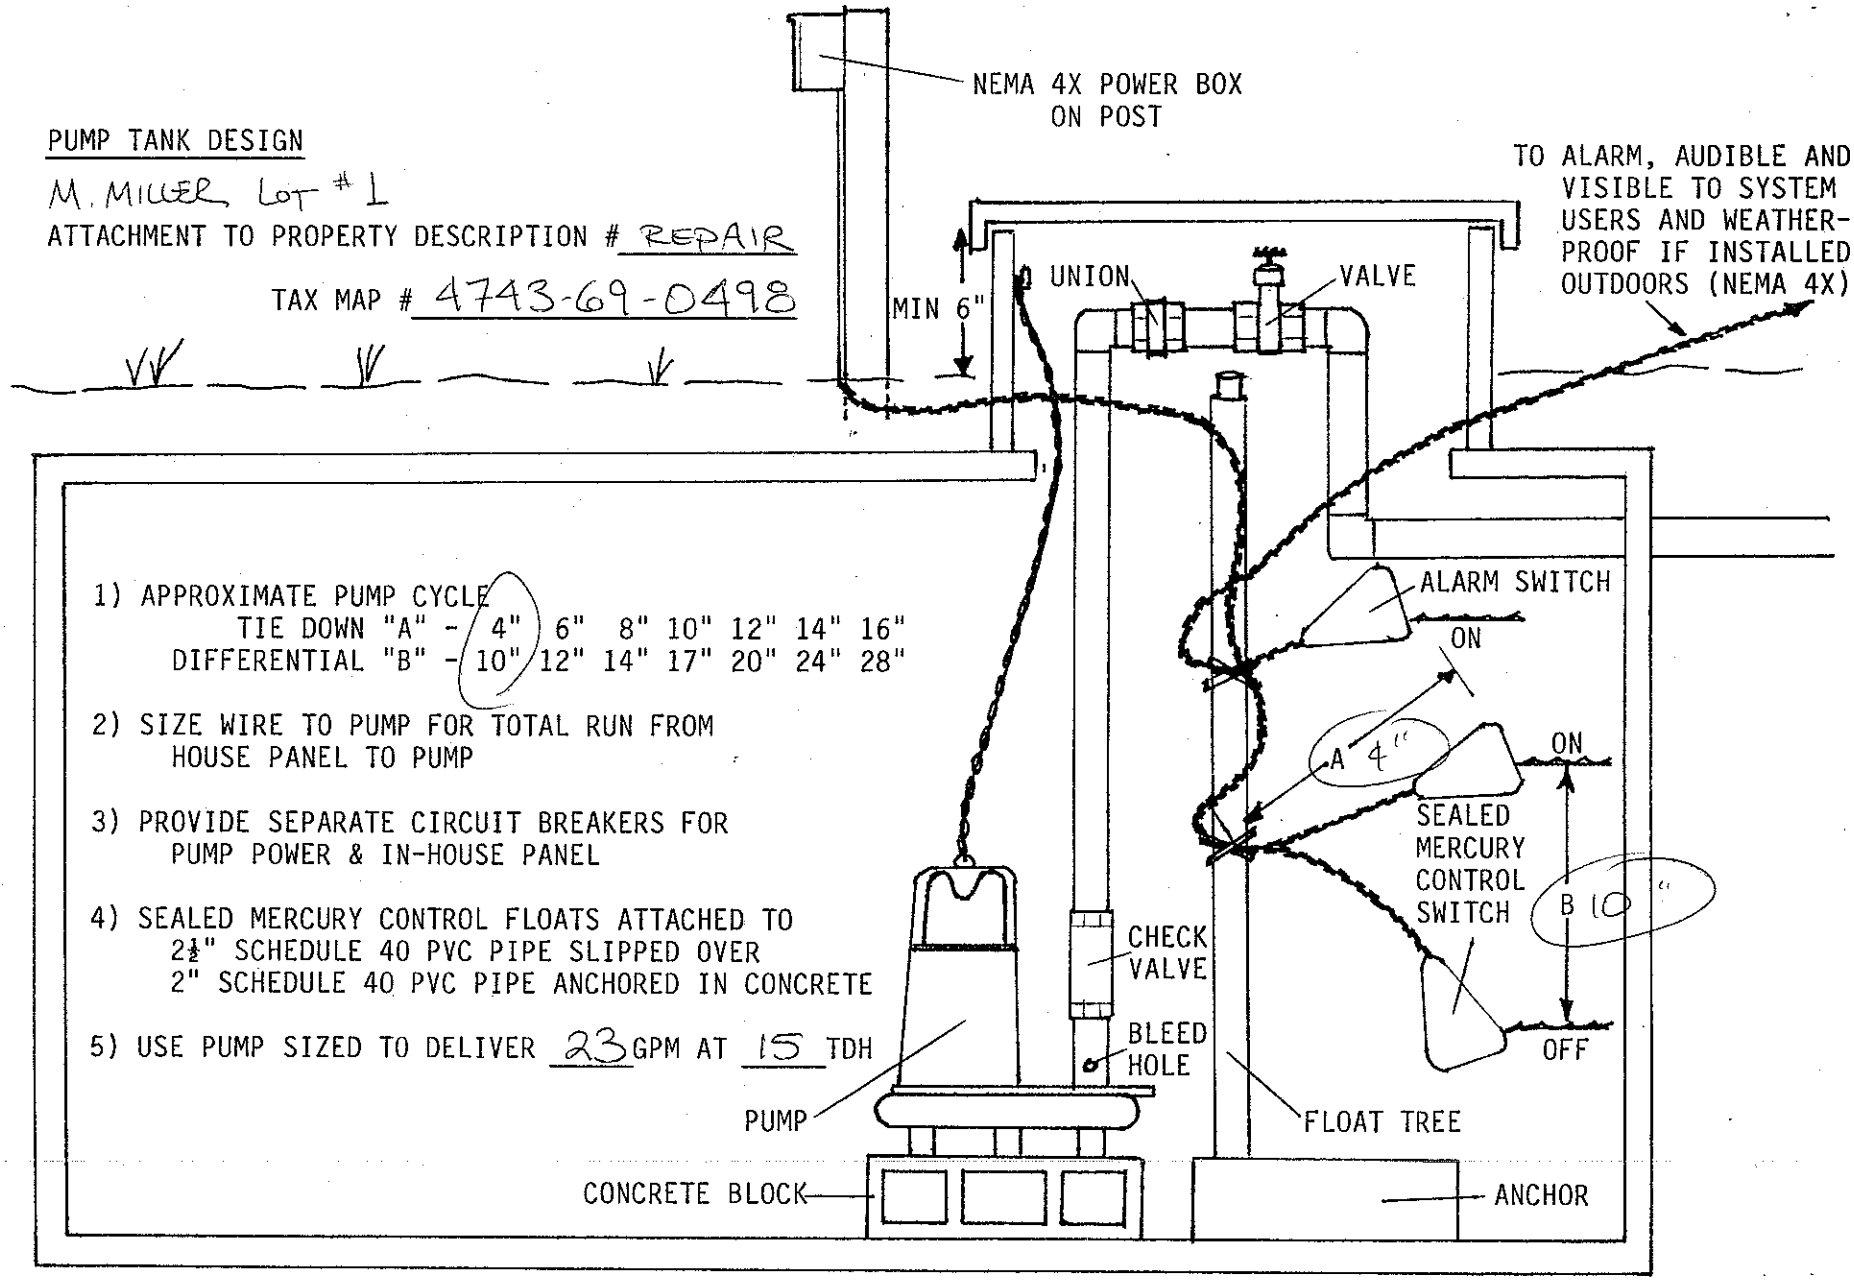

1) APPROXIMATE PUMP CYCLE
   TIE DOWN "A" - 4" 6" 8" 10" 12" 14" 16"
   DIFFERENTIAL "B" - 10" 12" 14" 17" 20" 24" 28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE


5) USE PUMP SIZED TO DELIVER 23 GPM AT 15 TDH

PRESSURE MANIFOLD DESIGN

M. Miller

ATTACHMENT TO P.D.# REPAIR

TAX MAP #4743-69-0498

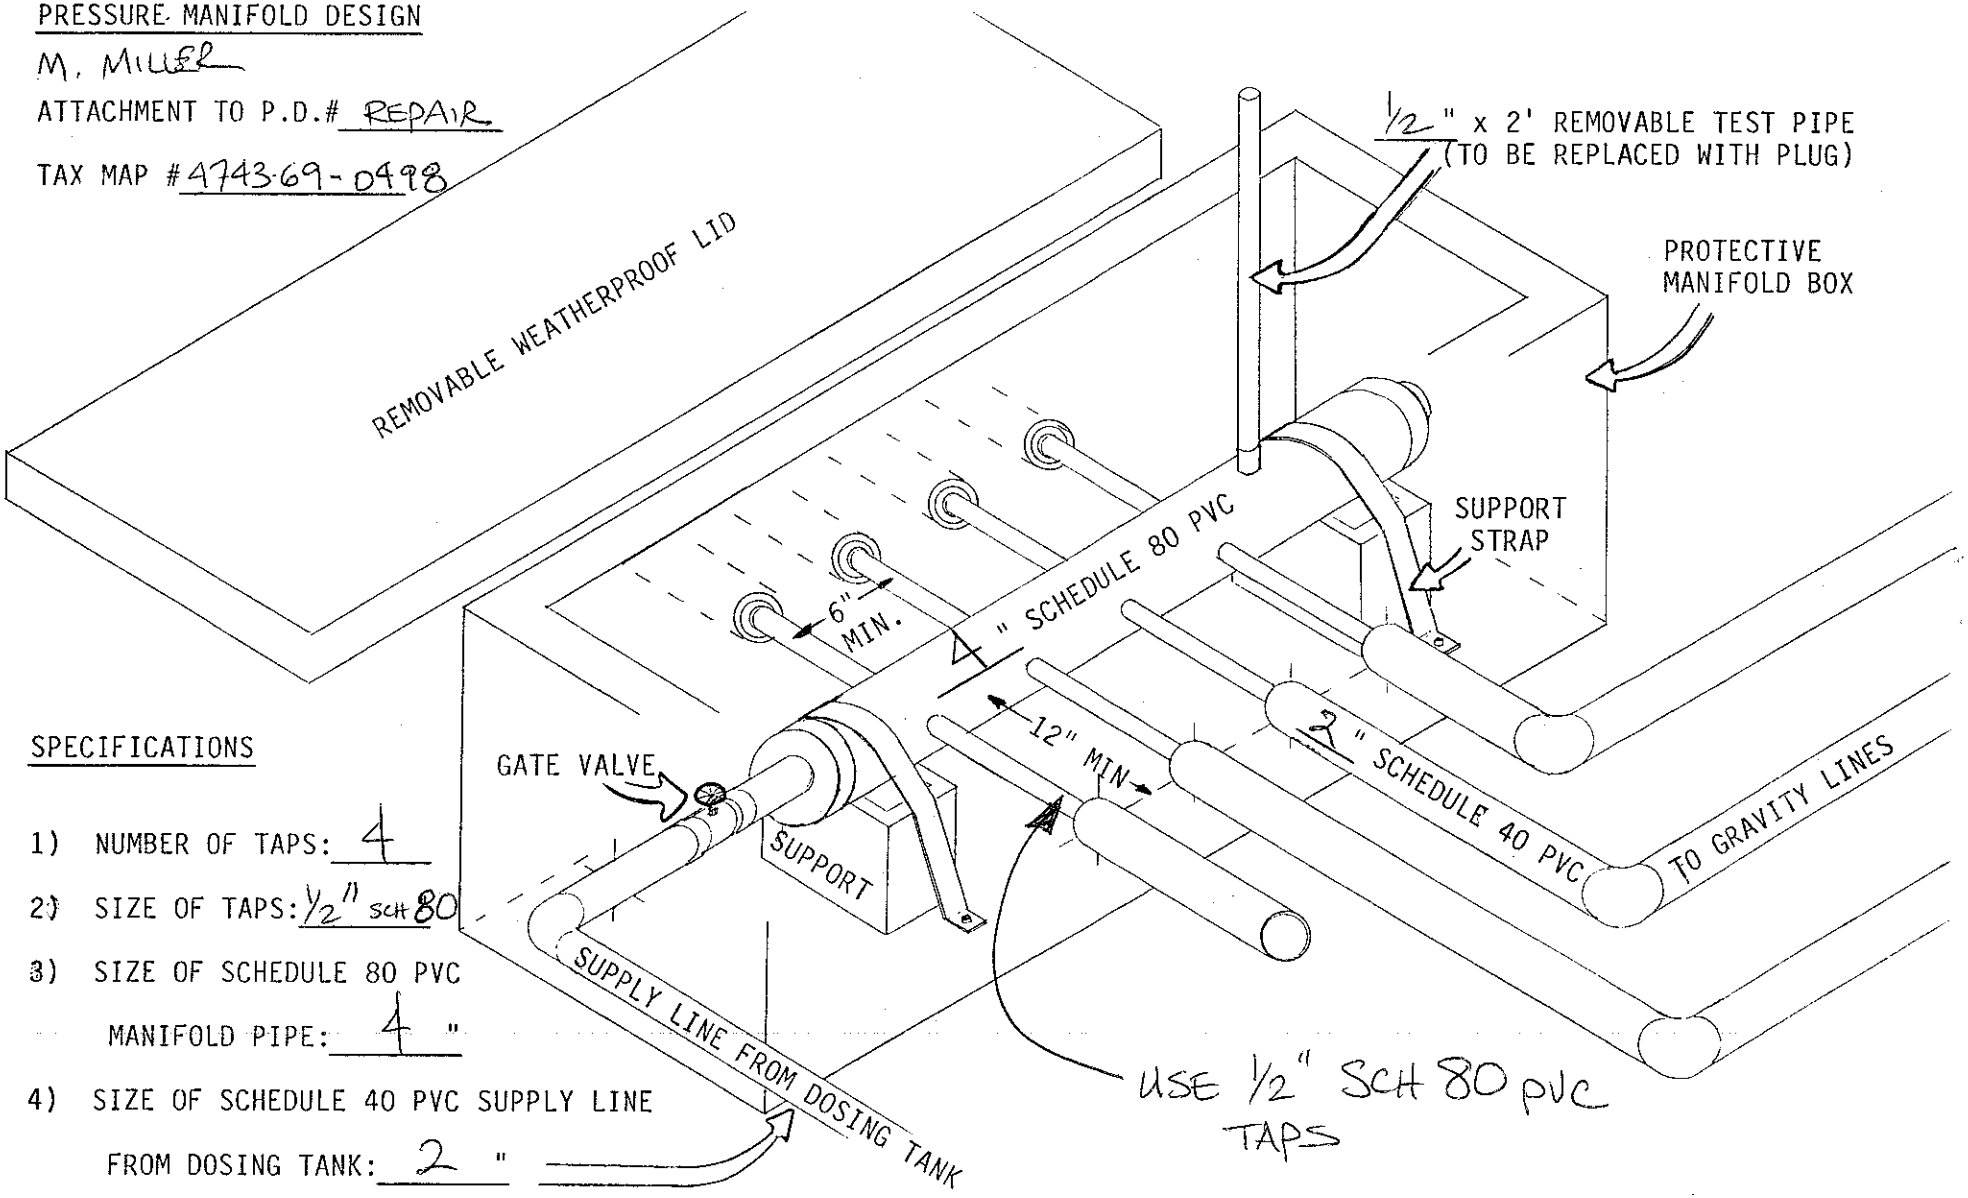

SPECIFICATIONS

1) NUMBER OF TAPS: 4

2) SIZE OF TAPS: ½" sch 80

3) SIZE OF SCHEDULE 80 PVC
MANIFOLD PIPE: 4 "

4) SIZE OF SCHEDULE 40 PVC SUPPLY LINE
FROM DOSING TANK: 2 "