
Attachments "B" / Michael J. Moore
Statesville, N.C.
In #4746-63-3882

PUMP TANK DESIGN

ATTACHMENT TO PROPERTY DESCRIPTION #_____

TAX MAP #_____

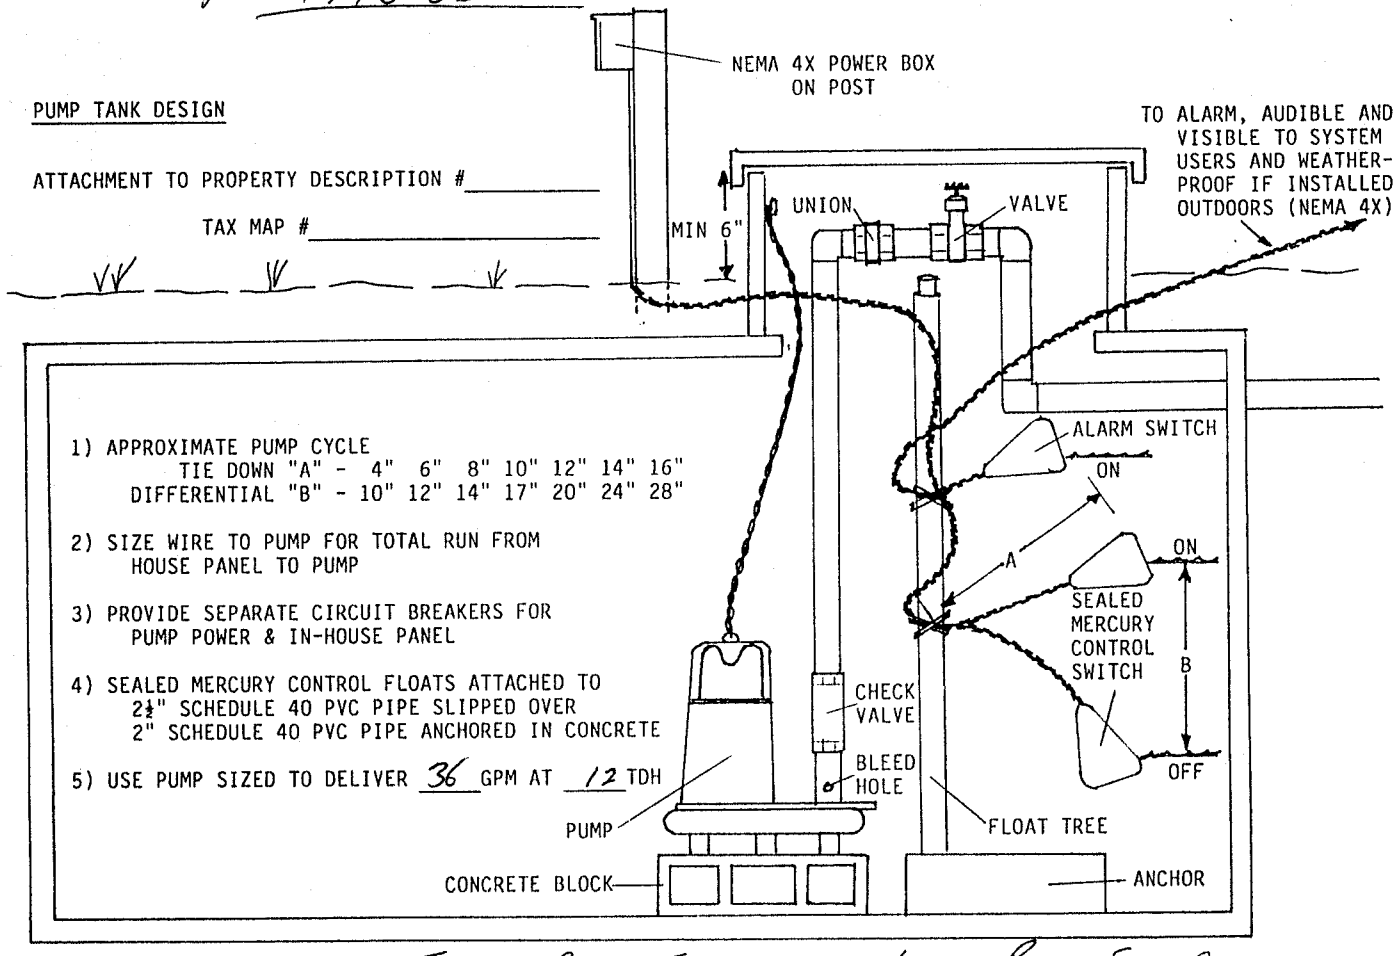

1) APPROXIMATE PUMP CYCLE
   TIE DOWN "A" - 4" 6" 8" 10" 12" 14" 16"
   DIFFERENTIAL "B" - 10" 12" 14" 17" 20" 24" 28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

5) USE PUMP SIZED TO DELIVER 36 GPM AT 12 TDH

Note: Septic Tank + Pump Tank Must be Reenforced.

Health Dept. requires a Certificate or letter from Manufactor Stating Such.