
Date 2-22-12
Date 3-22-12
Plans Approved ONLY
Acknowledgement of

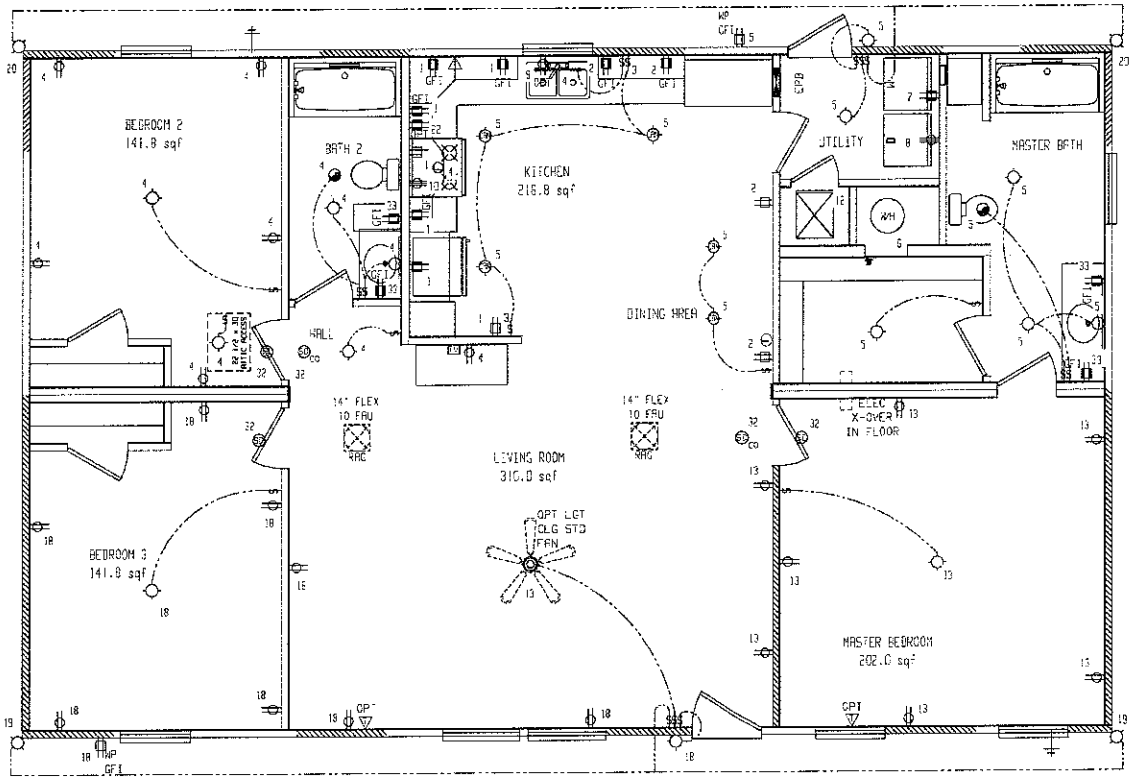

APPROVED BY
NTA INC. 03/16/2011
Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.
Mike Failer

NOTE: ON MODULARS, 15 & 20 AMP BRANCH CIRCUITS SUPPLYING OUTLETS INSTALLED IN DWELLING UNIT FAMILY ROOMS, DINING ROOMS, LIVING ROOMS PARLORS, LIBRARIES, DENS, BEDROOMS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, OR SIMILAR ROOMS OR AREAS MUST BE PROTECTED BY AN ARC-FAULT INTERRUPTER IN ACCORDANCE WITH SECTION 210.12 OF THE NEC. AFCI IS NOT REQUIRED FOR SMOKE DETECTORS IN SOUTH CAROLINA

ELECTRICAL SCHEDULE

CIR. NO.	DESCRIPTION	BRK. AMP.	VOLTS	COPP. WIRE
1	PORTABLE APPLIANCES	20	120	12
2	PORTABLE APPLIANCES	20	120	12
3	PORTABLE APPLIANCES	20	120	12
4	GEN. LIGHTING GFI RCPT.	15	120	14
5	GEN. LIGHTING GFI RCPT.	15	120	14
6	ELEC. WATER HEATER	CIRCUITS VARY, SEE		
DWTR PAGE PLN-3.1 FOR HUB, PLN-3.1 FOR MOD				
7	WASHER RECEPT.	20	120	12
8	DRYER RECEPT.	30	240	10
9	OPT. DISHWASHER	15	120	14
10	ELECT. RANGE/COKTOP	40	240	8
11	GAS FURNACE	15	120	14
12	ELECTRIC FURNACE	CIRCUITS VARY, SEE		
DWTR PAGE PLN-3.5 FOR MOD, PLN-1.5 FOR MOD				
13	GEN. LIGHTING GFI RCPT.	15	120	14
14	OPT. COOLER BOX	15	120	14
15	OPT. GARBAGE DISPOSER	15	120	14
16	FREEZER	20	120	12
17	OPT. WHIRLPOOL	20	120	12
18	GEN. LIGHTING GFI RCPT.	15	120	14
19	GEN. LIGHTING GFI RCPT.	15	120	14
20	GEN. LIGHTING GFI RCPT.	15	120	14
21	GEN. LIGHTING GFI RCPT.	15	120	14
22	OPT. MICROWAVE	20	120	12/2
24	ELECT. BUILT-IN OVEN	20	240	12/3
25	GENERAL LIGHTING	15	120	14
26	GENERAL LIGHTING	15	120	14
27	GENERAL LIGHTING	15	120	14
28	GENERAL LIGHTING	15	120	14
29	GENERAL LIGHTING	15	120	14
30	GENERAL LIGHTING	15	120	14
31	SLTC INSTALLED HEAT PUMP	40	240	8/3
32	SMOKE ALARMS	15	120	14
33	BATH GFI	20	120	12

BRAND: SCHULT
SERIES: AV32

CMH MANUFACTURING, INC.

REVISIONS

	BY	DATE

GENERAL NOTES

LOCK-OUT BREAKER ON CIRCUIT #6

DRAWING TITLE: ELECTRICAL PLAN

MODEL NAME
SQ. FT. 1424

PLANT	DESCRIPTION	MODEL NO.
957	32X48 3BR-2BA	3321

DRAWN BY	ORIG. DATE	DATE PRINTED	SHEET NO.
KLK	03/08/2011	03/11/2011	11-1