4751617365

IREDELL COUNTY HEALTH DEPARTMENT

10407

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Frances Gabriel DATE Dec. 22, '89 PERMIT NO. 5B-A-57

PHONE: Business _____ Home _____

LOCATION 2 1/2 N. on Right TR 1001 (Ostwalt-Amity Rd) 2.9 miles

S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____


House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 4 No. Bathrooms 2

Garbage Disposal Unit	Yes (✓)	No ( )	Character & Porosity of Soil	25 clay
Auto. Dishwasher	Yes (✓)	No ( )	Percolation Rate	fr. 4
Auto. Wash. Machine	Yes (✓)	No ( )	Topography	2% 4
Site ~~Suitable~~ RS	Yes (✓)	No ( )	Depth to Water Table	4+
			Rock or other impervious formations	none obs.

Lot Area 1 AC.

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

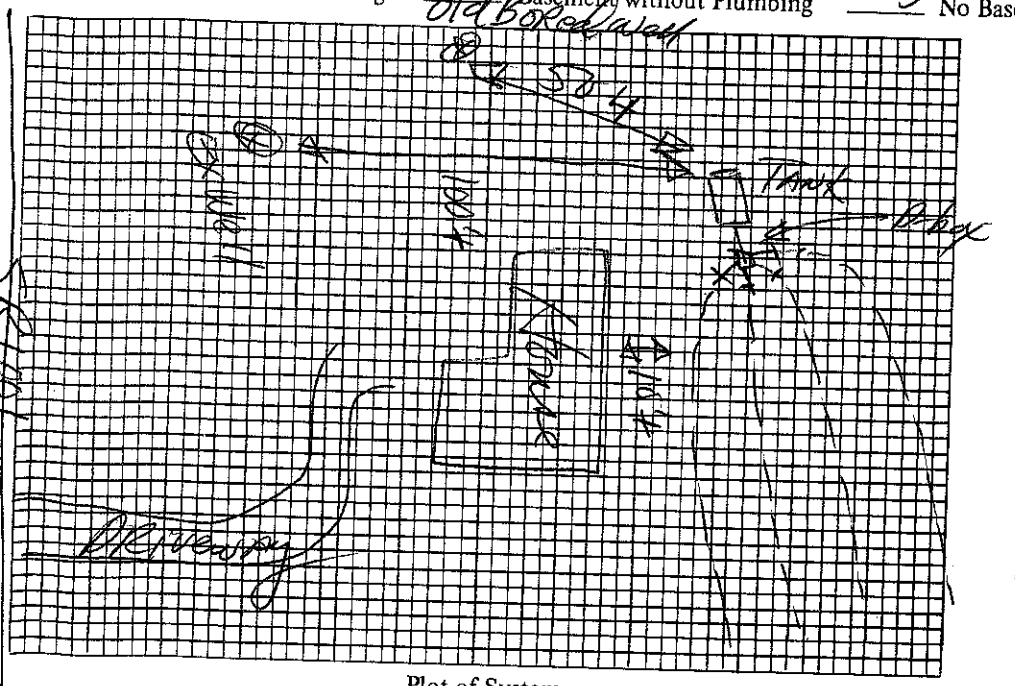

Plot of System

Size of Tank 1500 Gals.

Nitrification Field:
No. of Lines 4
Sq. Ft. 200 Linear Ft. 400
Depth of Stone in Lines 12"

Water Supply: Individual (✓) Ex.
Public ( )

Installed by H E Houston

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY ACP

COMMENTS: _____

CERTIFICATE OF COMPLETION BY D R Fuson, RS DATE 12-22-89

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

rmit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making provements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

10407

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

1530 (HE Houston)

OWNER OR CONTRACTOR Frances Gabriel

PHONE: Business _____ Home 528-6196 DATE 8/28/89 PERMIT NO. SB-A-57

LOCATION 2 I N. TR Ostwalt-Amity Rd. 2.9 miles on R. just before Amity Hill Rd.

SUBDIVISION NAME _____ LOT NO. _____ S. R. No. _____

House ( ) Mobile Home ( ) Business ( ) Other _____ SECTION OR BLOCK NO. _____

No. Bedrooms 4 No. Bathrooms 2

Garbage Disposal Unit	Yes (✓)	No ( )
Auto. Dishwasher	Yes (✓)	No ( )
Auto. Wash. Machine	Yes (✓)	No ( )
Site Suitable	Yes (✓)	No ( )

Lot Area 1 ACRE

Character & Porosity of Soil clayey


Percolation Rate 4 gpd/ft²

Topography 4%

Depth to Water Table 4' +

Rock or other impervious formations none observed

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

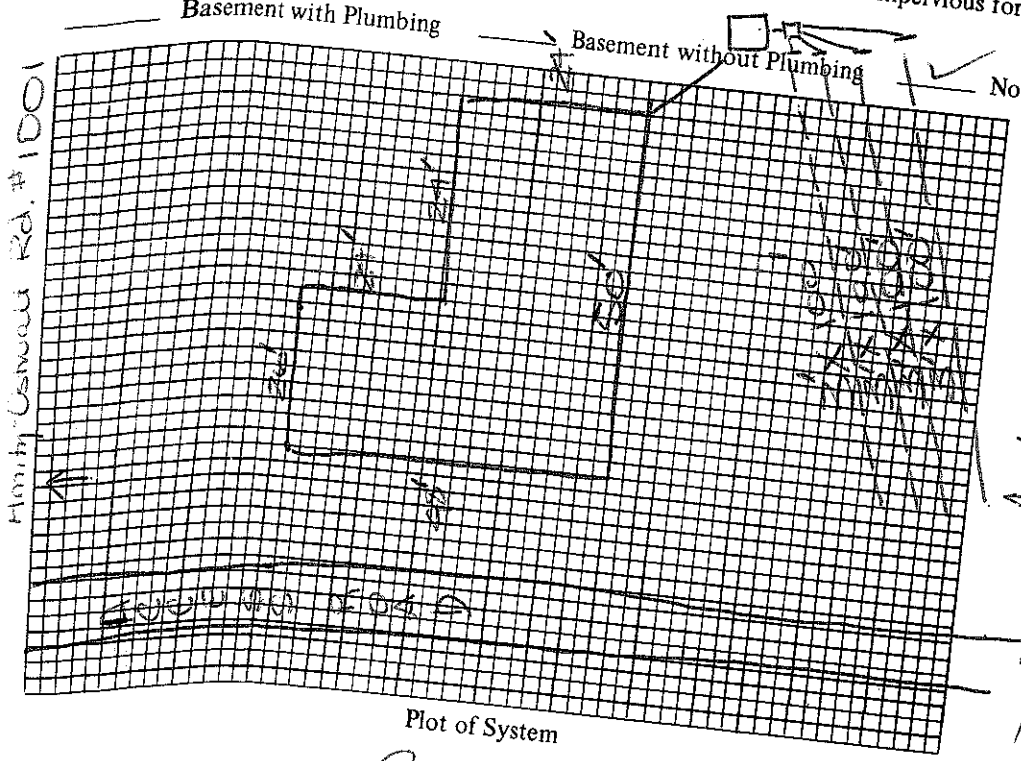

Plot of System

Size of Tank 1500 Gals.

Nitrification Field:


No. of Lines 4

Sq. Ft. 1200 Linear Ft. 400

Depth of Stone in Lines 12"

Water Supply: Individual (✓) next door

Public ( )




Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Mickey Pelle

IMPROVEMENTS PERMIT BY Andrew C. Pierce, R.S.

COMMENTS: Install system at a shallow depth of 30" to bottom of the ~~trenches~~ ditches.

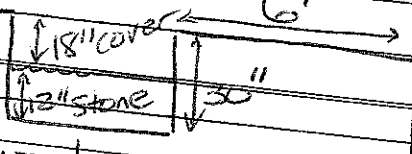

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

ermit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making
provements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold