
Part of Michael F. Crimi Septic System Plan

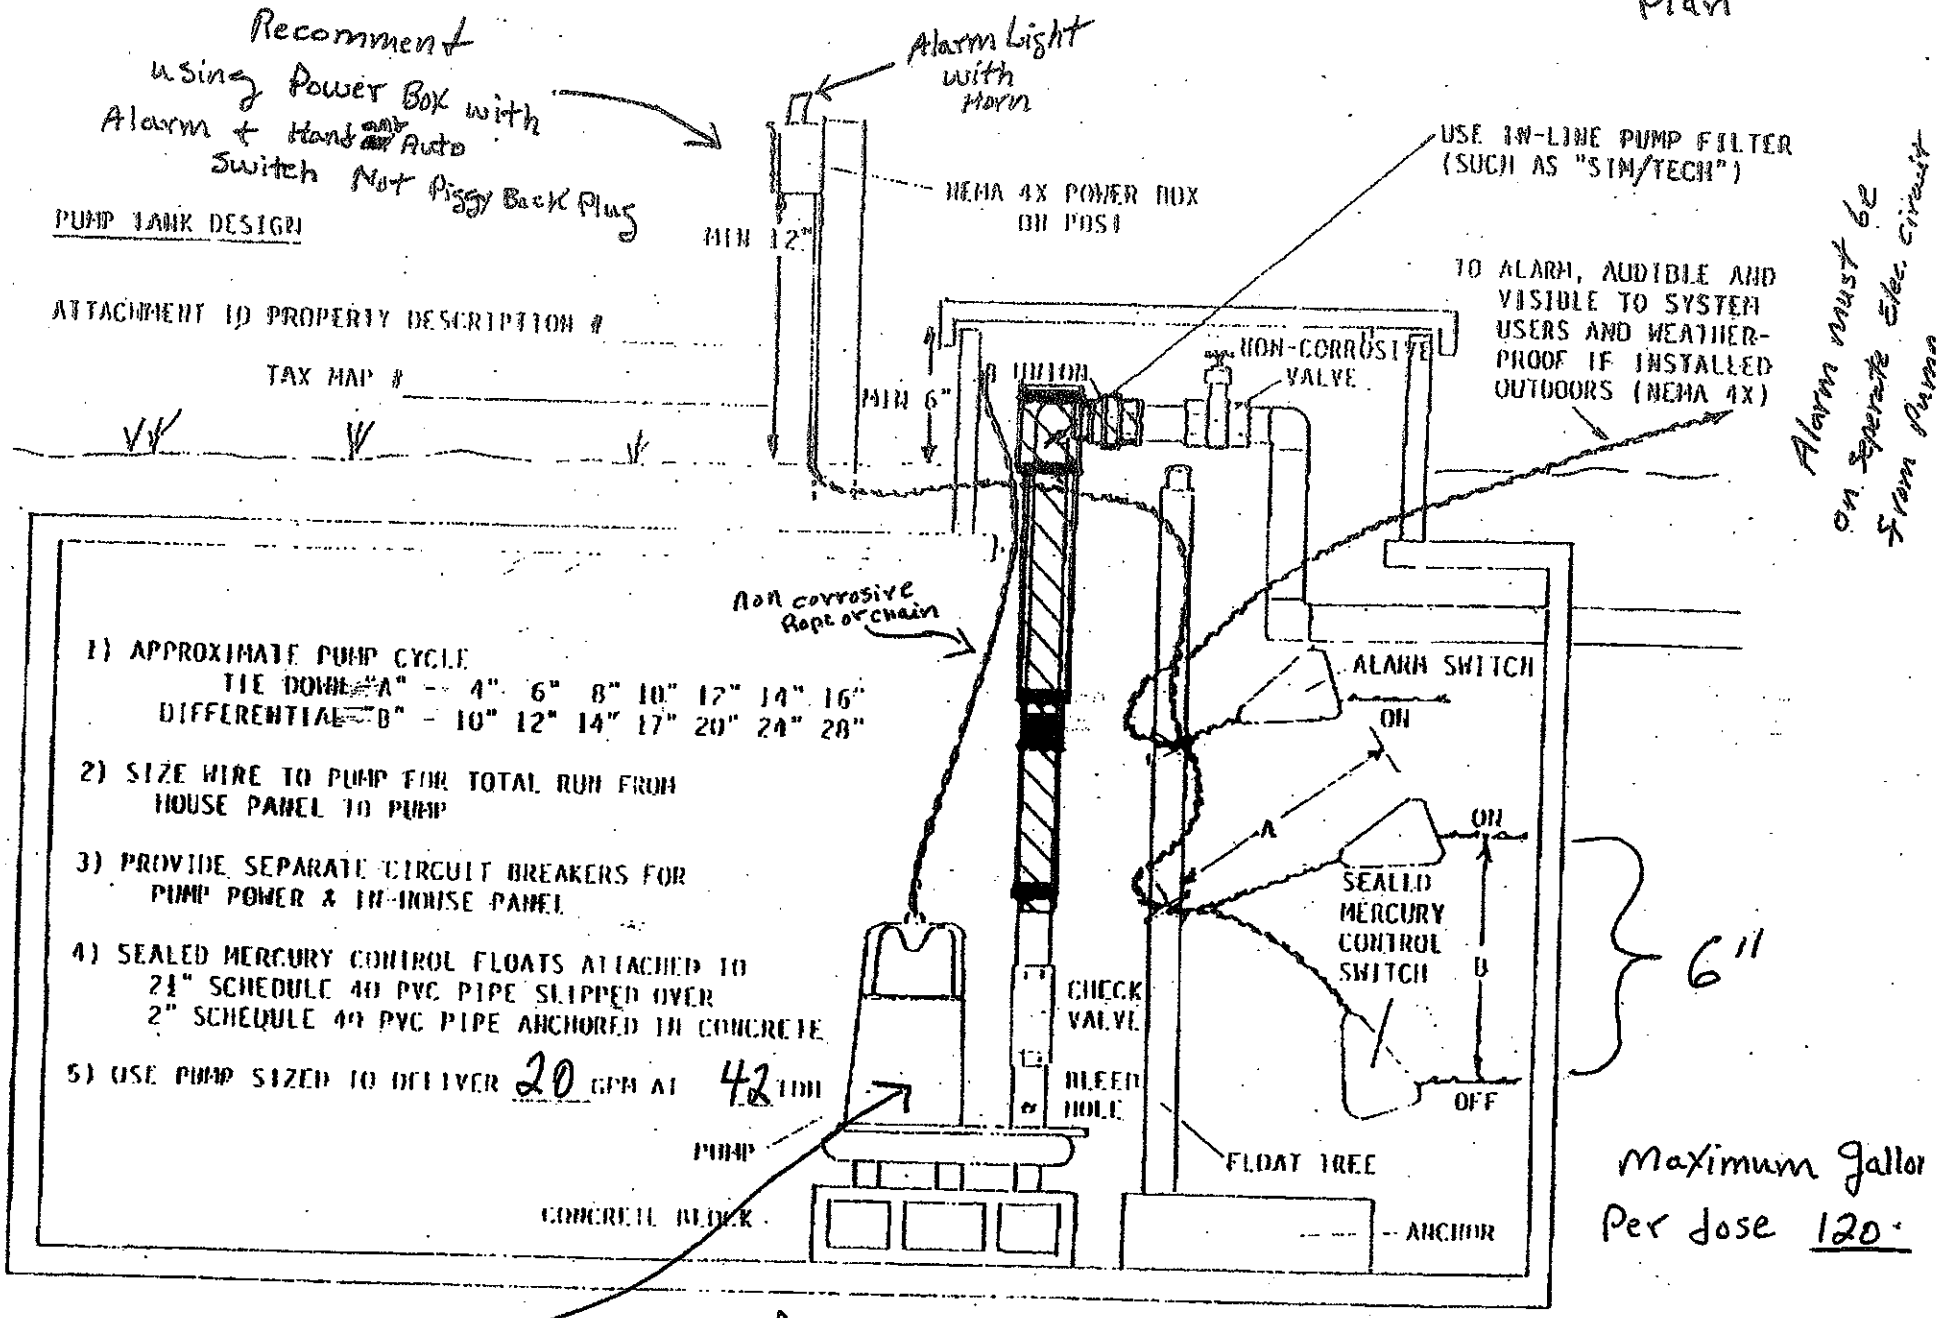


Maximum Gallon Per dose 120.

Recommend using Goulds Model 3885 Series WE nmH

1000 gallon Pump Tank

PAGE 01
INDELL ENVHLTH STVL

Part of Michael F. Crimi Septic System Plan

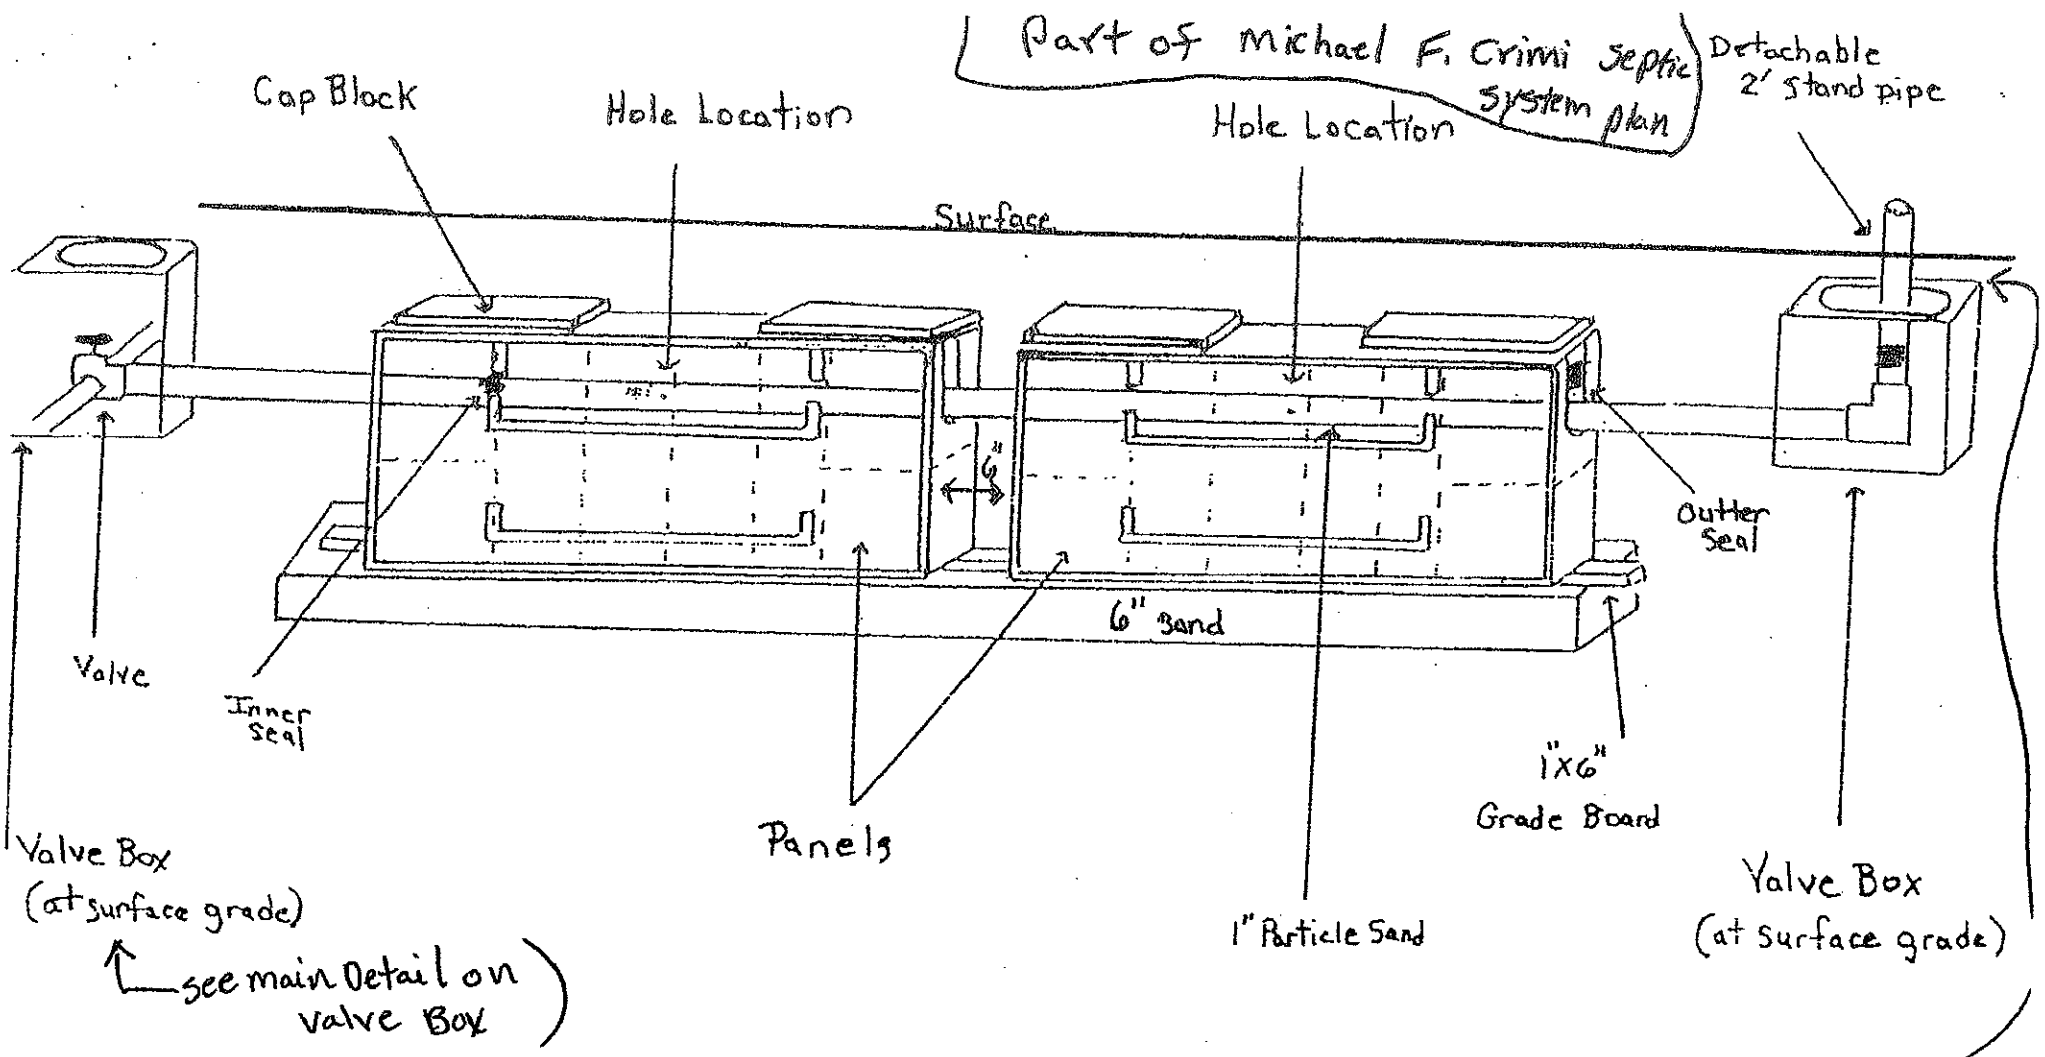


↑ see main Detail on valve Box

Pressure Dosed PPBPS

# of panels 33.
Size holes 3/16". 1 hole per panel.
Approximate amount of sand needed 25 Tons
100lbs. of partical sand per 8 panels.
Sidewalls raked and limed.
GPM 20.
TDH 42.

Comments

Have Box Lid at Finish Grade or slightly Above

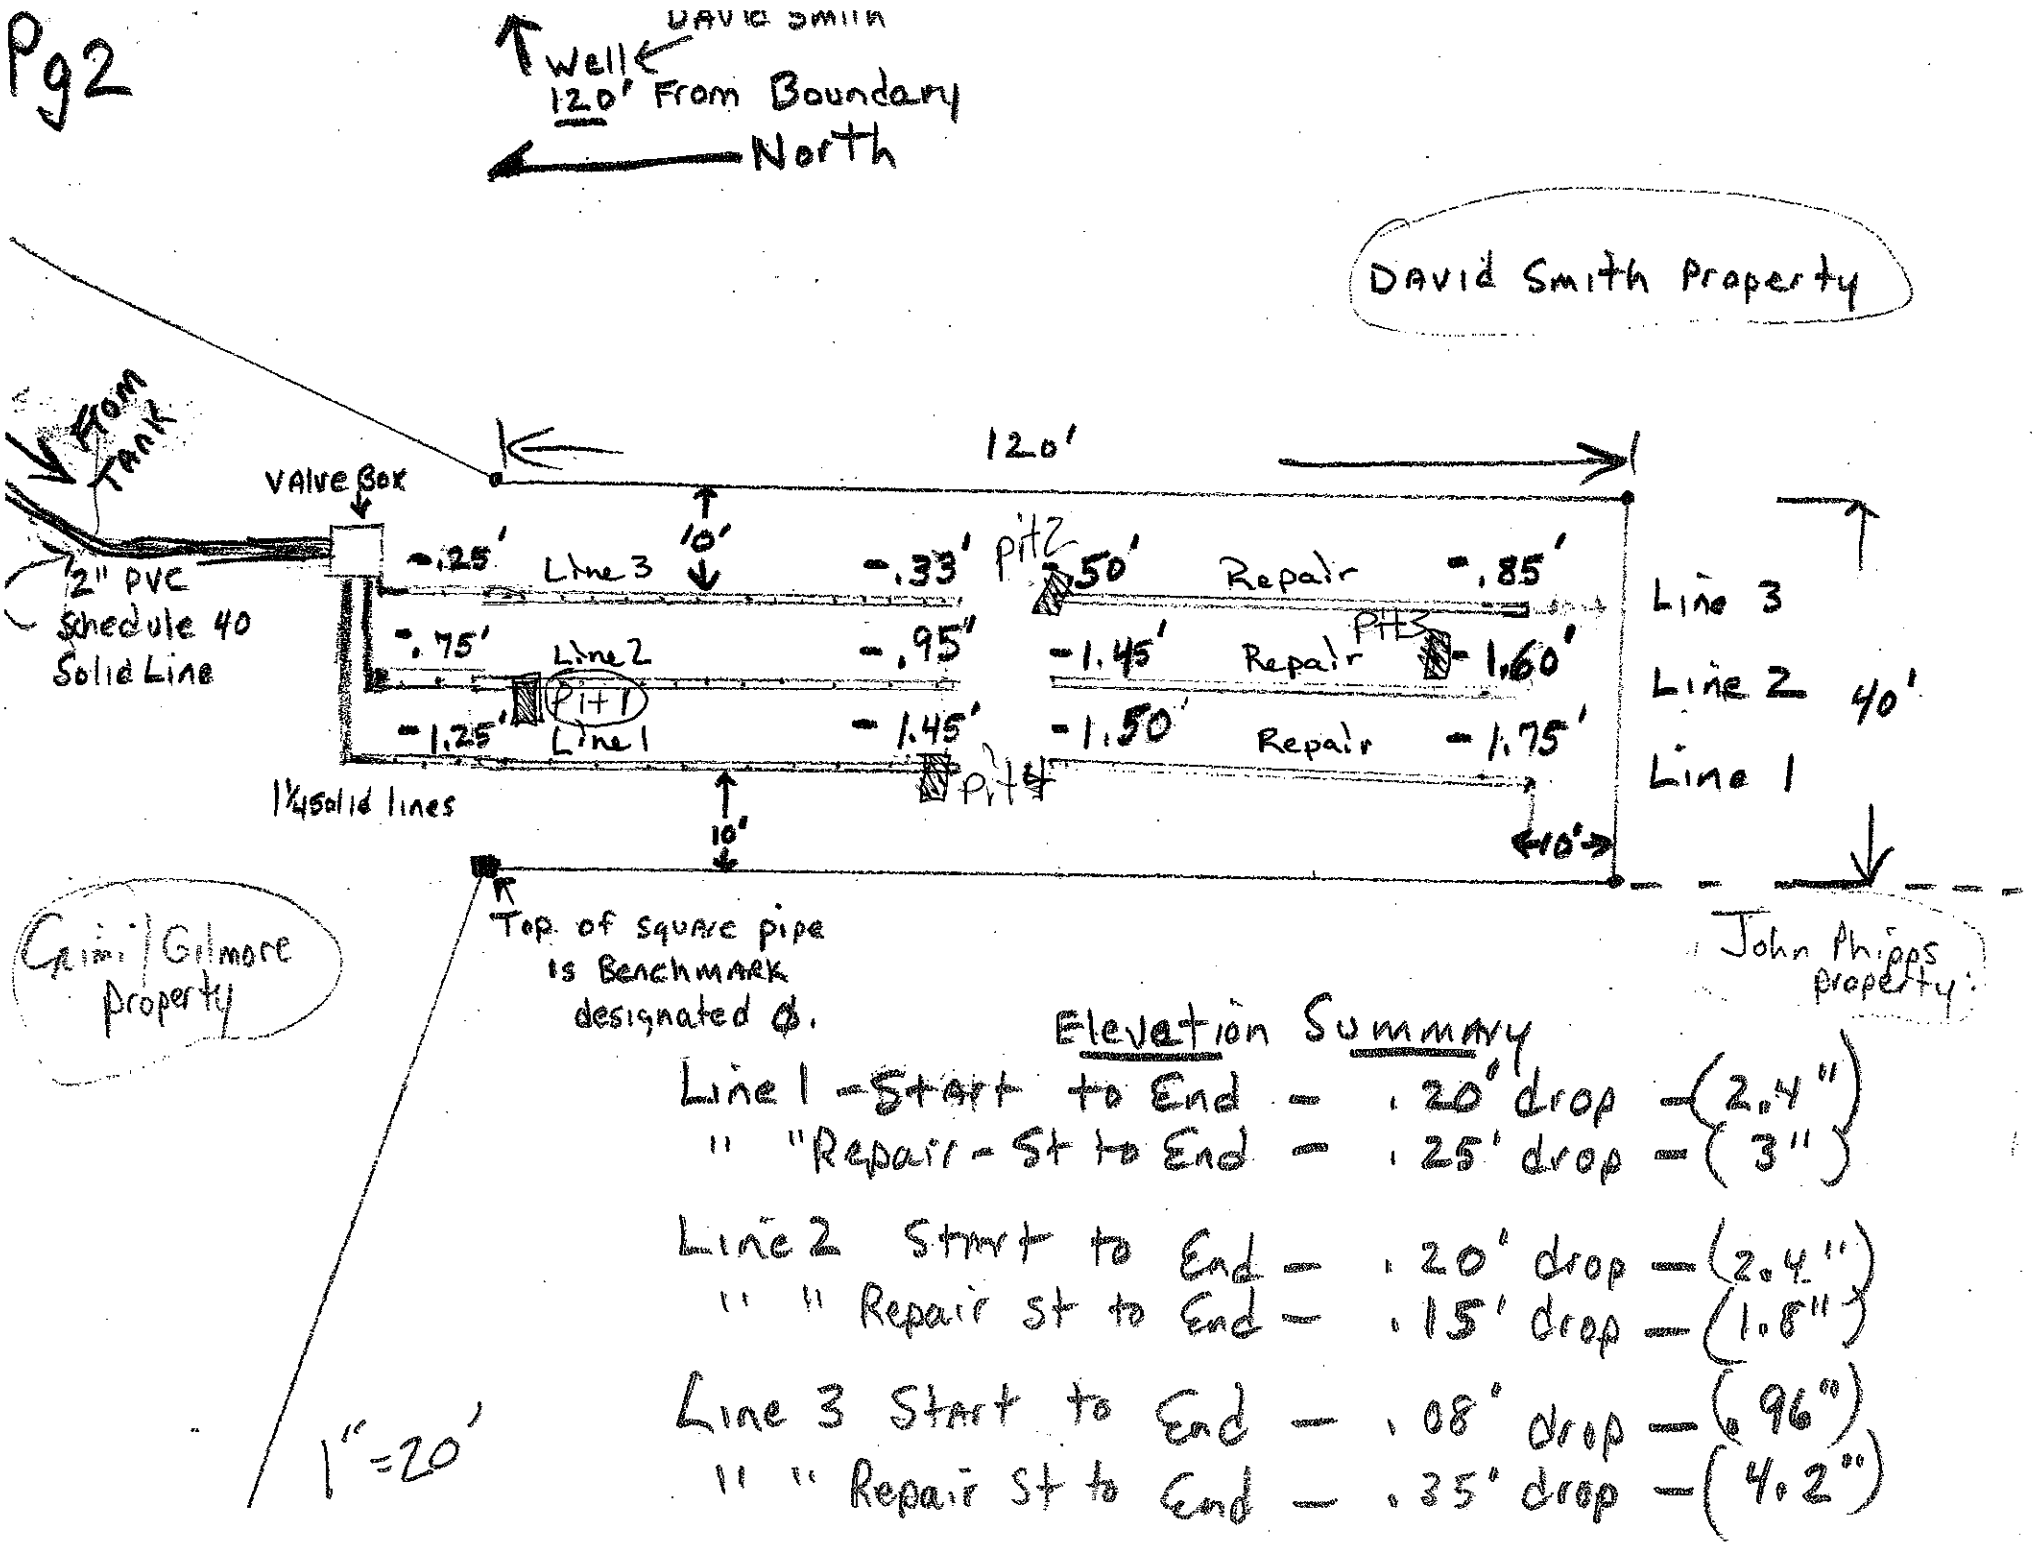

Elevation Summary

Line 1 - Start to End — .20' drop — (2.4")
" "Repair - St to End — .25' drop — (3")

Line 2 Start to End — .20' drop — (2.4")
" " Repair st to End — .15' drop — (1.8")

Line 3 Start to End — .08' drop — (.96")
" " Repair St to End — .35' drop — (4.2")