IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Tommy LAPISH DATE 7-6-83 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION Shiloh Church Rd., T.L. on Clements Rd., then T.L. on Lakeside Rd (gravel) .1/4 mi. on R. S. R. No. _____

SUBDIVISION NAME Crestview Acres LOT NO. 43 SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other _____


No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes ( ) No (✓)
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes (✓) No ( )

Character & Porosity of Soil cecil clay loam
Percolation Rate 1 5gal/sq. ft.
Topography 2-6%
Depth to Water Table 10+
Rock or other impervious formations none

Lot Area 100' x 200'

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

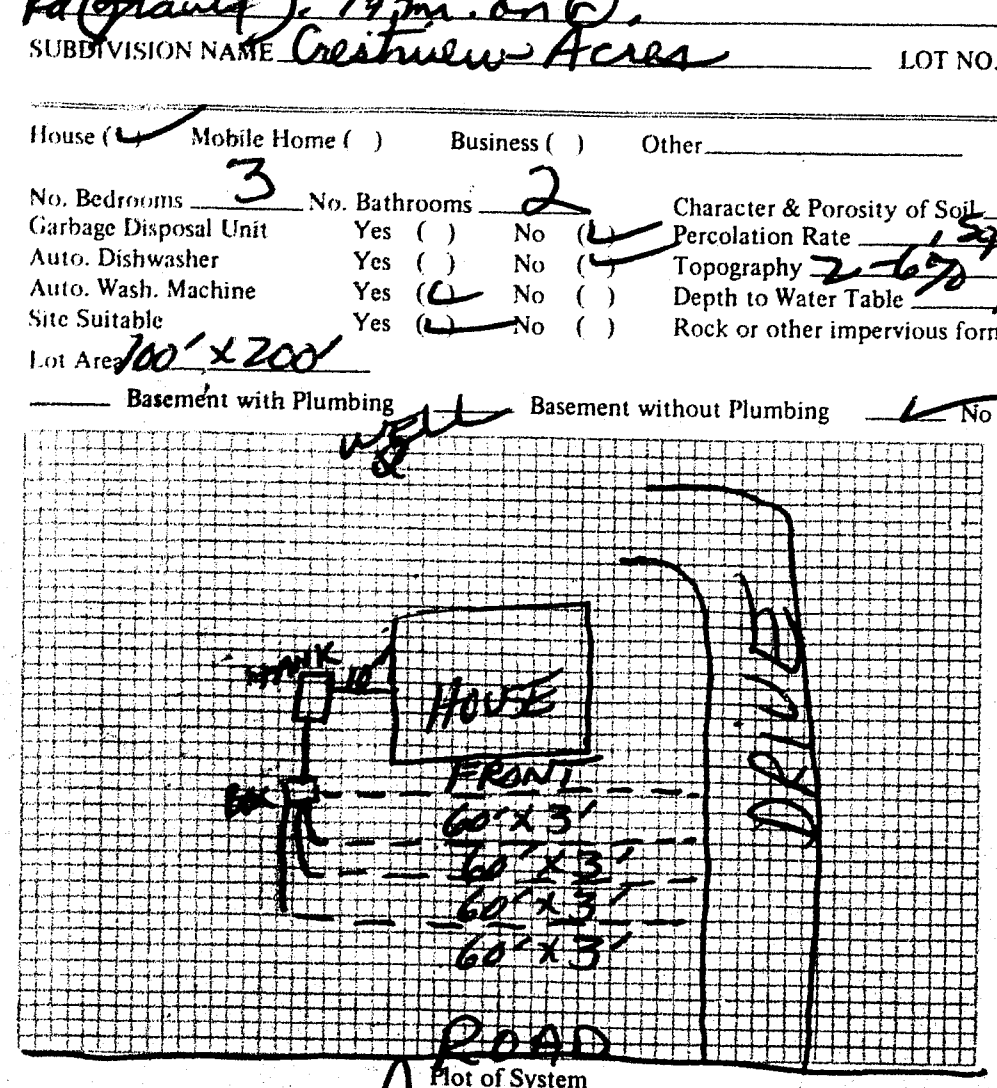

Plot of System

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 4
Sq. Ft. 720 Linear Ft. 240
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by Robert Hoke

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY J. C. Moore

COMMENTS: _____

CERTIFICATE OF COMPLETION BY Steve Braun DATE 7-6-83

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold