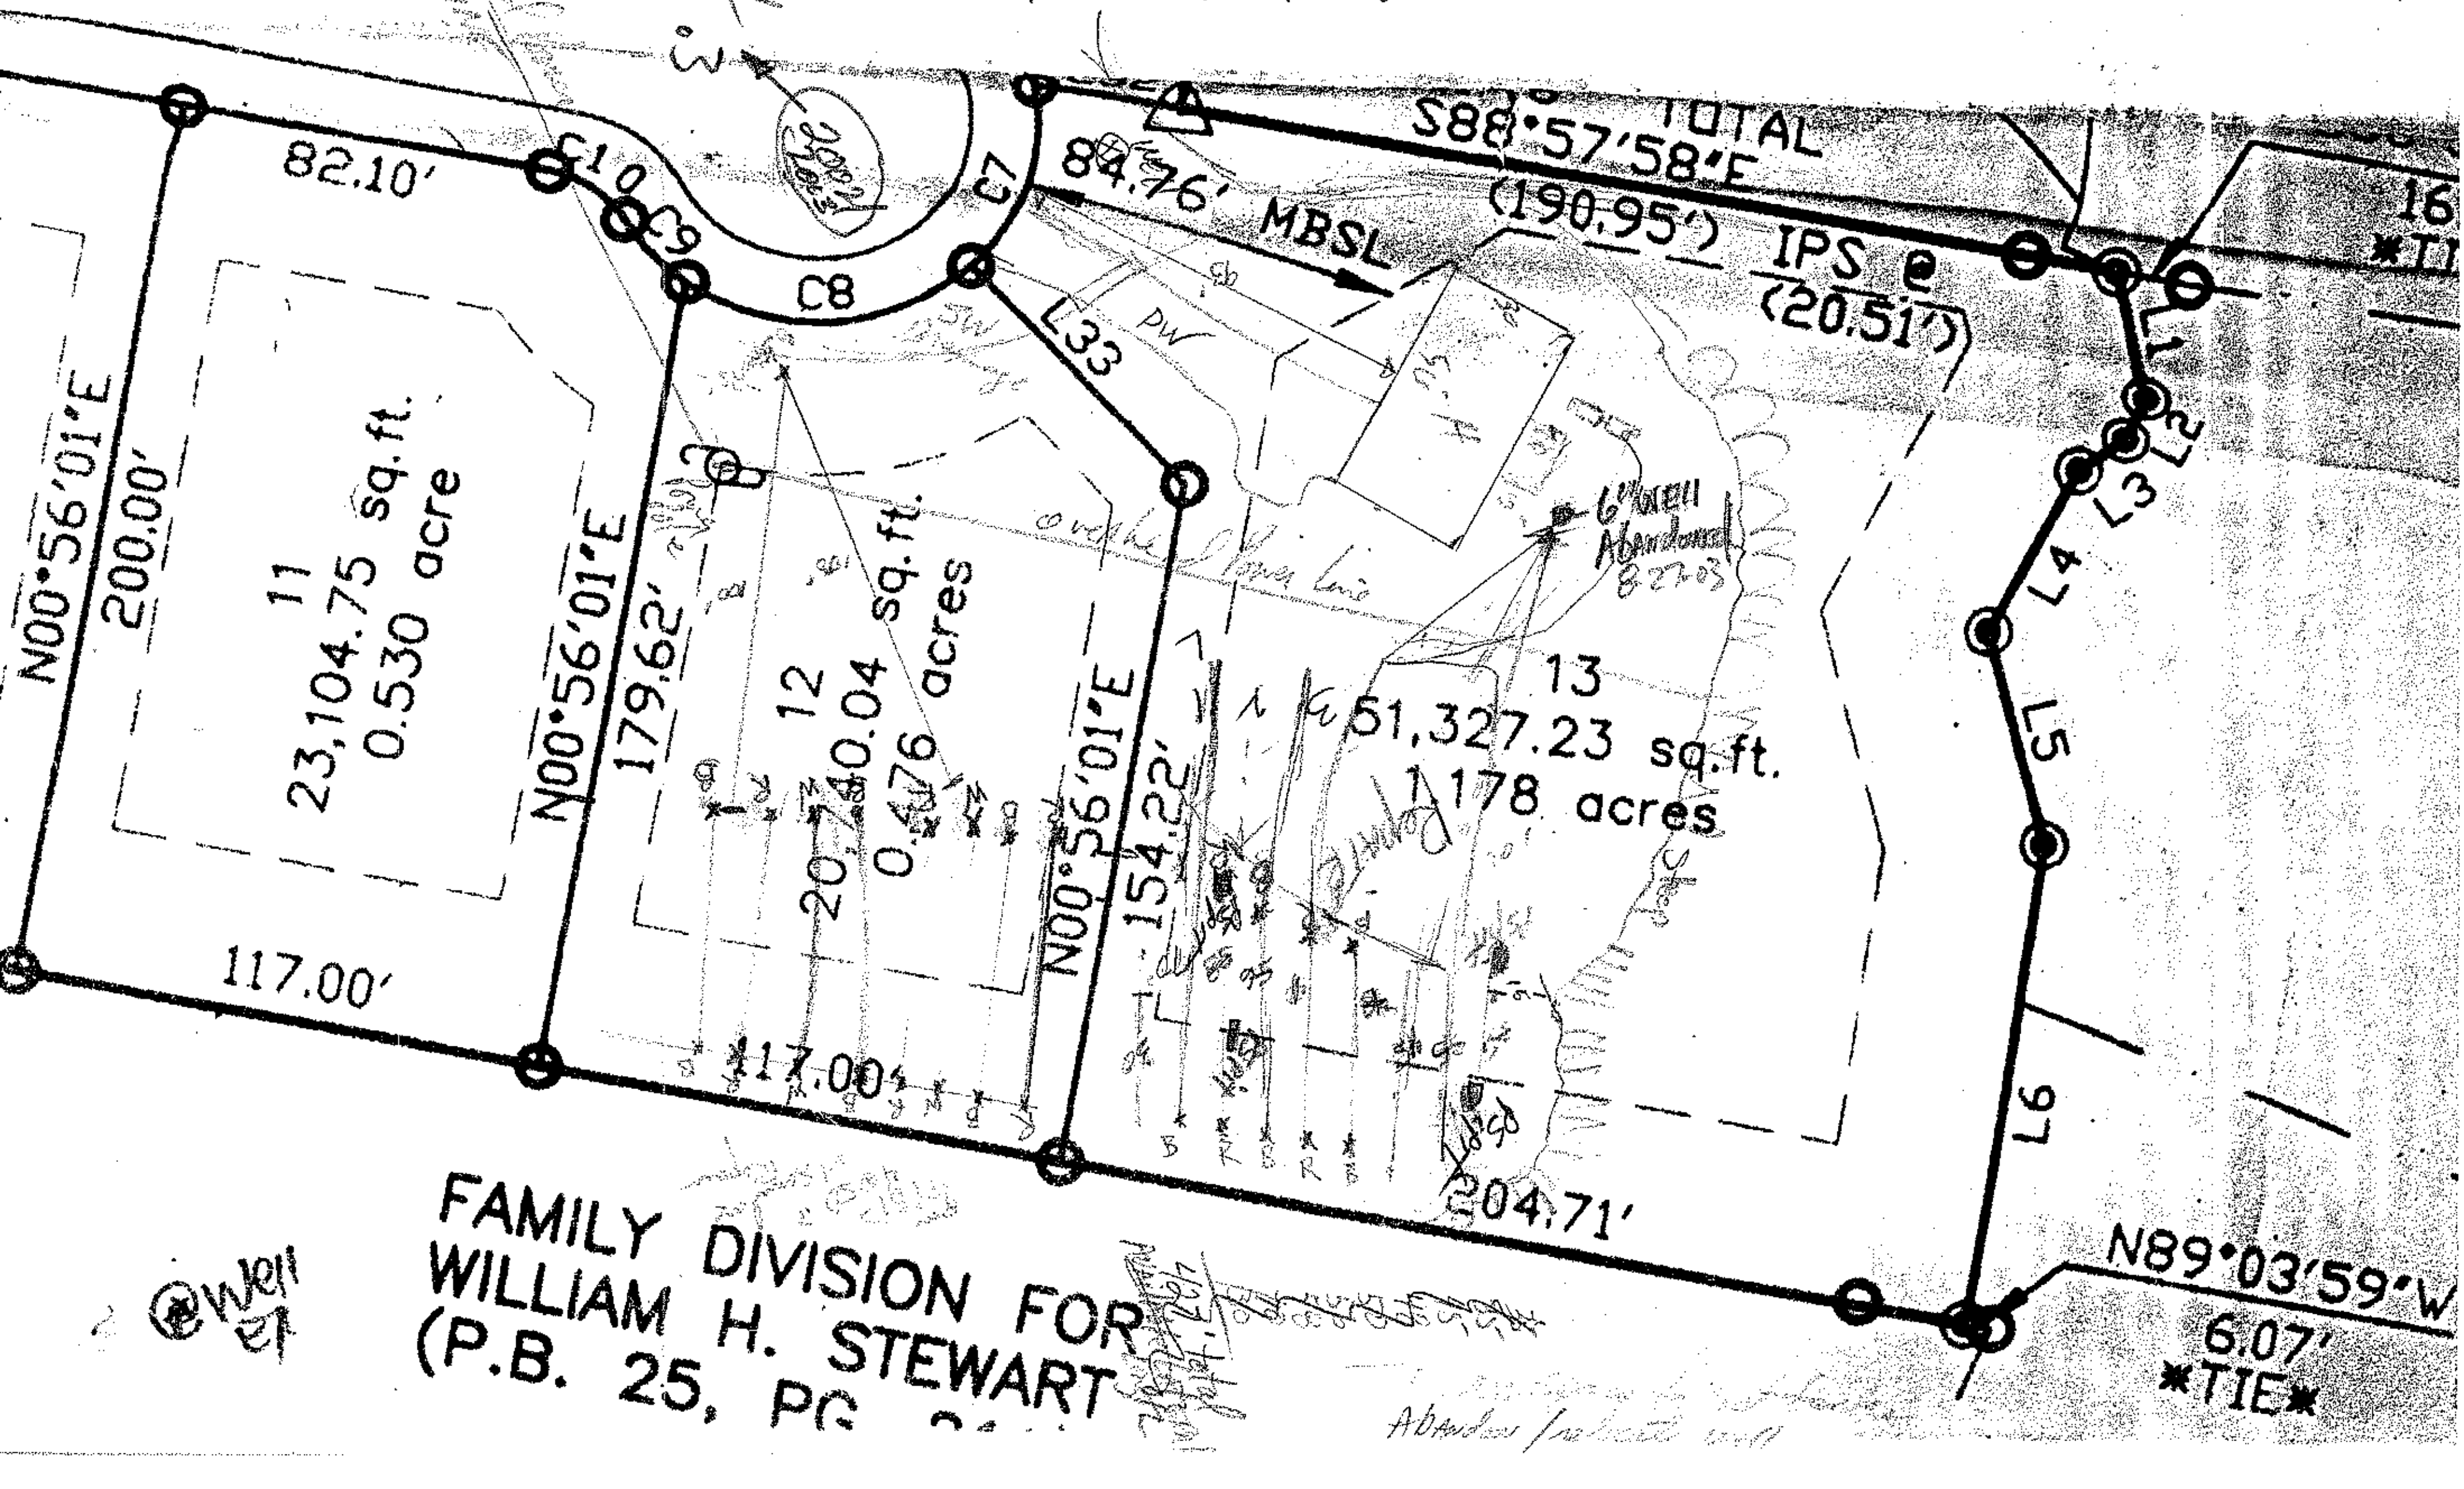


Can overhead power lines be moved

#13 ... Repair

4 BHpits IN System & Repair Area

All pits were ps Rd/cL w/few-med sap @3

Soil sheet lost.

DRH

8-12% slope across drainfield area