
Repair Permit - David Gryder

Oak Grove Rd.

PRESSURE MANIFOLD DESIGN

ATTACHMENT TO P.D.#_____

TAX MAP #_____

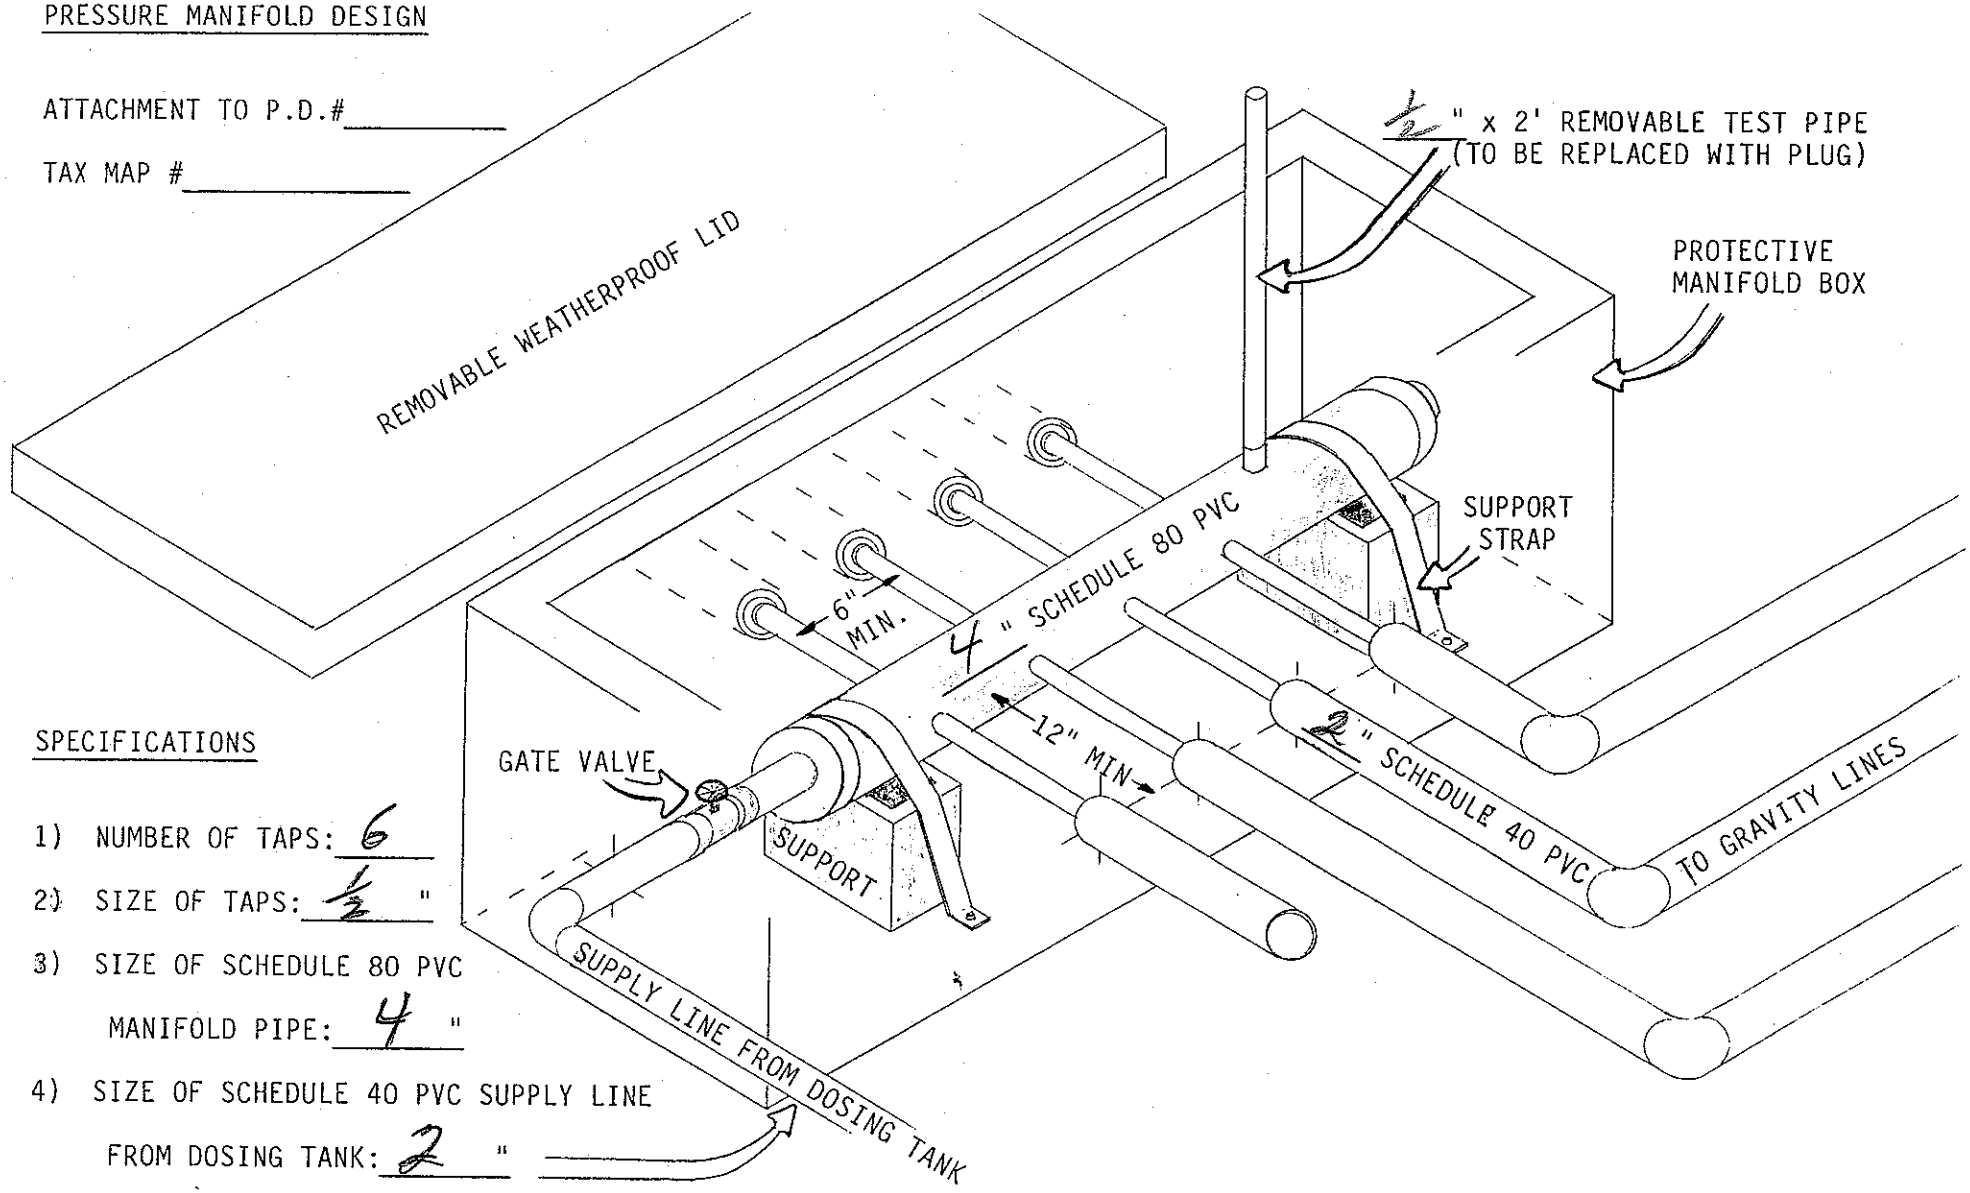

SPECIFICATIONS

1) NUMBER OF TAPS: 6

2) SIZE OF TAPS: ½ "

3) SIZE OF SCHEDULE 80 PVC
MANIFOLD PIPE: 4 "

4) SIZE OF SCHEDULE 40 PVC SUPPLY LINE
FROM DOSING TANK: 2 "


Repair Permit – David Gryder

Oak Grove Rd

PUMP TANK DESIGN

ATTACHMENT TO PROPERTY DESCRIPTION #_____

TAX MAP #_____

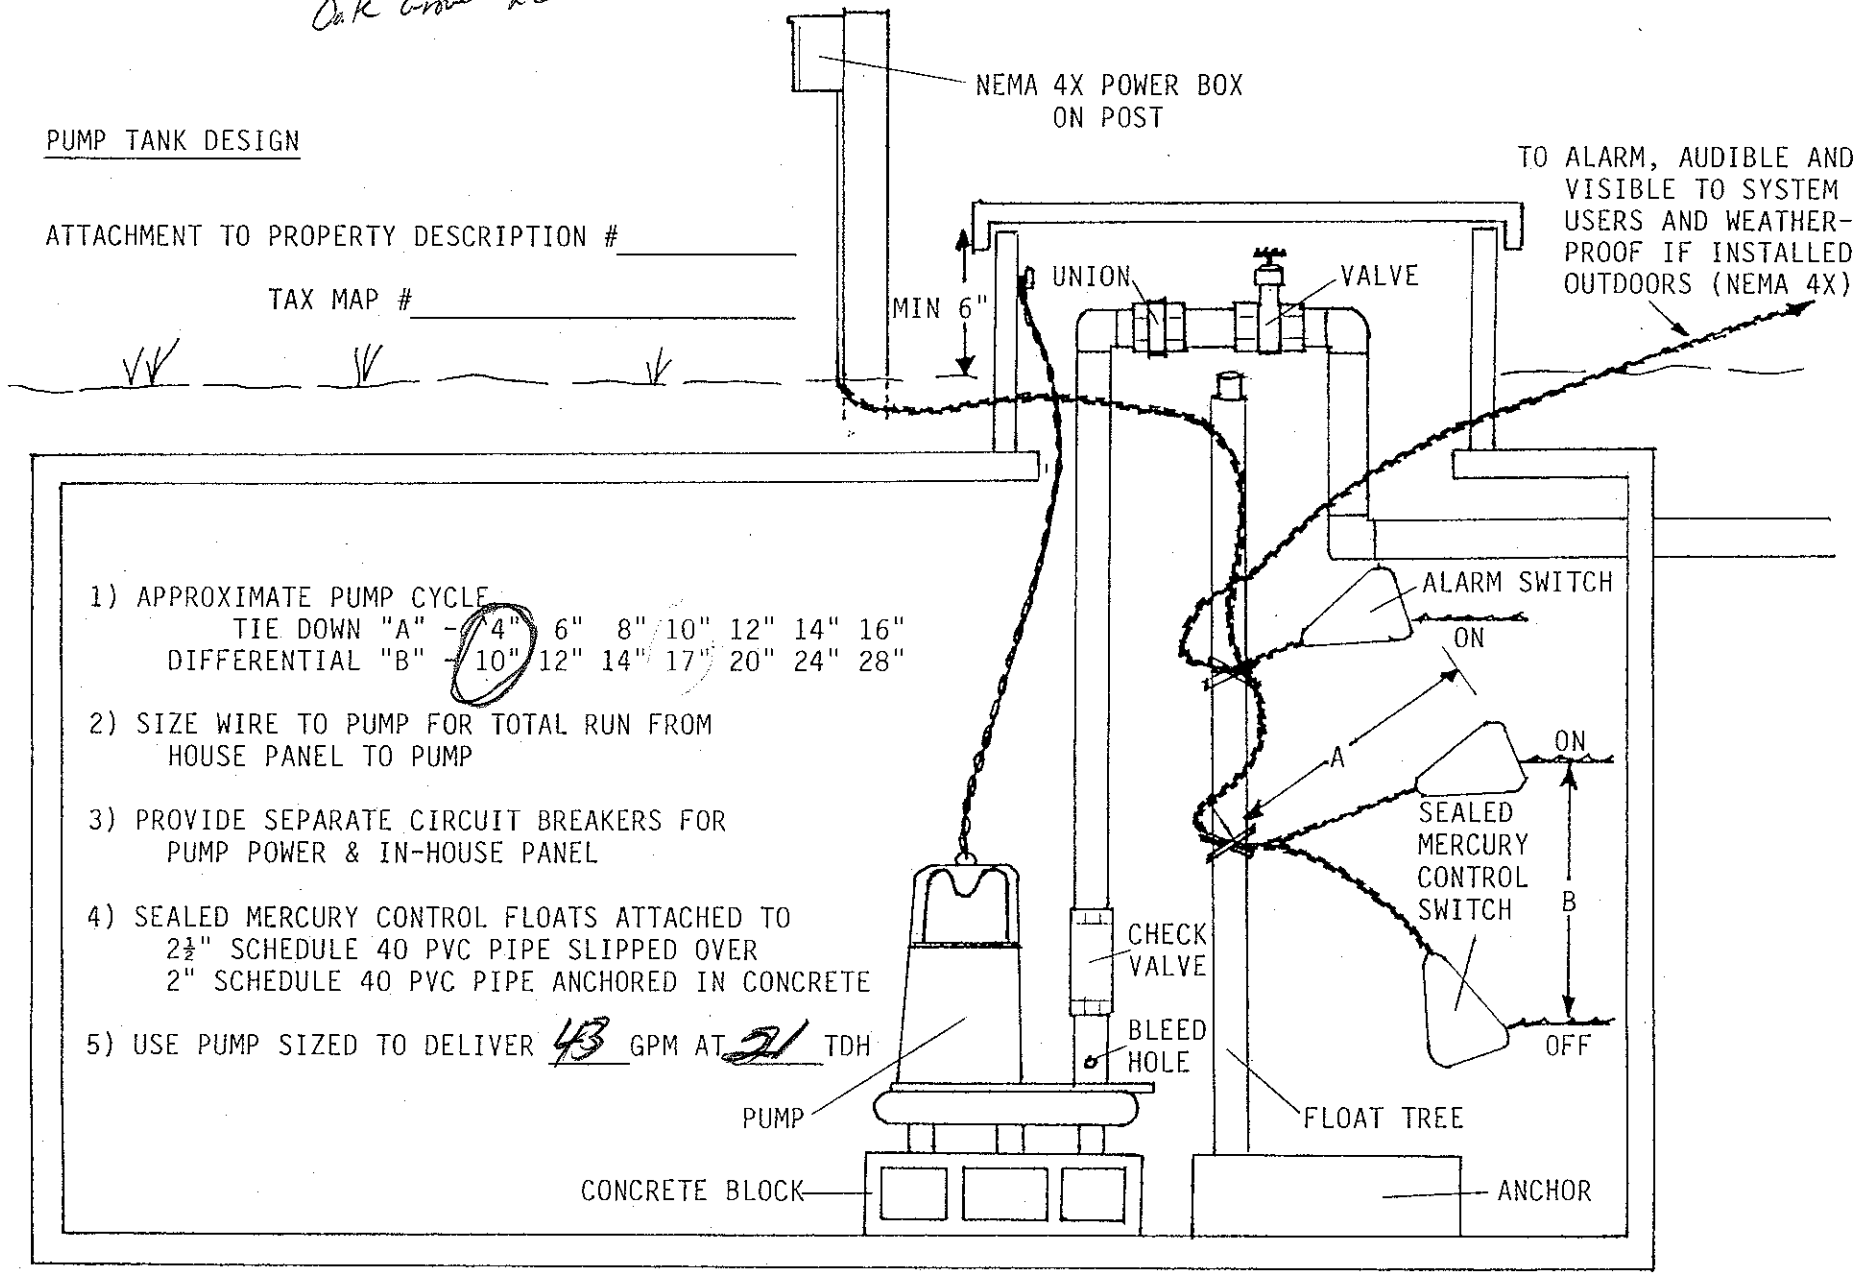

1) APPROXIMATE PUMP CYCLE
TIE DOWN "A" – (4") 6" 8" 10" 12" 14" 16"
DIFFERENTIAL "B" – (10") 12" 14" 17" 20" 24" 28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

5) USE PUMP SIZED TO DELIVER 43 GPM AT 21 TDH