
Sunwood Energy
Meadowview lot 22
Attach to Permit as
part of Permit.

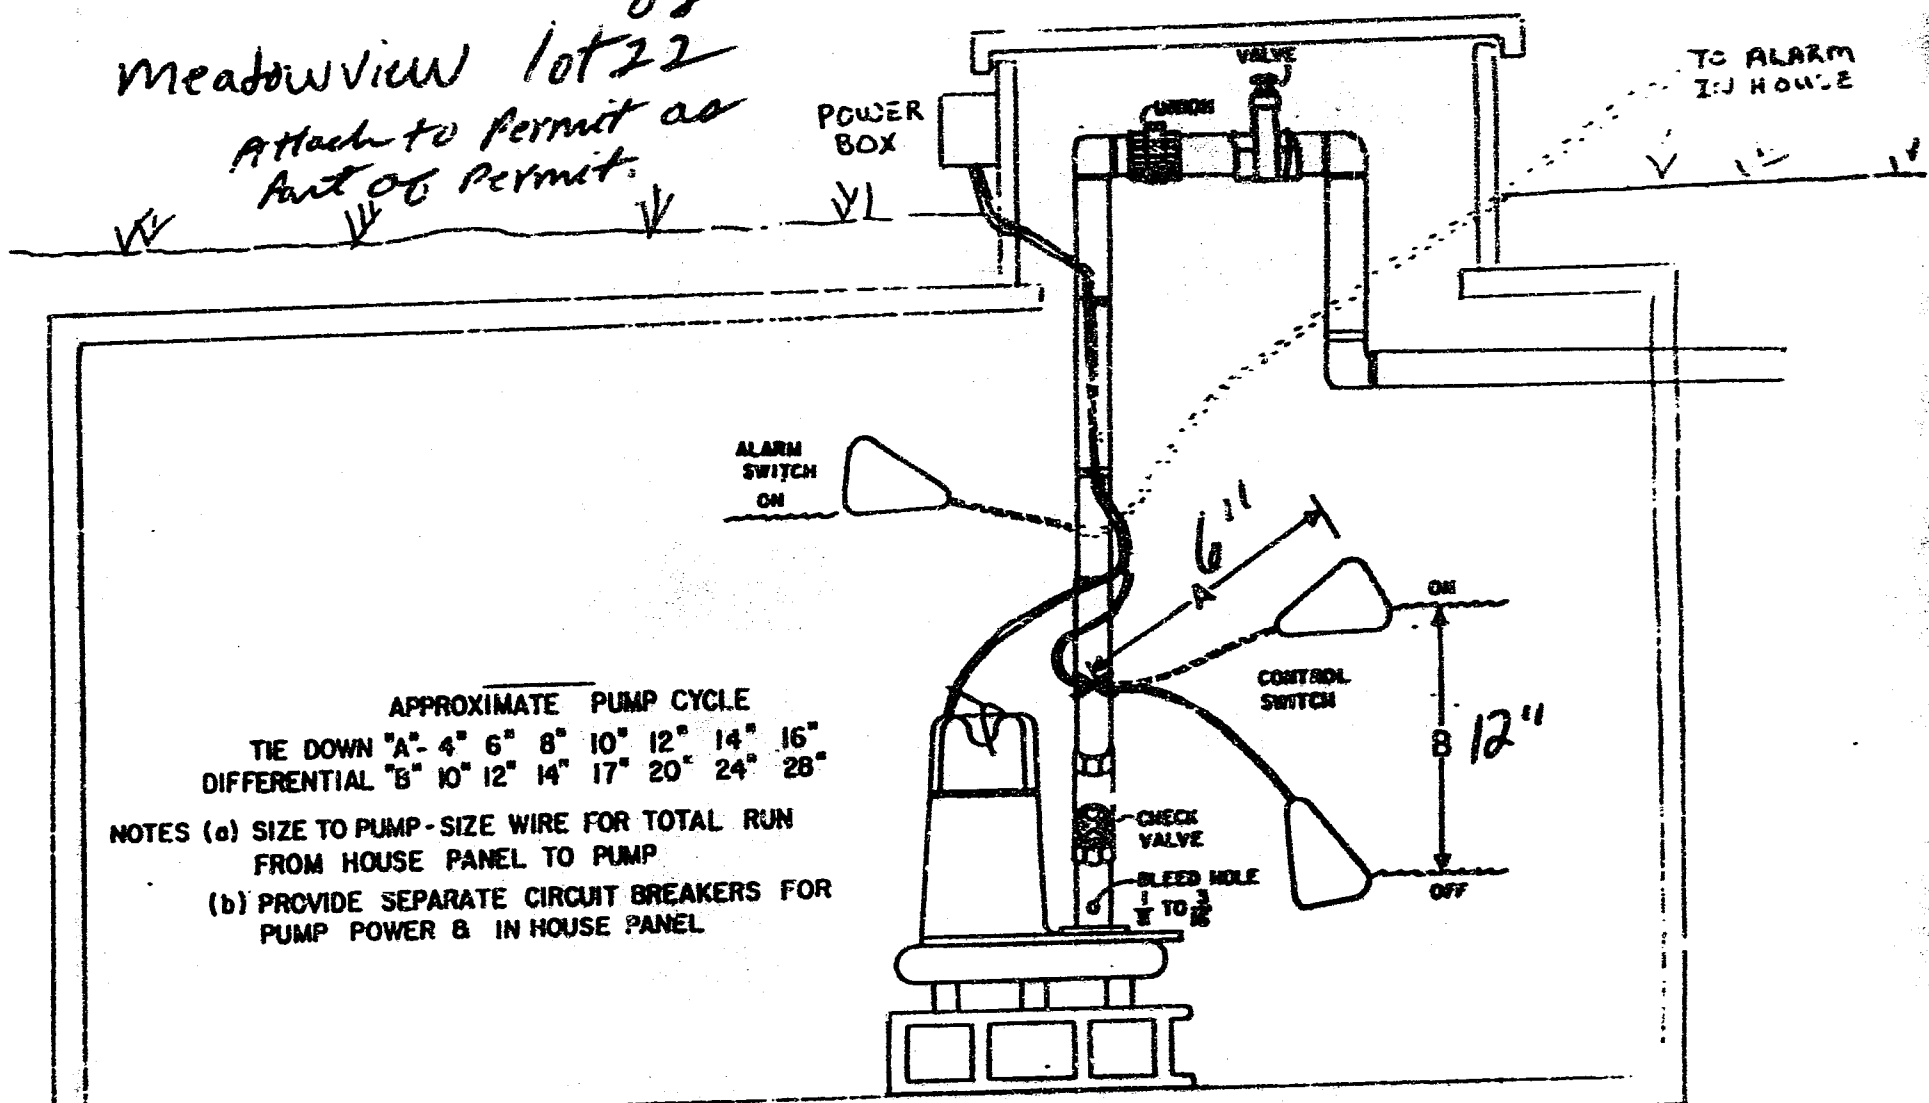

APPROXIMATE PUMP CYCLE

TIE DOWN "A"	4"	6"	8"	10"	12"	14"	16"
DIFFERENTIAL "B"	10"	12"	14"	17"	20"	24"	28"

NOTES (a) SIZE TO PUMP - SIZE WIRE FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

(b) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN HOUSE PANEL