
BETHANY TRACE LOT 39/40

PUMP TANK DESIGN

ATTACHMENT TO PROPERTY DESCRIPTION #_____

TAX MAP #_____

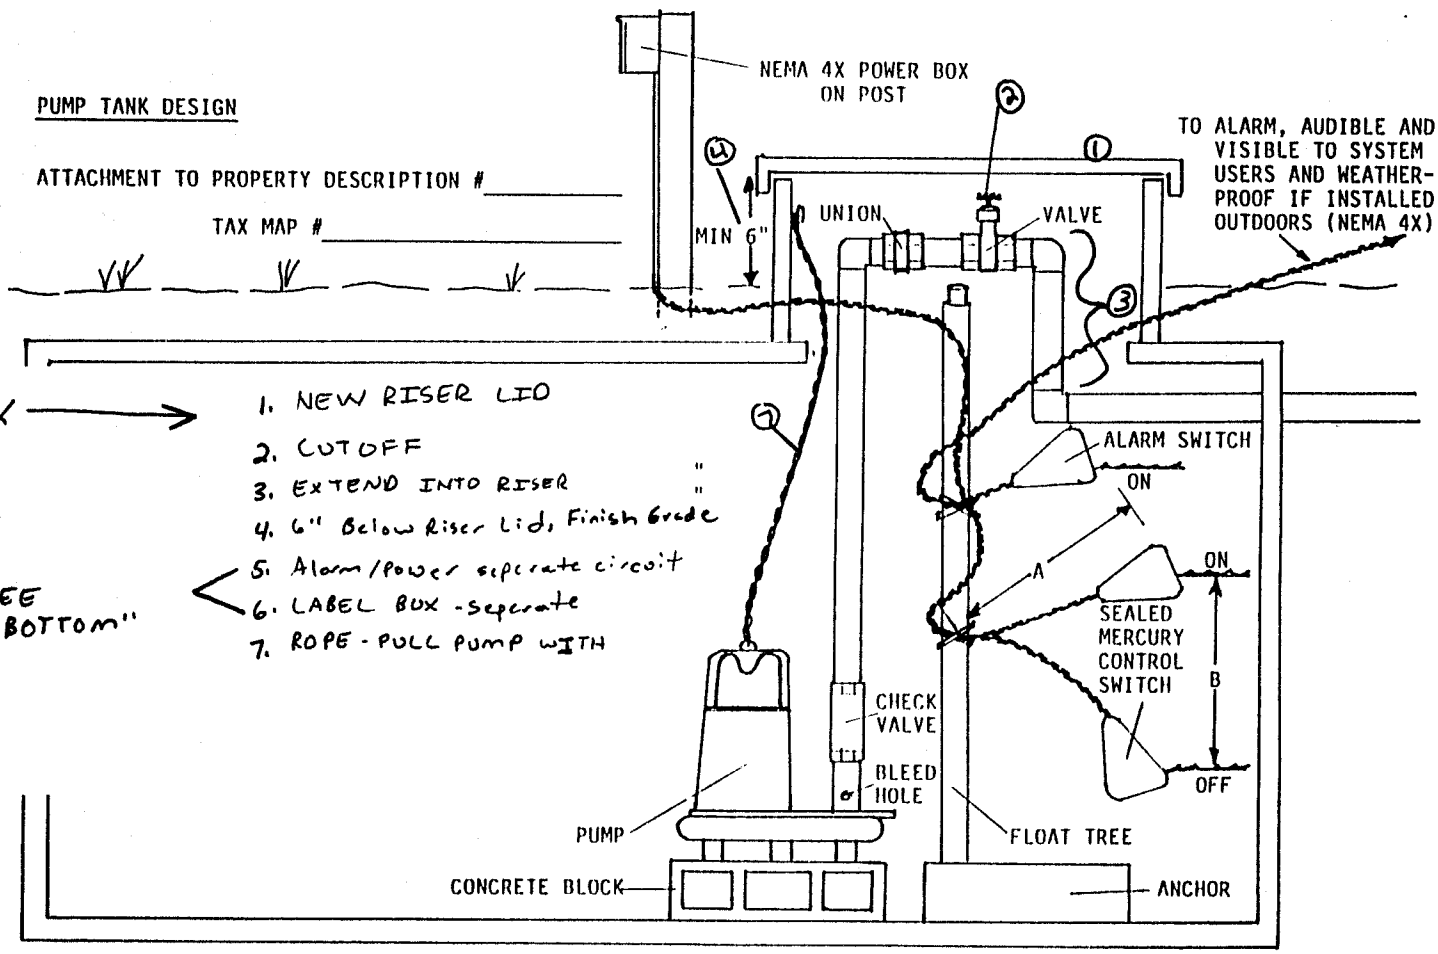

FIX →

1. NEW RISER LID
2. CUTOFF
3. EXTEND INTO RISER " "
4. 6" Below Riser Lid, Finish Grade
5. Alarm/Power seperate circuit
6. LABEL BOX - seperate
7. ROPE - PULL PUMP WITH

"SEE BOTTOM"

5. THE ALARM & PUMP POWER SUPPLY IS WIRED ON SAME CIRCUIT. It needs to be on two seperate circuits.

6. POWER BOX NEEDS TO BE LABELED with alarm & pump power supply.