10786

IREDELL COUNTY HEALTH DEPARTMENT

36788

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Rick Dyson Heritage Bldg Co. DATE 9-19-90 PERMIT NO. 10H-1-A-33

PHONE: Business _____ Home _____

LOCATION Dunlap Gate Loop Lot 33 S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit	Yes ( )	No (✓)
Auto. Dishwasher	Yes (✓)	No ( )
Auto. Wash. Machine	Yes (✓)	No ( )
Site Suitable	Yes (✓)	No ( )

Lot Area 20,000 Sq'

Character & Porosity of Soil Clayey

Percolation Rate 24

Topography 2 to 6%

Depth to Water Table 10'+


Rock or other impervious formations None

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 3
Sq. Ft. 900 Linear Ft. 300
Depth of Stone in Lines 12"

Water Supply: Individual ( )
Public (✓)

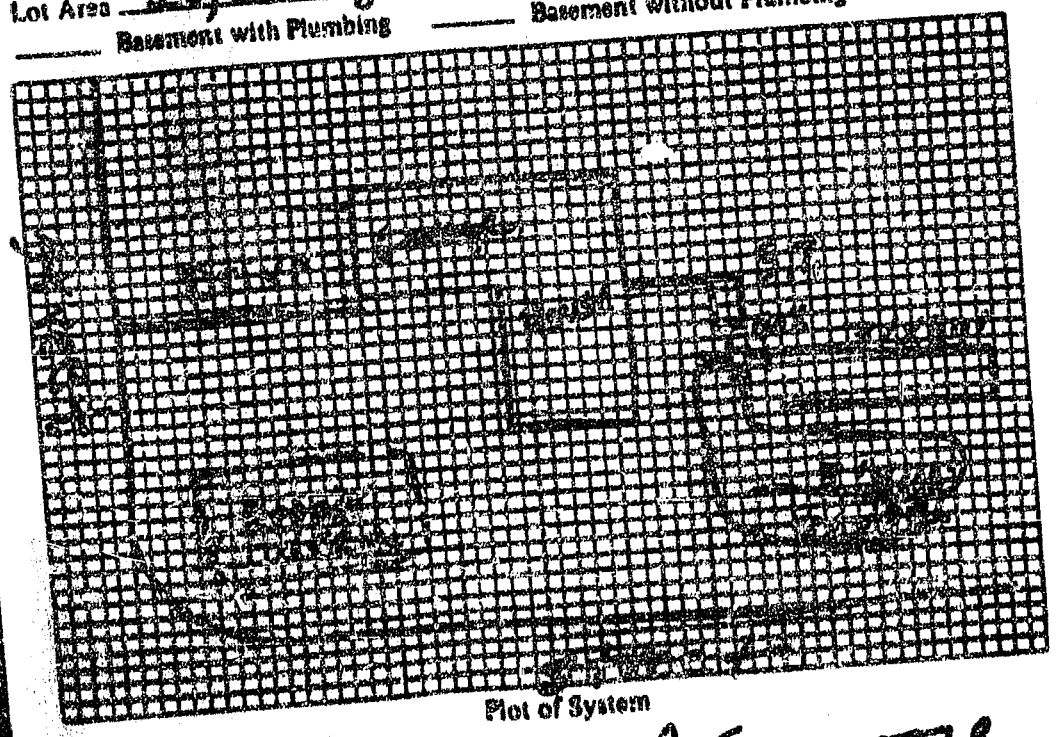

Plot of System

Installed by Wes Lytton

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY R. C. Moore

COMMENTS: _____

CERTIFICATE OF COMPLETION BY R. C. Moore DATE 9-19-90

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold